



Test Report issued under the responsibility of:



TEST REPORT

IEC 62368-1

Audio/video, information and communication technology equipment Part 1: Safety requirements

Report Number : CN25FJQ7 001
Date of issue : 2025-07-30
Total number of pages : 59 (excluding attachments, see page 3)

**Name of Testing Laboratory
preparing the Report** : TÜV Rheinland (Shanghai) Co., Ltd.

Applicant's name : HCS KABLOLAMA SISTEMLERİ SANAYİ VE TİCARET A.Ş.
Address : HCS Cabling Systems İkitelli OSB Mahallesi, 8. Cadde, No: 3/A- 3/B Kat: 1
34490 Basakşehir Türkiye

Test specification:

Standard : IEC 62368-1:2014
Test procedure : CB Scheme
Non-standard test method : N/A

TRF template used : IECEE OD-2020-F1:2021, Ed.1.4
Test Report Form No. : IEC62368_1D
Test Report Form(s) Originator... : UL(US)
Master TRF : Dated 2022-04-14

Copyright © 2022 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved.




This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

General disclaimer:

The test results presented in this report relate only to the object tested.
This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory.
The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.

Test Item description	Power Distribution Unit	
Trade Mark(s)		
Manufacturer	Same as applicant	
Model/Type reference	BPDU series BPIM series NPIM series SPIM series SPOS series SPOM series SPOX series Refer to Attachment – Model difference list for details	
Ratings	I/P: AC 190-240V or AC 380-415V, 50/60Hz, 16A or 32A; Class I Refer to Attachment – Model difference list for details	
Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
<input checked="" type="checkbox"/> CB Testing Laboratory:	TÜV Rheinland (Shanghai) Co., Ltd.	
Testing location/ address	No.177, Lane 777 West Guangzhong Road, Jing'an District, Shanghai, China c/o TUV Rheinland Suzhou Co. Ltd. Pingqian (Taicang) Modern Industrial Park, No.525, Yuewang Lingang South Road, Shaxi Town, Taicang City, Jiangsu Province, China	
Tested by (name, function, signature)	Xiang Ding / Project Engineer	
Approved by (name, function, signature)	Spike Wu / Expert	
Testing procedure: CTF Stage 1:		
<input type="checkbox"/> Testing procedure: CTF Stage 1:	N/A	
Testing location/ address		
Tested by (name, function, signature)		
Approved by (name, function, signature)		
Testing procedure: CTF Stage 2:		
<input type="checkbox"/> Testing procedure: CTF Stage 2:	N/A	
Testing location/ address		
Tested by (name, function, signature)		
Witnessed by (name, function, signature)		
Approved by (name, function, signature)		
Testing procedure: CTF Stage 3 :		
<input type="checkbox"/> Testing procedure: CTF Stage 3 :	N/A	
Testing procedure: CTF Stage 4:		
<input type="checkbox"/> Testing procedure: CTF Stage 4:	N/A	
Testing location/ address		
Tested by (name, function, signature)		
Witnessed by (name, function, signature)		

Approved by (name, function, signature) :		
Supervised by (name, function, signature)..... :		

List of Attachments (including a total number of pages in each attachment):

ATTACHMENT – National Differences (52 pages)

ATTACHMENT – Photo Documentation (36 pages)

Note: Total number of pages in each attachment is indicated in individual attachment.

Summary of testing:

All applicable tests are the type tests, the routine tests involved shall be conducted by manufacturer during manufacturing.

The load conditions used during testing: Maximum normal load according to Annex B.2 for this equipment is the operation with the maximum specified AC-load and DC-load with maximum power condition according to the manufacturer specified.

The test sample is pre-production sample without serial number.

Tests performed (name of test and test clause):

All applicable tests as described in test case and measurement sections were performed on model XBSPOX60-4232A3P-Vxx and XBSPOX60-4232A1P-Vxx.

The product was submitted and evaluated for use at the maximum ambient temperature (T_{ma}) permitted by the manufacturers specification of 50 °C

Testing location:

TUV Rheinland Suzhou Co. Ltd.

Pingqian (Taicang) Modern Industrial Park, No.525, Yuewang Lingang South Road, Shaxi Town, Taicang City, Jiangsu Province, China

Summary of compliance with National Differences (List of countries addressed):

EU Group Differences, EU Special National Conditions, CA, JP, US, DK, IT, AU, NZ

Explanation of used codes: CA=Canada, JP=Japan, US=United States of America, DK= Denmark, IT=Italy, AU=Australia, NZ=New Zealand

☒ **The product fulfils the requirements of**

- IEC 62368-1:2014 (Second Edition)
- EN 62368-1:2014+A11:2017
- CSA/UL 62368-1:2014

Use of uncertainty of measurement for decisions on conformity (decision rule) :

☒ No decision rule is specified by the IEC standard, when comparing the measurement result with the applicable limit according to the specification in that standard. The decisions on conformity are made without applying the measurement uncertainty ("simple acceptance" decision rule, previously known as "accuracy method").

☐ Other:... (to be specified, for example when required by the standard or client, or if national accreditation requirements apply)

Information on uncertainty of measurement:

The uncertainties of measurement are calculated by the laboratory based on application of criteria given by OD-5014 for test equipment and application of test methods, decision sheets and operational procedures of IECEE.

IEC Guide 115 provides guidance on the application of measurement uncertainty principles and applying the decision rule when reporting test results within IECEE scheme, noting that the reporting of the measurement uncertainty for measurements is not necessary unless required by the test standard or customer.

Calculations leading to the reported values are on file with the NCB and testing laboratory that conducted the testing.

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

ITEM:XBSP0X60-4232A3P-VBK

PDU 0U 42 IEX POMS

H07RN-F 5G4.0mm² 32A Plug

Input Rating:380-415VAC;32A;50/60Hz

Output Rating:190-240VAC



HCS Cabling Systems



Order No:



Test Sample

ITEM:XBSP0X60-4232A1P-VBK

PDU 0U 42 IEX POMS

H07RN-F 3G4.0mm² 32A Plug

Input Rating:190-240VAC;32A;50/60Hz

Output Rating:190-240VAC



HCS Cabling Systems



Order No:



Test Sample

Note: Marking plates for other models are similar as above except model number and ratings.

TEST ITEM PARTICULARS:	
Classification of use by..... :	<input type="checkbox"/> Ordinary person <input checked="" type="checkbox"/> Instructed person <input checked="" type="checkbox"/> Skilled person <input type="checkbox"/> Children likely to be present
Supply Connection..... :	<input checked="" type="checkbox"/> AC Mains <input type="checkbox"/> DC Mains <input type="checkbox"/> External Circuit - not Mains connected - <input type="checkbox"/> ES1 <input type="checkbox"/> ES2 <input type="checkbox"/> ES3
Supply % Tolerance :	<input checked="" type="checkbox"/> +10%/-10% <input type="checkbox"/> +20%/-15% <input type="checkbox"/> +____%/ -____% <input type="checkbox"/> None
Supply Connection – Type :	<input type="checkbox"/> pluggable equipment type A - <input type="checkbox"/> non-detachable supply cord <input type="checkbox"/> appliance coupler <input type="checkbox"/> direct plug-in <input type="checkbox"/> mating connector <input checked="" type="checkbox"/> pluggable equipment type B - <input checked="" type="checkbox"/> non-detachable supply cord <input type="checkbox"/> appliance coupler <input type="checkbox"/> permanent connection <input type="checkbox"/> mating connector <input type="checkbox"/> other:
Considered current rating of protective device as part of building or equipment installation :	16 A Installation location: <input checked="" type="checkbox"/> building; <input checked="" type="checkbox"/> equipment(Only for models with input current rating 32A)
Equipment mobility..... :	<input checked="" type="checkbox"/> movable <input type="checkbox"/> hand-held <input type="checkbox"/> transportable <input type="checkbox"/> stationary <input type="checkbox"/> for building-in <input type="checkbox"/> direct plug-in <input checked="" type="checkbox"/> rack-mounting <input type="checkbox"/> wall-mounted
Over voltage category (OVC) :	<input type="checkbox"/> OVC I <input checked="" type="checkbox"/> OVC II <input type="checkbox"/> OVC III <input type="checkbox"/> OVC IV <input type="checkbox"/> other:
Class of equipment :	<input checked="" type="checkbox"/> Class I <input type="checkbox"/> Class II <input type="checkbox"/> Class III <input type="checkbox"/> Class II with functional earthing <input type="checkbox"/> Not classified
Access location :	<input type="checkbox"/> restricted access area <input checked="" type="checkbox"/> N/A
Pollution degree (PD) :	<input type="checkbox"/> PD 1 <input checked="" type="checkbox"/> PD 2 <input type="checkbox"/> PD 3
Manufacturer's specified maximum operating ambient :	50°C
IP protection class :	<input checked="" type="checkbox"/> IPX0 <input type="checkbox"/> IP__
Power Systems :	<input checked="" type="checkbox"/> TN <input type="checkbox"/> TT <input type="checkbox"/> IT - ____ V L-L; <input type="checkbox"/> dc mains <input type="checkbox"/> N/A
Altitude during operation (m) :	<input checked="" type="checkbox"/> 2000 m or less <input type="checkbox"/> ____ m or less
Altitude of test laboratory (m) :	<input checked="" type="checkbox"/> 2000 m or less <input type="checkbox"/> ____ m
Mass of equipment (kg) :	<input checked="" type="checkbox"/> 2.5-7.5 kg depends on the exact model

Possible test case verdicts:

- test case does not apply to the test object : N/A
- test object does meet the requirement : P (Pass)
- test object does not meet the requirement : F (Fail)

Testing..... :

Date of receipt of test item : 2025-06-11

Date (s) of performance of tests..... : 2025-06-16 to 2025-07-09

General remarks:

"(See Enclosure #)" refers to additional information appended to the report.
 "(See appended table)" refers to a table appended to the report.

Throughout this report a ☐ comma / ☒ point is used as the decimal separator.

Manufacturer's Declaration per sub-clause 4.2.5 of IEC 60335-1:

The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided

- ☐ Yes
☒ Not applicable

When differences exist; they shall be identified in the General product information section.

Name and address of factory (ies)

NINGBO HAISHU CHAOBAI DIANZI CO., LTD
 3rd Floor, Block 2, No. 7 Xiufeng Road, Gaoqiao Town,
 Haishu Area, Ningbo, 315175 Zhejiang, P.R. China

General product information and other remarks:**Product Description –**

The equipments are a Power Distribution Unit for use with information technology equipment. It consists of optional electronic components with optional circuit breakers and housed in a metal enclosure with plastic caps on the two ends. The enclosures secured together by screws and mechanical construction.
 The PDUs are designed for indoor use only, and do not provide surge or line noise protection for connected equipments. There are no user serviceable parts inside.
 There are two input current ratings for all models as 16A and 32A. Only models with input current rating 32A are configured with a circuit break for each line.
 All appliance outlets used on all models are tested and evaluated by TUV Rheinland and complied with the standards of IEC 61984:2008, EN 61984:2009 and UL 498:2020. Refer to table 4.1.2 for details.

Model Differences –

All models are similar except for frame size, power system phase and optional functions, except below description for differences among the 7 series (BPDU series, BPIM series, NPIM series, SPIM series, SPOS series, SPOM series, SPOX series), others please refer to attachment - Model difference List for details.

BPDU series is without any functional boards.

BPIM series based on the BPDU series is additionally with power meter function.

NPIM series based on the BPDU series is additionally with data display function like total current, voltage, power and electricity.

SPIM series is with the same functions and parameters as the NPIM series, but with more advanced terminal, control, display and SNMP module.

SPOS series based on the BPIM series is additionally with remote switch function to each appliance outlet.

SPOM series based on the BPIM series is additionally with remote data monitoring function to each appliance outlet.

SPOX series based on the BPIM series is additionally with remote switch function and data monitoring function to

each appliance outlet.

Additional application considerations – (Considerations used to test a component or sub-assembly) –

- Some components are pre-certified, which have been evaluated according to the relevant requirements of IEC 62368-1, are employed in this product. Their suitability of use has been checked according to clauses 4.1.2.
- Tests were repeated with each alternative source of components with identical results unless otherwise specified.
- The equipment provided fixed type rack mount, wall mount (portrait orientation only) and desk-top function.
- The end product with optical transceivers installed is required to comply with laser class 1 product according to IEC/EN 62368-1 and IEC/EN 60825-1 and IEC/EN 60825-2, including any declared national differences.

ENERGY SOURCE IDENTIFICATION AND CLASSIFICATION TABLE:	
(Note 1: Identify the following six (6) energy source forms based on the origin of the energy.) (Note 2: The identified classification e.g., ES2, TS1, should be with respect to its ability to cause pain or injury on the body or its ability to ignite a combustible material. Any energy source can be declared Class 3 as a worse case classification e.g. PS3, ES3.)	
Electrically-caused injury (Clause 5): (Note: Identify type of source, list sub-assembly or circuit designation and corresponding energy source classification) Example: +5 V dc input	
ES1	
Source of electrical energy	Corresponding classification (ES)
All internal circuits (AC mains, AC/DC power module, appliance outlets)	ES3
All secondary terminals	ES1
Electrically-caused fire (Clause 6): (Note: List sub-assembly or circuit designation and corresponding energy source classification) Example: Battery pack (maximum 85 watts):	
PS2	
Source of power or PIS	Corresponding classification (PS)
All circuits except USB terminals	PS3
USB terminals	PS1
Injury caused by hazardous substances (Clause 7) (Note: Specify hazardous chemicals, whether produces ozone or other chemical construction not addressed as part of the component evaluation.) Example: Liquid in filled component	
Glycol	
Source of hazardous substances	Corresponding chemical
Non-rechargeable RTC battery	Li-ion
Mechanically-caused injury (Clause 8) (Note: List moving part(s), fan, special installations, etc. & corresponding MS classification based on Table 35.) Example: Wall mount unit	
MS2	
Source of kinetic/mechanical energy	Corresponding classification (MS)
Equipment mass (2.5-7.5 kg)	MS1 or MS2 depends on the exact model
Edges and corners	MS1
Thermal burn injury (Clause 9) (Note: Identify the surface or support, and corresponding energy source classification based on type of part, location, operating temperature and contact time in Table 38.) Example: Hand-held scanner – thermoplastic enclosure	
TS1	
Source of thermal energy	Corresponding classification (TS)
All accessible parts	TS1
Inside of equipment	TS3
Radiation (Clause 10) (Note: List the types of radiation present in the product and the corresponding energy source classification.) Example: DVD – Class 1 Laser Product	
RS1	
Type of radiation	Corresponding classification (RS)
Low power applications of LED	RS1

ENERGY SOURCE DIAGRAM				
Indicate which energy sources are included in the energy source diagram. Insert diagram below				
<p>< Refer to ENERGY SOURCE IDENTIFICATION AND CLASSIFICATION TABLE ></p> <p> <input checked="" type="checkbox"/> ES <input checked="" type="checkbox"/> PS <input checked="" type="checkbox"/> MS <input checked="" type="checkbox"/> TS <input checked="" type="checkbox"/> RS </p>				
OVERVIEW OF EMPLOYED SAFEGUARDS				
Clause	Possible Hazard			
5.1	Electrically-caused injury			
Body Part (e.g. Ordinary)	Energy Source (ES3: Primary Filter circuit)	Safeguards		
		Basic	Supplementary	Reinforced (Enclosure)
Instructed person	ES3: All internal circuits (AC mains, AC/DC power module primary parts, appliance outlets)	Insulation between primary circuits and secondary circuits or accessible parts	Earthed metal enclosure	Insulation + component safeguards in approved power supply
Skilled person		Skilled safeguard	Skilled safeguard	Skilled safeguard
6.1	Electrically-caused fire			
Material part (e.g. mouse enclosure)	Energy Source (PS2: 100 Watt circuit)	Safeguards		
		Basic	Supplementary	Reinforced
All combustible materials	PS3: All circuits except USB terminals	Ignition not occurred and temperature within the limits	All printed boards are made of V-0 class material Used of IEC components and components mounted on V-0 PCB Internal wire: VW-1	Fire enclosure rated metal and V-0 complied with cl. 6.4.8
7.1	Injury caused by hazardous substances			
Body Part (e.g., skilled)	Energy Source (hazardous material)	Safeguards		
		Basic	Supplementary	Reinforced
Instructed person, Skilled person	Li-ion	N/A	N/A	Comply with Annex M
8.1	Mechanically-caused injury			
Body Part (e.g. Ordinary)	Energy Source (MS3:High Pressure Lamp)	Safeguards		
		Basic	Supplementary	Reinforced (Enclosure)
Instructed person, Skilled person	MS1 or MS2 depends on the exact model	No stability requirements for fixed equipment	N/A	N/A
Instructed person, Skilled person	MS1: Edges and corners	N/A	N/A	N/A
9.1	Thermal Burn			
Body Part	Energy Source	Safeguards		

(e.g., Ordinary)	(TS2)	Basic	Supplementary	Reinforced
Instructed person	TS1: All accessible parts	N/A	N/A	N/A
Skilled person	TS3: Inside of equipment	Skilled safeguard	Skilled safeguard	Skilled safeguard
10.1	Radiation			
Body Part (e.g., Ordinary)	Energy Source (Output from audio port)	Safeguards		
		Basic	Supplementary	Reinforced
Instructed person, Skilled person	RS1: Low power applications of LED	N/A	N/A	N/A
Supplementary Information:				
(1) See attached energy source diagram for additional details.				
(2) "N" – Normal Condition; "A" – Abnormal Condition; "S" Single Fault				

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
4	GENERAL REQUIREMENTS		P
4.1.1	Acceptance of materials, components and subassemblies	(See appended table 4.1.2)	P
4.1.2	Use of components	Components which are certified to IEC and/or national standards are used correctly within their ratings. Components not covered by IEC standards are tested under the conditions present in the equipment	P
4.1.3	Equipment design and construction		P
4.1.15	Markings and instructions..... :	(See Annex F)	P
4.4.4	Safeguard robustness		P
4.4.4.2	Steady force tests :	(See Annex T.5)	P
4.4.4.3	Drop tests :		N/A
4.4.4.4	Impact tests :	(See Annex T.6)	P
4.4.4.5	Internal accessible safeguard enclosure and barrier tests..... :		N/A
4.4.4.6	Glass Impact tests..... :		N/A
4.4.4.7	Thermoplastic material tests..... :	(See Annex T.8)	P
4.4.4.8	Air comprising a safeguard..... :		N/A
4.4.4.9	Accessibility and safeguard effectiveness		P
4.5	Explosion	No explosion occurs during normal/abnormal operation and single fault conditions	P
4.6	Fixing of conductors		P
4.6.1	Fix conductors not to defeat a safeguard		P
4.6.2	10 N force test applied to :	Complied	P
4.7	Equipment for direct insertion into mains socket - outlets	Not a direct plug-in type equipment	N/A
4.7.2	Mains plug part complies with the relevant standard..... :		N/A
4.7.3	Torque (Nm) :		N/A
4.8	Products containing coin/button cell batteries	Equipment for use in locations where it is unlikely that children will be present	N/A
4.8.2	Instructional safeguard		N/A
4.8.3	Battery Compartment Construction		N/A
	Means to reduce the possibility of children removing the battery :		—
4.8.4	Battery Compartment Mechanical Tests :		N/A
4.8.5	Battery Accessibility		N/A
4.9	Likelihood of fire or shock due to entry of conductive object :	(See Annex P)	P
5	ELECTRICALLY-CAUSED INJURY		P
5.2.1	Electrical energy source classifications..... :	(See appended table 5.2)	P

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
5.2.2	ES1, ES2 and ES3 limits		P
5.2.2.2	Steady-state voltage and current.....:	(See appended table 5.2)	P
5.2.2.3	Capacitance limits		N/A
5.2.2.4	Single pulse limits.....:		N/A
5.2.2.5	Limits for repetitive pulses.....:		N/A
5.2.2.6	Ringing signals	No ringing signal	N/A
5.2.2.7	Audio signals	No audio signal	N/A
5.3	Protection against electrical energy sources		P
5.3.1	General Requirements for accessible parts to ordinary, instructed and skilled persons		P
5.3.2.1	Accessibility to electrical energy sources and safeguards		P
5.3.2.2	Contact requirements		P
	a) Test with test probe from Annex V.....:	The test probe cannot access the hazardous live part	P
	b) Electric strength test potential (V)		N/A
	c) Air gap (mm)	More than 2.0 mm	P
5.3.2.4	Terminals for connecting stripped wire		N/A
5.4	Insulation materials and requirements		P
5.4.1.2	Properties of insulating material	No such hygroscopic materials are used as insulation	P
5.4.1.3	Humidity conditioning		N/A
5.4.1.4	Maximum operating temperature for insulating materials	(See appended table 5.4.1.4)	P
5.4.1.5	Pollution degree	2	—
5.4.1.5.2	Test for pollution degree 1 environment and for an insulating compound		N/A
5.4.1.5.3	Thermal cycling		N/A
5.4.1.6	Insulation in transformers with varying dimensions		N/A
5.4.1.7	Insulation in circuits generating starting pulses		N/A
5.4.1.8	Determination of working voltage		P
5.4.1.9	Insulating surfaces		P
5.4.1.10	Thermoplastic parts on which conductive metallic parts are directly mounted	Evaluated in approved power supply unit	P
5.4.1.10.2	Vicat softening temperature		N/A
5.4.1.10.3	Ball pressure	(See appended table 5.4.1.10.3)	P
5.4.2	Clearances		P
5.4.2.2	Determining clearance using peak working voltage	(See appended table 5.4.2.2)	P
5.4.2.3	Determining clearance using required withstand voltage	(See appended table 5.4.2.3)	P
	a) a.c. mains transient voltage	OVC II, 2500 V peak	—
	b) d.c. mains transient voltage		—

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
	c) external circuit transient voltage.....:		—
	d) transient voltage determined by measurement... :		—
5.4.2.4	Determining the adequacy of a clearance using an electric strength test	Not used	N/A
5.4.2.5	Multiplication factors for clearances and test voltages	Less than 2000m	P
5.4.3	Creepage distances.....:	(See appended table 5.4.3)	P
5.4.3.1	General		P
5.4.3.3	Material Group	IIIb assumed	—
5.4.4	Solid insulation		P
5.4.4.2	Minimum distance through insulation	(See appended table 5.4.4.2)	P
5.4.4.3	Insulation compound forming solid insulation	Approved optocoupler used	P
5.4.4.4	Solid insulation in semiconductor devices	Approved optocoupler used	P
5.4.4.5	Cemented joints		N/A
5.4.4.6	Thin sheet material		N/A
5.4.4.6.1	General requirements		N/A
5.4.4.6.2	Separable thin sheet material		N/A
	Number of layers (pcs)		N/A
5.4.4.6.3	Non-separable thin sheet material		N/A
5.4.4.6.4	Standard test procedure for non-separable thin sheet material		N/A
5.4.4.6.5	Mandrel test		N/A
5.4.4.7	Solid insulation in wound components		N/A
5.4.4.9	Solid insulation at frequencies >30 kHz		N/A
5.4.5	Antenna terminal insulation		N/A
5.4.5.1	General		N/A
5.4.5.2	Voltage surge test		N/A
	Insulation resistance (MΩ)		—
5.4.6	Insulation of internal wire as part of supplementary safeguard.....:		N/A
5.4.7	Tests for semiconductor components and for cemented joints		N/A
5.4.8	Humidity conditioning		P
	Relative humidity (%)	95%	—
	Temperature (°C)	40 °C	—
	Duration (h)	120 h	—
5.4.9	Electric strength test.....:	(See appended table 5.4.9)	P
5.4.9.1	Test procedure for a solid insulation type test		P
5.4.9.2	Test procedure for routine tests	Considered in factory inspection	N/A
5.4.10	Protection against transient voltages between external circuit		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
5.4.10.1	Parts and circuits separated from external circuits		N/A
5.4.10.2	Test methods		N/A
5.4.10.2.1	General		N/A
5.4.10.2.2	Impulse test		N/A
5.4.10.2.3	Steady-state test		N/A
5.4.11	Insulation between external circuits and earthed circuitry		N/A
5.4.11.1	Exceptions to separation between external circuits and earth		N/A
5.4.11.2	Requirements		N/A
	Rated operating voltage U_{op} (V)		—
	Nominal voltage U_{peak} (V)		—
	Max increase due to variation U_{sp}		—
	Max increase due to ageing $\square U_{sa}$		—
	$U_{op} = U_{peak} + \square U_{sp} + \square U_{sa}$		—
5.5	Components as safeguards		P
5.5.1	General		P
5.5.2	Capacitors and RC units		P
5.5.2.1	General requirement	Y-Cap., are IEC 60384-14 approval components and complied with Annex G.11.	P
5.5.2.2	Safeguards against capacitor discharge after disconnection of a connector	No X capacitors.	N/A
5.5.3	Transformers	Evaluated in approved power supply unit	P
5.5.4	Optocouplers	Approved source used, see appended table 4.1.2 for details.	P
5.5.5	Relays	Approved source used, see appended table 4.1.2 for details.	P
5.5.6	Resistors		N/A
5.5.7	SPD's	Approved source used, see appended table 4.1.2 for details.	P
5.5.7.1	Use of an SPD connected to reliable earthing		P
5.5.7.2	Use of an SPD between mains and protective earth		P
5.5.8	Insulation between the mains and external circuit consisting of a coaxial cable		N/A
5.6	Protective conductor		P
5.6.2	Requirement for protective conductors		P
5.6.2.1	General requirements		P
5.6.2.2	Colour of insulation		P
5.6.3	Requirement for protective earthing conductors		P
	Protective earthing conductor size (mm ²)	2.5 or 4 depend on exact model	—

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
5.6.4	Requirement for protective bonding conductors		P
5.6.4.1	Protective bonding conductors		P
	Protective bonding conductor size (mm ²)..... :	2.5 or 4 depend on exact model	—
	Protective current rating (A) :	16	—
5.6.4.3	Current limiting and overcurrent protective devices	Approved circuit breaker used on each line of models with input current rating 32A	P
5.6.5	Terminals for protective conductors	Approved industrial plug used	P
5.6.5.1	Requirement		P
	Conductor size (mm ²), nominal thread diameter (mm)..... :	Screw diameter 5.0mm	P
5.6.5.2	Corrosion		P
5.6.6	Resistance of the protective system		P
5.6.6.1	Requirements		P
5.6.6.2	Test Method Resistance (Ω)..... :	(See appended table 5.6.6.2)	P
5.6.7	Reliable earthing		P
5.7	Prospective touch voltage, touch current and protective conductor current		P
5.7.2	Measuring devices and networks		P
5.7.2.1	Measurement of touch current..... :	(See appended table 5.7.4)	P
5.7.2.2	Measurement of prospective touch voltage		P
5.7.3	Equipment set-up, supply connections and earth connections		P
	System of interconnected equipment (separate connections/single connection) :		—
	Multiple connections to mains (one connection at a time/simultaneous connections) :	Simultaneous connections	—
5.7.4	Earthed conductive accessible parts :	(See appended table 5.7.4)	P
5.7.5	Protective conductor current		P
	Supply Voltage (V) :	457	—
	Measured current (mA) :	0.068	—
	Instructional Safeguard :	Not applicable.	N/A
5.7.6	Prospective touch voltage and touch current due to external circuits		N/A
5.7.6.1	Touch current from coaxial cables		N/A
5.7.6.2	Prospective touch voltage and touch current from external circuits		N/A
5.7.7	Summation of touch currents from external circuits		N/A
	a) Equipment with earthed external circuits Measured current (mA) :		N/A
	b) Equipment whose external circuits are not referenced to earth. Measured current (mA) :		N/A
6	ELECTRICALLY- CAUSED FIRE		P
6.2	Classification of power sources (PS) and potential ignition sources (PIS)		P

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
6.2.2	Power source circuit classifications		P
6.2.2.1	General		P
6.2.2.2	Power measurement for worst-case load fault.....:	(See appended table 6.2.2)	P
6.2.2.3	Power measurement for worst-case power source fault.....:	(See appended table 6.2.2)	P
6.2.2.4	PS1		N/A
6.2.2.5	PS2		N/A
6.2.2.6	PS3	(See appended table 6.2.2)	P
6.2.3	Classification of potential ignition sources		P
6.2.3.1	Arcing PIS	Primary circuits are considered as arcing PIS	P
6.2.3.2	Resistive PIS	All components are considered as resistive PIS	P
6.3	Safeguards against fire under normal operating and abnormal operating conditions		P
6.3.1 (a)	No ignition and attainable temperature value less than 90 % defined by ISO 871 or less than 300 °C for unknown materials	(See appended table 5.4.1.5, 6.3.2, 9.0, B.2.6)	P
6.3.1 (b)	Combustible materials outside fire enclosure	No combustible materials outside fire enclosure	N/A
6.4	Safeguards against fire under single fault conditions		P
6.4.1	Safeguard Method	The method "Control of fire spread" is selected	P
6.4.2	Reduction of the likelihood of ignition under single fault conditions in PS1 circuits		N/A
6.4.3	Reduction of the likelihood of ignition under single fault conditions in PS2 and PS3 circuits		N/A
6.4.3.1	General		N/A
6.4.3.2	Supplementary Safeguards		N/A
	Special conditions if conductors on printed boards are opened or peeled		N/A
6.4.3.3	Single Fault Conditions		N/A
	Special conditions for temperature limited by fuse		N/A
6.4.4	Control of fire spread in PS1 circuits		N/A
6.4.5	Control of fire spread in PS2 circuits		N/A
6.4.5.2	Supplementary safeguards		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
6.4.6	Control of fire spread in PS3 circuit	Compliance detailed as follows: – Printed board: V-0 class material; – Wire insulation and tubing: complying with clause 6 – All other components: at least V-2 except for mounted on min. V-1 material or small parts of combustible material. Also see table 4.1.2 and annex G – Isolating transformer: Evaluated in approved power supply unit Fire metal enclosure of clause 6.4.8 provided with the equipment	P
6.4.7	Separation of combustible materials from a PIS		N/A
6.4.7.1	General.....:		N/A
6.4.7.2	Separation by distance		N/A
6.4.7.3	Separation by a fire barrier		N/A
6.4.8	Fire enclosures and fire barriers	Metal chassis is considered as a fire enclosure	P
6.4.8.1	Fire enclosure and fire barrier material properties	See 6.4.8.2.2	P
6.4.8.2.1	Requirements for a fire barrier		N/A
6.4.8.2.2	Requirements for a fire enclosure		P
6.4.8.3	Constructional requirements for a fire enclosure and a fire barrier		P
6.4.8.3.1	Fire enclosure and fire barrier openings		N/A
6.4.8.3.2	Fire barrier dimensions		N/A
6.4.8.3.3	Top Openings in Fire Enclosure: dimensions (mm)	No top openings.	N/A
	Needle Flame test		N/A
6.4.8.3.4	Bottom Openings in Fire Enclosure, condition met a), b) and/or c) dimensions (mm)	No bottom openings.	N/A
	Flammability tests for the bottom of a fire enclosure		N/A
6.4.8.3.5	Integrity of the fire enclosure, condition met: a), b) or c)		N/A
6.4.8.4	Separation of PIS from fire enclosure and fire barrier distance (mm) or flammability rating	Metal enclosure and V-0 plastic enclosure used	P
6.5	Internal and external wiring		P
6.5.1	Requirements	UL VW-1 wire is used. UL 758 VW-1 certification is considered to be more severe than related IEC testing method	P
6.5.2	Cross-sectional area (mm ²)		—
6.5.3	Requirements for interconnection to building wiring		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
6.6	Safeguards against fire due to connection to additional equipment		P
	External port limited to PS2 or complies with Clause Q.1	USB port complies with Annex Q.1	P
7	INJURY CAUSED BY HAZARDOUS SUBSTANCES		P
7.2	Reduction of exposure to hazardous substances		N/A
7.3	Ozone exposure		N/A
7.4	Use of personal safeguards (PPE)		N/A
	Personal safeguards and instructions		—
7.5	Use of instructional safeguards and instructions		N/A
	Instructional safeguard (ISO 7010)		—
7.6	Batteries	(See Annex M)	P
8	MECHANICALLY-CAUSED INJURY		P
8.1	General		P
8.2	Mechanical energy source classifications		P
8.3	Safeguards against mechanical energy sources		N/A
8.4	Safeguards against parts with sharp edges and corners	Edges and corners are rounded	N/A
8.4.1	Safeguards		N/A
8.5	Safeguards against moving parts		N/A
8.5.1	MS2 or MS3 part required to be accessible for the function of the equipment		N/A
8.5.2	Instructional Safeguard		—
8.5.4	Special categories of equipment comprising moving parts		N/A
8.5.4.1	Large data storage equipment		N/A
8.5.4.2	Equipment having electromechanical device for destruction of media		N/A
8.5.4.2.1	Safeguards and Safety Interlocks		N/A
8.5.4.2.2	Instructional safeguards against moving parts		N/A
	Instructional Safeguard		—
8.5.4.2.3	Disconnection from the supply		N/A
8.5.4.2.4	Probe type and force (N)		N/A
8.5.5	High Pressure Lamps		N/A
8.5.5.1	Energy Source Classification		N/A
8.5.5.2	High Pressure Lamp Explosion Test		N/A
8.6	Stability	Fixed equipment (rack-mounting)	N/A
8.6.1	Product classification		N/A
	Instructional Safeguard		—
8.6.2	Static stability		N/A
8.6.2.2	Static stability test		N/A
	Applied Force		—

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
8.6.2.3	Downward Force Test		N/A
8.6.3	Relocation stability test		N/A
	Unit configuration during 10° tilt..... :		—
8.6.4	Glass slide test		N/A
8.6.5	Horizontal force test (Applied Force)..... :		N/A
	Position of feet or movable parts :		—
8.7	Equipment mounted to wall or ceiling		N/A
8.7.1	Mounting Means (Length of screws (mm) and mounting surface) :		N/A
8.7.2	Direction and applied force..... :		N/A
8.8	Handles strength		N/A
8.8.1	Classification		N/A
8.8.2	Applied Force :		N/A
8.9	Wheels or casters attachment requirements		N/A
8.9.1	Classification		N/A
8.9.2	Applied force :		—
8.10	Carts, stands and similar carriers		N/A
8.10.1	General		N/A
8.10.2	Marking and instructions		N/A
	Instructional Safeguard :		—
8.10.3	Cart, stand or carrier loading test and compliance		N/A
	Applied force :		—
8.10.4	Cart, stand or carrier impact test		N/A
8.10.5	Mechanical stability		N/A
	Applied horizontal force (N)..... :		—
8.10.6	Thermoplastic temperature stability (°C) :		N/A
8.11	Mounting means for rack mounted equipment		P
8.11.1	General	For mounting option 2 & 3	P
8.11.2	Product Classification	MS1 or MS2 depends on exact model	P
8.11.3	Mechanical strength test, variable <i>N</i> :	365	P
8.11.4	Mechanical strength test 250N, including end stops		P
8.12	Telescoping or rod antennas.....	No such device	N/A
	Button/Ball diameter (mm)..... :		—
9	THERMAL BURN INJURY		P
9.2	Thermal energy source classifications	All accessible surfaces are classified as TS1, see appended table 5.4.1.4, 6.3.2, 9.0, B.2.6	P
9.3	Safeguard against thermal energy sources		N/A
9.4	Requirements for safeguards		N/A
9.4.1	Equipment safeguard		N/A
9.4.2	Instructional safeguard :		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
10	RADIATION		P
10.2	Radiation energy source classification		P
10.2.1	General classification		P
10.3	Protection against laser radiation		N/A
	Laser radiation that exists in the equipment:		—
	Normal, abnormal, single-fault.....:		N/A
	Instructional safeguard		—
	Tool		—
10.4	Protection against visible, infrared, and UV radiation		P
10.4.1	General	LED indicator is considered as RS1	P
10.4.1.a)	RS3 for Ordinary and instructed persons		N/A
10.4.1.b)	RS3 accessible to a skilled person		N/A
	Personal safeguard (PPE) instructional safeguard.....:		—
10.4.1.c)	Equipment visible, IR, UV does not exceed RS1 :		N/A
10.4.1.d)	Normal, abnormal, single-fault conditions		N/A
10.4.1.e)	Enclosure material employed as safeguard is opaque.....:		N/A
10.4.1.f)	UV attenuation		N/A
10.4.1.g)	Materials resistant to degradation UV		N/A
10.4.1.h)	Enclosure containment of optical radiation.....:		N/A
10.4.1.i)	Exempt Group under normal operating conditions	Exempt Group	P
10.4.2	Instructional safeguard		N/A
10.5	Protection against x-radiation		N/A
10.5.1	X- radiation energy source that exists equipment :		N/A
	Normal, abnormal, single fault conditions		N/A
	Equipment safeguards		N/A
	Instructional safeguard for skilled person.....:		N/A
10.5.3	Most unfavourable supply voltage to give maximum radiation.....:		—
	Abnormal and single-fault condition		N/A
	Maximum radiation (pA/kg).....:		N/A
10.6	Protection against acoustic energy sources		N/A
10.6.1	General		N/A
10.6.2	Classification		N/A
	Acoustic output, dB(A).....:		N/A
	Output voltage, unweighted r.m.s.:		N/A
10.6.4	Protection of persons		N/A
	Instructional safeguards		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Equipment safeguard prevent ordinary person to RS2		—
	Means to actively inform user of increase sound pressure.....		—
	Equipment safeguard prevent ordinary person to RS2		—
10.6.5	Requirements for listening devices (headphones, earphones, etc.)		N/A
10.6.5.1	Corded passive listening devices with analogue input		N/A
	Input voltage with 94 dB(A) L_{Aeq} acoustic pressure output		—
10.6.5.2	Corded listening devices with digital input		N/A
	Maximum dB(A)		—
10.6.5.3	Cordless listening device		N/A
	Maximum dB(A)		—
B	NORMAL OPERATING CONDITION TESTS, ABNORMAL OPERATING CONDITION TESTS AND SINGLE FAULT CONDITION TESTS		P
B.2	Normal Operating Conditions		P
B.2.1	General requirements	(See Test Item Particulars and appended test tables)	P
	Audio Amplifiers and equipment with audio amplifiers	No such device	N/A
B.2.3	Supply voltage and tolerances		P
B.2.5	Input test.....	(See appended table B.2.5)	P
B.3	Simulated abnormal operating conditions		P
B.3.1	General requirements	(See appended table B.3)	P
B.3.2	Covering of ventilation openings		N/A
B.3.3	D.C. mains polarity test		N/A
B.3.4	Setting of voltage selector		N/A
B.3.5	Maximum load at output terminals.....	(See appended table B.3)	P
B.3.6	Reverse battery polarity	Skilled person replaceable	N/A
B.3.7	Abnormal operating conditions as specified in Clause E.2.		N/A
B.3.8	Safeguards functional during and after abnormal operating conditions		P
B.4	Simulated single fault conditions		P
B.4.2	Temperature controlling device open or short-circuited	No such device	N/A
B.4.3	Motor tests	No motors	N/A
B.4.3.1	Motor blocked or rotor locked increasing the internal ambient temperature		N/A
B.4.4	Short circuit of functional insulation		P
B.4.4.1	Short circuit of clearances for functional insulation		P

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
B.4.4.2	Short circuit of creepage distances for functional insulation		P
B.4.4.3	Short circuit of functional insulation on coated printed boards		N/A
B.4.5	Short circuit and interruption of electrodes in tubes and semiconductors		P
B.4.6	Short circuit or disconnect of passive components		P
B.4.7	Continuous operation of components		N/A
B.4.8	Class 1 and Class 2 energy sources within limits during and after single fault conditions		P
B.4.9	Battery charging under single fault conditions..... :	(See Annex M)	P
C	UV RADIATION		N/A
C.1	Protection of materials in equipment from UV radiation		N/A
C.1.2	Requirements		N/A
C.1.3	Test method		N/A
C.2	UV light conditioning test		N/A
C.2.1	Test apparatus		N/A
C.2.2	Mounting of test samples		N/A
C.2.3	Carbon-arc light-exposure apparatus		N/A
C.2.4	Xenon-arc light exposure apparatus		N/A
D	TEST GENERATORS		N/A
D.1	Impulse test generators		N/A
D.2	Antenna interface test generator		N/A
D.3	Electronic pulse generator		N/A
E	TEST CONDITIONS FOR EQUIPMENT CONTAINING AUDIO AMPLIFIERS		N/A
E.1	Audio amplifier normal operating conditions		N/A
	Audio signal voltage (V) :		—
	Rated load impedance (Ω) :		—
E.2	Audio amplifier abnormal operating conditions		N/A
F	EQUIPMENT MARKINGS, INSTRUCTIONS, AND INSTRUCTIONAL SAFEGUARDS		P
F.1	General requirements		P
	Instructions – Language :	English user manual provided. The other languages will be provided during the national approval.	—
F.2	Letter symbols and graphical symbols		P
F.2.1	Letter symbols according to IEC60027-1		P
F.2.2	Graphic symbols IEC, ISO or manufacturer specific		P
F.3	Equipment markings		P
F.3.1	Equipment marking locations	Equipment marking is easily visible from the exterior	P
F.3.2	Equipment identification markings		P

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
F.3.2.1	Manufacturer identification	See "copy of marking plate"	—
F.3.2.2	Model identification	See "copy of marking plate"	—
F.3.3	Equipment rating markings		P
F.3.3.1	Equipment with direct connection to mains		P
F.3.3.2	Equipment without direct connection to mains		N/A
F.3.3.3	Nature of supply voltage.....	See "copy of marking plate"	—
F.3.3.4	Rated voltage.....	See "copy of marking plate"	—
F.3.3.5	Rated frequency	See "copy of marking plate"	—
F.3.3.6	Rated current or rated power.....	See "copy of marking plate"	—
F.3.3.7	Equipment with multiple supply connections		N/A
F.3.4	Voltage setting device	No such device	N/A
F.3.5	Terminals and operating devices		P
F.3.5.1	Mains appliance outlet and socket-outlet markings	See "copy of marking plate"	P
F.3.5.2	Switch position identification marking		N/A
F.3.5.3	Replacement fuse identification and rating markings.....		N/A
F.3.5.4	Replacement battery identification marking	The battery is not replaced by an ordinary person	N/A
F.3.5.5	Terminal marking location		N/A
F.3.6	Equipment markings related to equipment classification		P
F.3.6.1	Class I Equipment		P
F.3.6.1.1	Protective earthing conductor terminal	Provided within the appliance	P
F.3.6.1.2	Neutral conductor terminal	Not a permanently connected equipment	N/A
F.3.6.1.3	Protective bonding conductor terminals		P
F.3.6.2	Class II equipment (IEC60417-5172)		N/A
F.3.6.2.1	Class II equipment with or without functional earth		N/A
F.3.6.2.2	Class II equipment with functional earth terminal marking		N/A
F.3.7	Equipment IP rating marking	IPX0	—
F.3.8	External power supply output marking		N/A
F.3.9	Durability, legibility and permanence of marking		P
F.3.10	Test for permanence of markings		P
F.4	Instructions		P
	a) Equipment for use in locations where children not likely to be present - marking		P
	b) Instructions given for installation or initial use		P
	c) Equipment intended to be fastened in place		P
	d) Equipment intended for use only in restricted access area		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
	e) Audio equipment terminals classified as ES3 and other equipment with terminals marked in accordance F.3.6.1		N/A
	f) Protective earthing employed as safeguard		P
	g) Protective earthing conductor current exceeding ES 2 limits		N/A
	h) Symbols used on equipment		P
	i) Permanently connected equipment not provided with all-pole mains switch		N/A
	j) Replaceable components or modules providing safeguard function		N/A
F.5	Instructional safeguards		P
	Where "instructional safeguard" is referenced in the test report it specifies the required elements, location of marking and/or instruction		P
G	COMPONENTS		P
G.1	Switches		N/A
G.1.1	General requirements	No such component	N/A
G.1.2	Ratings, endurance, spacing, maximum load		N/A
G.2	Relays		P
G.2.1	General requirements	IEC 61810-1 approved relays used. Details see table 4.1.2.	P
G.2.2	Overload test		P
G.2.3	Relay controlling connectors supply power		P
G.2.4	Mains relay, modified as stated in G.2		P
G.3	Protection Devices		P
G.3.1	Thermal cut-offs	No such component.	N/A
G.3.1.1a) &b)	Thermal cut-outs separately approved according to IEC 60730 with conditions indicated in a) & b)		N/A
G.3.1.1c)	Thermal cut-outs tested as part of the equipment as indicated in c)		N/A
G.3.1.2	Thermal cut-off connections maintained and secure		N/A
G.3.2	Thermal links		N/A
G.3.2.1a)	Thermal links separately tested with IEC 60691	No such component.	N/A
G.3.2.1b)	Thermal links tested as part of the equipment		N/A
	Aging hours (H).....:		—
	Single Fault Condition		—
	Test Voltage (V) and Insulation Resistance (Ω) .:		—
G.3.3	PTC Thermistors	No such component.	N/A
G.3.4	Overcurrent protection devices	Details see table 4.1.2.	P
G.3.5	Safeguards components not mentioned in G.3.1 to G.3.5		N/A
G.3.5.1	Non-resettable devices suitably rated and marking provided		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
G.3.5.2	Single faults conditions		N/A
G.4	Connectors		P
G.4.1	Spacings		P
G.4.2	Mains connector configuration	Approved connectors used. Details see table 4.1.2.	P
G.4.3	Plug is shaped that insertion into mains socket-outlets or appliance coupler is unlikely		P
G.5	Wound Components		N/A
G.5.1	Wire insulation in wound components	Evaluated in approved power supply unit	N/A
G.5.1.2 a)	Two wires in contact inside wound component, angle between 45° and 90°		N/A
G.5.1.2 b)	Construction subject to routine testing		N/A
G.5.2	Endurance test on wound components		N/A
G.5.2.1	General test requirements		N/A
G.5.2.2	Heat run test		N/A
	Time (s)		—
	Temperature (°C)		—
G.5.2.3	Wound Components supplied by mains		N/A
G.5.3	Transformers		N/A
G.5.3.1	Requirements applied (IEC61204-7, IEC61558-1/-2, and/or IEC62368-1)	Evaluated in approved power supply unit	N/A
	Position		—
	Method of protection		—
G.5.3.2	Insulation		N/A
	Protection from displacement of windings		—
G.5.3.3	Overload test		N/A
G.5.3.3.1	Test conditions		N/A
G.5.3.3.2	Winding Temperatures testing in the unit		N/A
G.5.3.3.3	Winding Temperatures - Alternative test method		N/A
G.5.4	Motors		N/A
G.5.4.1	General requirements	No motors used	N/A
	Position		—
G.5.4.2	Test conditions		N/A
G.5.4.3	Running overload test		N/A
G.5.4.4	Locked-rotor overload test		N/A
	Test duration (days)		—
G.5.4.5	Running overload test for d.c. motors in secondary circuits		N/A
G.5.4.5.2	Tested in the unit		N/A
	Electric strength test (V)		—

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
G.5.4.5.3	Tested on the Bench - Alternative test method; test time (h) :		N/A
	Electric strength test (V)..... :		—
G.5.4.6	Locked-rotor overload test for d.c. motors in secondary circuits		N/A
G.5.4.6.2	Tested in the unit		N/A
	Maximum Temperature :		N/A
	Electric strength test (V) :		N/A
G.5.4.6.3	Tested on the bench - Alternative test method; test time (h)..... :		N/A
	Electric strength test (V)..... :		N/A
G.5.4.7	Motors with capacitors		N/A
G.5.4.8	Three-phase motors		N/A
G.5.4.9	Series motors		N/A
	Operating voltage :		—
G.6	Wire Insulation		N/A
G.6.1	General		N/A
G.6.2	Solvent-based enamel wiring insulation		N/A
G.7	Mains supply cords		P
G.7.1	General requirements	Approved power supply cord used	P
	Type :	Refer to table 4.1.2	—
	Rated current (A) :	Refer to table 4.1.2	—
	Cross-sectional area (mm ²), (AWG) :	Refer to table 4.1.2	—
G.7.2	Compliance and test method		P
G.7.3	Cord anchorages and strain relief for non- detachable power supply cords		P
G.7.3.2	Cord strain relief		P
G.7.3.2.1	Requirements		P
	Strain relief test force (N) :	60 or 100 depend on exact model	—
G.7.3.2.2	Strain relief mechanism failure		P
G.7.3.2.3	Cord sheath or jacket position, distance (mm) ... :	0.5	—
G.7.3.2.4	Strain relief comprised of polymeric material		P
G.7.4	Cord Entry :	Refer to table 5.4.9.	P
G.7.5	Non-detachable cord bend protection	Not such equipment.	N/A
G.7.5.1	Requirements		N/A
G.7.5.2	Mass (g) :		—
	Diameter (m)..... :		—
	Temperature (°C)..... :		—
G.7.6	Supply wiring space		P
G.7.6.2	Stranded wire		P
G.7.6.2.1	Test with 8 mm strand		P

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
G.8	Varistors		P
G.8.1	General requirements		P
G.8.2	Safeguard against shock	IEC 61051-2 complied	P
G.8.3	Safeguard against fire		N/A
G.8.3.2	Varistor overload test		N/A
G.8.3.3	Temporary overvoltage		N/A
G.9	Integrated Circuit (IC) Current Limiters		N/A
G.9.1 a)	Manufacturer defines limit at max. 5A.		N/A
G.9.1 b)	Limiters do not have manual operator or reset		N/A
G.9.1 c)	Supply source does not exceed 250 VA		—
G.9.1 d)	IC limiter output current (max. 5A).....		—
G.9.1 e)	Manufacturers' defined drift		—
G.9.2	Test Program 1		N/A
G.9.3	Test Program 2		N/A
G.9.4	Test Program 3		N/A
G.10	Resistors		N/A
G.10.1	General requirements	No such components.	N/A
G.10.2	Resistor test		N/A
G.10.3	Test for resistors serving as safeguards between the mains and an external circuit consisting of a coaxial cable		N/A
G.10.3.1	General requirements		N/A
G.10.3.2	Voltage surge test		N/A
G.10.3.3	Impulse test		N/A
G.11	Capacitor and RC units		P
G.11.1	General requirements	Evaluated in approved power supply unit	P
G.11.2	Conditioning of capacitors and RC units		P
G.11.3	Rules for selecting capacitors		P
G.12	Optocouplers		P
	Optocouplers comply with IEC 60747-5-5:2007 Spacing or Electric Strength Test (specify option and test results)	Approved optocouplers used. Refer to table 4.1.2.	P
	Type test voltage Vini		—
	Routine test voltage, Vini,b		—
G.13	Printed boards		P
G.13.1	General requirements	UL approved PCB used	P
G.13.2	Uncoated printed boards		P
G.13.3	Coated printed boards		N/A
G.13.4	Insulation between conductors on the same inner surface		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Compliance with cemented joint requirements (Specify construction)..... :		—
G.13.5	Insulation between conductors on different surfaces		N/A
	Distance through insulation :		N/A
	Number of insulation layers (pcs) :		—
G.13.6	Tests on coated printed boards		N/A
G.13.6.1	Sample preparation and preliminary inspection		N/A
G.13.6.2a)	Thermal conditioning		N/A
G.13.6.2b)	Electric strength test		N/A
G.13.6.2c)	Abrasion resistance test		N/A
G.14	Coating on components terminals		N/A
G.14.1	Requirements :	No such component	N/A
G.15	Liquid filled components		N/A
G.15.1	General requirements	No such component	N/A
G.15.2	Requirements		N/A
G.15.3	Compliance and test methods		N/A
G.15.3.1	Hydrostatic pressure test		N/A
G.15.3.2	Creep resistance test		N/A
G.15.3.3	Tubing and fittings compatibility test		N/A
G.15.3.4	Vibration test		N/A
G.15.3.5	Thermal cycling test		N/A
G.15.3.6	Force test		N/A
G.15.4	Compliance		N/A
G.16	IC including capacitor discharge function (ICX)		N/A
a)	Humidity treatment in accordance with sc 5.4.8 – 120 hours	No such component	N/A
b)	Impulse test using circuit 2 with $U_c =$ to transient voltage :		N/A
C1)	Application of ac voltage at 110% of rated voltage for 2.5 minutes		N/A
C2)	Test voltage :		—
D1)	10,000 cycles on and off using capacitor with smallest capacitance resistor with largest resistance specified by manufacturer		N/A
D2)	Capacitance :		—
D3)	Resistance :		—
H	CRITERIA FOR TELEPHONE RINGING SIGNALS		N/A
H.1	General		N/A
H.2	Method A		N/A
H.3	Method B		N/A
H.3.1	Ringling signal		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
H.3.1.1	Frequency (Hz)		—
H.3.1.2	Voltage (V)		—
H.3.1.3	Cadence; time (s) and voltage (V)		—
H.3.1.4	Single fault current (mA):.....		—
H.3.2	Tripping device and monitoring voltage		N/A
H.3.2.1	Conditions for use of a tripping device or a monitoring voltage complied with		N/A
H.3.2.2	Tripping device		N/A
H.3.2.3	Monitoring voltage (V)		—
J	INSULATED WINDING WIRES FOR USE WITHOUT INTERLEAVED INSULATION		N/A
	General requirements		N/A
K	SAFETY INTERLOCKS		N/A
K.1	General requirements	No safety interlocks.	N/A
K.2	Components of safety interlock safeguard mechanism		N/A
K.3	Inadvertent change of operating mode		N/A
K.4	Interlock safeguard override		N/A
K.5	Fail-safe		N/A
	Compliance		N/A
K.6	Mechanically operated safety interlocks		N/A
K.6.1	Endurance requirement		N/A
K.6.2	Compliance and Test method		N/A
K.7	Interlock circuit isolation		N/A
K.7.1	Separation distance for contact gaps & interlock circuit elements (type and circuit location)		N/A
K.7.2	Overload test, Current (A)		N/A
K.7.3	Endurance test		N/A
K.7.4	Electric strength test		N/A
L	DISCONNECT DEVICES		P
L.1	General requirements	The industrial power plug is considered as disconnect device.	P
L.2	Permanently connected equipment		N/A
L.3	Parts that remain energized	When the equipment is disconnected from mains, no remaining parts at hazardous voltage in the equipment.	N/A
L.4	Single phase equipment	The disconnect device disconnects both poles simultaneously.	P
L.5	Three-phase equipment	The disconnect device disconnects all phase conductors simultaneously.	P
L.6	Switches as disconnect devices		N/A
L.7	Plugs as disconnect devices		P
L.8	Multiple power sources		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
M	EQUIPMENT CONTAINING BATTERIES AND THEIR PROTECTION CIRCUITS		P
M.1	General requirements		P
M.2	Safety of batteries and their cells		P
M.2.1	Requirements		P
M.2.2	Compliance and test method (identify method)....:	Approved lithium coin/button cell used	P
M.3	Protection circuits		P
M.3.1	Requirements		P
M.3.2	Tests		P
	- Overcharging of a rechargeable battery		N/A
	- Unintentional charging of a non-rechargeable battery		P
	- Reverse charging of a rechargeable battery		N/A
	- Excessive discharging rate for any battery		P
M.3.3	Compliance :	(See appended Tables and Annex M.3 and M.4)	P
M.4	Additional safeguards for equipment containing secondary lithium battery		N/A
M.4.1	General	Primary battery used	N/A
M.4.2	Charging safeguards		N/A
M.4.2.1	Charging operating limits		N/A
M.4.2.2a)	Charging voltage, current and temperature :		—
M.4.2.2 b)	Single faults in charging circuitry :		—
M.4.3	Fire Enclosure		N/A
M.4.4	Endurance of equipment containing a secondary lithium battery		N/A
M.4.4.2	Preparation		N/A
M.4.4.3	Drop and charge/discharge function tests		N/A
	Drop		N/A
	Charge		N/A
	Discharge		N/A
M.4.4.4	Charge-discharge cycle test		N/A
M.4.4.5	Result of charge-discharge cycle test		N/A
M.5	Risk of burn due to short circuit during carrying		N/A
M.5.1	Requirement		N/A
M.5.2	Compliance and Test Method (Test of P.2.3)		N/A
M.6	Prevention of short circuits and protection from other effects of electric current		N/A
M.6.1	Short circuits		N/A
M.6.1.1	General requirements		N/A
M.6.1.2	Test method to simulate an internal fault		N/A
M.6.1.3	Compliance (Specify M.6.1.2 or alternative method) :		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
M.6.2	Leakage current (mA)		N/A
M.7	Risk of explosion from lead acid and NiCd batteries	No such battery.	N/A
M.7.1	Ventilation preventing explosive gas concentration		N/A
M.7.2	Compliance and test method		N/A
M.8	Protection against internal ignition from external spark sources of lead acid batteries		N/A
M.8.1	General requirements		N/A
M.8.2	Test method		N/A
M.8.2.1	General requirements		N/A
M.8.2.2	Estimation of hypothetical volume V_z (m ³ /s)		—
M.8.2.3	Correction factors		—
M.8.2.4	Calculation of distance d (mm)		—
M.9	Preventing electrolyte spillage		N/A
M.9.1	Protection from electrolyte spillage		N/A
M.9.2	Tray for preventing electrolyte spillage		N/A
M.10	Instructions to prevent reasonably foreseeable misuse (Determination of compliance: inspection, data review; or abnormal testing)		N/A
N	ELECTROCHEMICAL POTENTIALS		P
	Metal(s) used.....	Compliance	—
O	MEASUREMENT OF CREEPAGE DISTANCES AND CLEARANCES		P
	Figures O.1 to O.20 of this Annex applied		—
P	SAFEGUARDS AGAINST ENTRY OF FOREIGN OBJECTS AND SPILLAGE OF INTERNAL LIQUIDS		P
P.1	General requirements	No such openings after assembled.	P
P.2.2	Safeguards against entry of foreign object		N/A
	Location and Dimensions (mm)		—
P.2.3	Safeguard against the consequences of entry of foreign object		N/A
P.2.3.1	Safeguards against the entry of a foreign object		N/A
	Openings in transportable equipment		N/A
	Transportable equipment with metalized plastic parts		N/A
P.2.3.2	Openings in transportable equipment in relation to metallized parts of a barrier or enclosure (identification of supplementary safeguard)		N/A
P.3	Safeguards against spillage of internal liquids		N/A
P.3.1	General requirements		N/A
P.3.2	Determination of spillage consequences		N/A
P.3.3	Spillage safeguards		N/A
P.3.4	Safeguards effectiveness		N/A

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
P.4	Metallized coatings and adhesive securing parts		N/A
P.4.2 a)	Conditioning testing		N/A
	Tc (°C).....:		—
	Tr (°C)		—
	Ta (°C).....:		—
P.4.2 b)	Abrasion testing		N/A
P.4.2 c)	Mechanical strength testing..... :		N/A
Q	CIRCUITS INTENDED FOR INTERCONNECTION WITH BUILDING WIRING		P
Q.1	Limited power sources		P
Q.1.1 a)	Inherently limited output		N/A
Q.1.1 b)	Impedance limited output		P
	- Regulating network limited output under normal operating and simulated single fault condition		P
Q.1.1 c)	Overcurrent protective device limited output		N/A
Q.1.1 d)	IC current limiter complying with G.9		N/A
Q.1.2	Compliance and test method	(See appended table Annex Q.1)	P
Q.2	Test for external circuits – paired conductor cable		N/A
	Maximum output current (A)		—
	Current limiting method..... :		—
R	LIMITED SHORT CIRCUIT TEST		N/A
R.1	General requirements		N/A
R.2	Determination of the overcurrent protective device and circuit		N/A
R.3	Test method Supply voltage (V) and short-circuit current (A)).		N/A
S	TESTS FOR RESISTANCE TO HEAT AND FIRE		N/A
S.1	Flammability test for fire enclosures and fire barrier materials of equipment where the steady state power does not exceed 4 000 W		N/A
	Samples, material..... :		—
	Wall thickness (mm)..... :		—
	Conditioning (°C)		—
	Test flame according to IEC 60695-11-5 with conditions as set out		N/A
	- Material not consumed completely		N/A
	- Material extinguishes within 30s		N/A
	- No burning of layer or wrapping tissue		N/A
S.2	Flammability test for fire enclosure and fire barrier integrity		N/A
	Samples, material..... :		—
	Wall thickness (mm)..... :		—
	Conditioning (°C)		—

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
	Test flame according to IEC 60695-11-5 with conditions as set out		N/A
	Test specimen does not show any additional hole		N/A
S.3	Flammability test for the bottom of a fire enclosure		N/A
	Samples, material		—
	Wall thickness (mm).....		—
	Cheesecloth did not ignite		N/A
S.4	Flammability classification of materials		N/A
S.5	Flammability test for fire enclosure materials of equipment with a steady-state power exceeding 4000 W		N/A
	Samples, material		—
	Wall thickness (mm).....		—
	Conditioning (test condition), (°C).....		—
	Test flame according to IEC 60695-11-20 with conditions as set out		N/A
	After every test specimen was not consumed completely		N/A
	After fifth flame application, flame extinguished within 1 min		N/A
T	MECHANICAL STRENGTH TESTS		P
T.1	General requirements		P
T.2	Steady force test, 10 N	Evaluated in approved power supply unit	P
T.3	Steady force test, 30 N		N/A
T.4	Steady force test, 100 N		N/A
T.5	Steady force test, 250 N	(See appended table T.5)	P
T.6	Enclosure impact test	(See appended table T.6)	P
	Fall test		P
	Swing test		P
T.7	Drop test		N/A
T.8	Stress relief test.....	(See appended table T.8)	P
T.9	Impact Test (glass)		N/A
T.9.1	General requirements		N/A
T.9.2	Impact test and compliance		N/A
	Impact energy (J)		—
	Height (m).....		—
T.10	Glass fragmentation test.....		N/A
T.11	Test for telescoping or rod antennas		N/A
	Torque value (Nm)	No such device	—

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
U	MECHANICAL STRENGTH OF CATHODE RAY TUBES (CRT) AND PROTECTION AGAINST THE EFFECTS OF IMPLOSION		N/A
U.1	General requirements		N/A
U.2	Compliance and test method for non-intrinsically protected CRTs		N/A
U.3	Protective Screen :		N/A
V	DETERMINATION OF ACCESSIBLE PARTS (FINGERS, PROBES AND WEDGES)		P
V.1	Accessible parts of equipment		P
V.2	Accessible part criterion		P

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
Enclosure/frame - Chassis	Shenzhen Hongmingsheng Science and Technology Ltd.	--	Aluminum Alloy, thickness Min. 1.5mm	IEC/EN 62368-1	Tested with equipment	
Enclosure/frame- Cover	TORAY INDUSTRIES INC	CM3004-V0(rr)	V-0, 105°C	UL 746, UL94 IEC/EN 62368-1	UL E41797 and tested with equipment	
Industry plug 16A 3P (single phase)	QIXING	QX248	16A-6h/ 250V~, 2P+PE IP44	IEC 60309-1 IEC 60309-1/A1 IEC 60309-2 IEC 60309-2/A1	CB cert. No. CN20947	
Industry plug 32A 3P (single phase)	QIXING	QX260	32A-6h/ 250V~, 2P+PE IP44	IEC 60309-1 IEC 60309-1/A1 IEC 60309-2 IEC 60309-2/A1	CB cert. No. CN20944	
Industry plug 16A 5P (three phases)	QIXING	QX3	16A-6h/ 415V~, 3P+N+PE IP44	IEC 60309-1 IEC 60309-1/A1 IEC 60309-2 IEC 60309-2/A1	CB cert. No. CN20947	
Industry plug 32A 5P (three phases)	QIXING	QX4	32A-6h/ 415V~, 3P+N+PE IP44	IEC 60309-1 IEC 60309-1/A1 IEC 60309-2 IEC 60309-2/A1	CB cert. No. CN20944	
Cable (single phase) 1	Shenzhen Tongyuan Industrial Co., Ltd.	H05VV-F	16A/250V, 3G*1.5mm ²	DIN EN 50525-2- 11	VDE 101980	
Cable (single phase) 2	Guangdong Rifeng Electrical Cable Co., Ltd.	H07RN-F	32A/250V, 3G*4.0mm ²	DIN EN 50525-2- 11	VDE 40015999	
Cable (three phases) 1	Guangdong Rifeng Electrical Cable Co., Ltd.	H07RN-F	16A/380V, 5G*2.5mm ²	DIN EN 50525-2- 11	VDE 40015999	
Cable (three phases) 2	Guangdong Rifeng Electrical Cable Co., Ltd.	H07RN-F	32A/380V, 5G*4.0mm ²	DIN EN 50525-2- 11	VDE 40015999	
Internal primary wire and GND wire	TRIUMPH CABLE CO.,LTD	H05V-K	16A/250V, 32A/250V, 1*1.5mm ² 1*2.5mm ² 1*4.0mm ²	DIN EN 50525-2- 31	VDE 40053466	
Wire connector	WAGO GmbH & Co. KG	221-412, 221- 413, 221-415, 221-613, 221-615	32A, 450V, AWG24-12	UL 486A-486B IEC/EN 62368-1	UL E69654 and tested with equipment	
Circuit breaker	Carling Technologies, Inc	L31-X1-00-882- H12-D3	16A 120/240V~, 1-pole	EN 60934+A1+A2 EN IEC 60934	TUV R 72112518	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
Appliance outlet	POWERTEK LIMITED	IEX00ab	250V~, Max. 16A/ 20A	IEC/EN 61984 UL 498	TUV RH test report No. CN20L530 001 & CN206RFA 001	
PCB	NEW-HEART TECHNOLOGY CO LTD	3M2	130°C, V-0, Min.thickness 1.5mm	UL 796 IEC/EN 62368-1	UL E206991 and tested with equipment	
Alt.	Interchangeable	--	130°C, V-0, Min.thickness 1.5mm	UL 796	--	
SPS Simple SNMP board for NPIM series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	0101JM301-000- G A1	--	IEC/EN 62368-1	Tested with equipment	
SNMP module of SPIM, SPOM, SPOS, SPOX series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	SPSA201- ADC02-EF	--	IEC/EN 62368-1	Tested with equipment	
Coin battery on SPS Simple SNMP board for NPIM series and SNMP module of SPIM, SPOM, SPOS, SPOX series	Panasonic	CR1220	3V	UL 1642 IEC/EN 62368-1	UL MH12210 and tested with equipment	
SNMP_Bridge_board of SPIM, SPOM, SPOS, SPOX series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	0101J8501-000-G A1	--	IEC/EN 62368-1	Tested with equipment	
- Optocoupler (ISO1, ISO2)	Lite-On Technology Corporation	LTV-814S-TA1	Min. external Cr. & Cl 8.0mm, Max. V _{IDTM} =8000Vp, 115°C	EN IEC 60747-5- 5	VDE 40015248	
- isolating IC (U2)	Texas Instruments Incorporated	TI - ISO1042	5000Vrms reinforced isolation at working voltage 850Vrms	EN IEC 60747-17	VDE 40040142	
Inlet_board_L1 of SPIM, SPOM, SPOS, SPOX series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	SPSD302- ACC04-EF	--	IEC/EN 62368-1	Tested with equipment	
- Primary connector (J1)	Anytek Technology Corporation Ltd.	HB0421800000G	250V, 9A	EN 60998-2-2 EN 60998-1	VDE 40019491	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
- Fuse(F3, F5)	Littelfuse Inc.	39212000000	T2A, 250V, Standard sheet: 4	IEC/EN 60127- 1+A1+A2 IEC/EN 60127-3 UL 248-1; UL 248-14; CSA-C22.2 No. 248-1-00; CSA-C22.2 No. 248.14	VDE 126983 UL E67006	
- Switching power supply(M1)	MEAN WELL ENTERPRISES CO LTD	IRM-15-12	Input: 1) 100-240V~, 0.35A, 50/60Hz 2) 277V~, 0.17A, 50/60Hz Output: 12Vdc, 1.25A	IEC 62368-1 UL 60950-1	UL CB cert. No. DK-88214-UL UL E183223	
- Transformer (T3)	Speed	SDE1908H	Class 105 (A)	IEC/EN 62368-1	Tested with equipment	
-- winding	TA YA ELECTRIC WIRE & CABLE CO LTD	TYA1- U155(UEW/QA-F)	155°C	UL 1446 IEC/EN 62368-1	UL E84201 and tested with equipment	
Alt.	PACIFIC ELECTRIC WIRE & CABLE (SHENZHEN) CO LTD	UEF1/U@	155°C	UL 1446 IEC/EN 62368-1	UL E201757 and tested with equipment	
-- bobbin	SUMITOMO BAKELITE CO LTD	PM-9630	V-0, 150°C	UL 746, UL 94 IEC 60695-11-10 CSA-C22.2 No. 0.17 IEC/EN 62368-1	UL E41429 and tested with equipment	
-- insulation tape	3M COMPANY	1350F-1 (b)	130°C	UL 510A IEC/EN 62368-1	UL E17385 and tested with equipment	
- Optocoupler (ISO2)	Lite-On Technology Corporation	LTV-814S-TA1	Min. external Cr. & Cl 8.0mm, Max. V _{IDTM} =8000Vp, 115°C	EN IEC 60747-5- 5	VDE 40015248	
Inlet_board_L1- L2&L3 of SPIM, SPOM, SPOS, SPOX series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	SPSD302- ACC03-EF	--	IEC/EN 62368-1	Tested with equipment	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
- VDR (R1, R2, R3)	Littelfuse Inc.	P14V460	SPD type 5, Max. continuous voltage 460V, 3kA, 105°C	UL 1449 CSA C22.2 No. 269.5-17 EN IEC 61051-1 IEC 62368- 1:2018/G.8.1 IEC 61051- 2/AMD1 CECC 42201-006	UL E320116 VDE 116895	
- VDR (R4, R5, R6, R7)	Thinking Electronic Industrial Co., Ltd.	TVR14391	SPD type 5, Max. continuous voltage 390V, 3kA, 105°C, V-0	IEC 61051- 2:1991 IEC 61051- 2:1991/AMD1:20 09 IEC 61051-2- 2:1991 IEC 61051- 1:2007 UL 1449 CSA C22.2 No. 269.5-17	VDE 40031391 UL E314979	
Outlet_PMU_Board_ SKU*2 of SPOM, SPOS, SPOX series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	SPSD302- ANC05-EF	--	IEC/EN 62368-1	Tested with equipment	
- Relay (RL1, RL2)	Xiamen Hongfa Electroacoustic Co., Ltd.	HF163F-L16	16A, 277V, 85°C, Coil voltage 12Vdc	IEC/EN 61810- 1+A1 UL 508	VDE 40051265 UL E133481	
- Optocoupler (ISO4)	Lite-On Technology Corporation	LTV-814S-TA1	Min. external Cr. & Cl 8.0mm, Max. V _{IDTM} =8000Vp, 115°C	EN IEC 60747-5- 5	VDE 40015248	
Outlet_PMU_Board_ C13~C19*6 of SPOM, SPOS, SPOX series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	SPSD302- ANC02-EF	--	IEC/EN 62368-1	Tested with equipment	
- Relay (RL1, RL2, RL3, RL4, RL5, RL6)	Xiamen Hongfa Electroacoustic Co., Ltd.	HF163F-L16	16A, 277V, 85°C, Coil voltage 12Vdc	IEC/EN 61810- 1+A1 UL 508	VDE 40051265 UL E133481	
- Optocoupler (ISO1, ISO2, ISO3, ISO4, ISO5, ISO6)	Lite-On Technology Corporation	LTV-814S-TA1	Min. external Cr. & Cl 8.0mm, Max. V _{IDTM} =8000Vp, 115°C	EN IEC 60747-5- 5	VDE 40015248	
Power meter board for BPIM series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	0101FA801-000- G A1	--	IEC/EN 62368-1	Tested with equipment	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
- Primary connector (J1)	Anytek Technology Corporation Ltd.	HB0421800000G	250V, 9A	EN 60998-2-2 EN 60998-1	VDE 40019491	
- Fuse(F1)	Littelfuse Inc.	39212000000	T2A, 250V, Standard sheet: 4	IEC/EN 60127- 1+A1+A2 IEC/EN 60127-3 UL 248-1; UL 248-14; CSA-C22.2 No. 248-1-00; CSA-C22.2 No. 248.14	VDE 126983 UL E67006	
- VDR (R3)	Thinking Electronic Industrial Co., Ltd.	TVR14391	SPD type 5, Max. continuous voltage 390V, 3kA, 105°C, V-0	IEC 61051- 2:1991 IEC 61051- 2:1991/AMD1:20 09 IEC 61051-2- 2:1991 IEC 61051- 1:2007 UL 1449 CSA C22.2 No. 269.5-17	VDE 40031391 UL E314979	
Simple Inlet_Three Phase Board of NPIM series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	0101JM401-000- G A1	--	IEC/EN 62368-1	Tested with equipment	
- Primary connector (J1)	Anytek Technology Corporation Ltd.	HB0421800000G	250V, 9A	EN 60998-2-2 EN 60998-1	VDE 40019491	
- Switching power supply(M1)	MEAN WELL ENTERPRISES CO LTD	IRM-10-12	Input: 1) 100-240V~, 0.25A, 50/60Hz 2) 277V~, 0.125A, 50/60Hz Output: 12Vdc, 0.85A	IEC 62368-1 UL 60950-1	UL CB cert. No. DK-88214-UL UL E183223	

IEC 62368-1					
Clause	Requirement + Test			Result - Remark	Verdict
4.1.2	TABLE: List of critical components				P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}
- VDR (R1, R62, R100, R113, R114, R102, R82)	Thinking Electronic Industrial Co., Ltd.	TVR14391	SPD type 5, Max. continuous voltage 390V, 3kA, 105°C, V-0	IEC 61051-2:1991 IEC 61051-2:1991/AMD1:2009 IEC 61051-2:1991 IEC 61051-1:2007 UL 1449 CSA C22.2 No. 269.5-17	VDE 40031391 UL E314979
- VDR (R80, R111, R112)	Littelfuse Inc.	P14V460	SPD type 5, Max. continuous voltage 460V, 3kA, 105°C	UL 1449 CSA C22.2 No. 269.5-17 EN IEC 61051-1 IEC 62368-1:2018/G.8.1 IEC 61051-2/AMD1 CECC 42201-006	UL E320116 VDE 116895
- Non-optical isolators (ISO1)	Analog Devices Inc.	ADuM1200 A RZ	Isolation voltage 2500Vac	DIN VDE V 0884-11:2017-01 UL 1577 CSA Component Acceptance Service Notice No. 5A	VDE 40011599 UL E214100
- Non-optical isolator (ISO2, ISO3)	Analog Devices Inc.	ADuM 1412 ARWZ	Isolation voltage 2500Vac	DIN VDE V 0884-11:2017-01 UL 1577 CSA Component Acceptance Service Notice No. 5A	VDE 40011599 UL E214100
Simple Inlet_Single Phase Board of NPIM series	Ningbo Haishu Chaobai Dianzi Co.,Ltd .	0101JM201-000-G A1	--	IEC/EN 62368-1	Tested with equipment
- Primary connector (J1)	Anytek Technology Corporation Ltd.	HB0421800000G	250V, 9A	EN 60998-2-2 EN 60998-1	VDE 40019491

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
- Fuse(F1)	Littelfuse Inc.	39212000000	T2A, 250V, Standard sheet: 4	IEC/EN 60127- 1+A1+A2 IEC/EN 60127-3 UL 248-1; UL 248-14; CSA-C22.2 No. 248-1-00; CSA-C22.2 No. 248.14	VDE 126983 UL E67006	
- Switching power supply(M1)	MEAN WELL ENTERPRISES CO LTD	IRM-10-12	Input: 1) 100-240V~, 0.25A, 50/60Hz 2) 277V~, 0.125A, 50/60Hz Output: 12Vdc, 0.85A	IEC 62368-1 UL 60950-1	UL CB cert. No. DK-88214-UL UL E183223	
- VDR (R36, R65, R66)	Thinking Electronic Industrial Co., Ltd.	TVR14391	SPD type 5, Max. continuous voltage 390V, 3kA, 105°C, V-0	IEC 61051- 2:1991 IEC 61051- 2:1991/AMD1:20 09 IEC 61051-2- 2:1991 IEC 61051- 1:2007 UL 1449 CSA C22.2 No. 269.5-17	VDE 40031391 UL E314979	
- Non-optical isolators (ISO1)	Analog Devices Inc.	ADuM 1412 ARWZ	Isolation voltage 2500Vac	DIN VDE V 0884- 11:2017-01 UL 1577 CSA Component Acceptance Service Notice No. 5A	VDE 40011599 UL E214100	
- Non-optical isolators (ISO2)	Analog Devices Inc.	ADuM1200 A RZ	Isolation voltage 2500Vac	DIN VDE V 0884- 11:2017-01 UL 1577 CSA Component Acceptance Service Notice No. 5A	VDE 40011599 UL E214100	
All Y capacitor between primary circuits and earthed metal chassis	PROSPERITY DIELECTRICS CO LTD	FK12X#, FK21X#	Y2, 250Vac, 150- 4700pF for FK12X#, 100- 2700pF for FK21X#, 125°C	EN 60384-14 UL 60384-14 CAN/CSA- E60384-1 CAN/CSA- E60384-14	TUV R 50041666 TUV R 50359148 UL E346791	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.1.2	TABLE: List of critical components					P
Object / part No.	Manufacturer/ trademark	Type / model	Technical data	Standard	Mark(s) of conformity ^{1), 2)}	
Sleeving/tubing	Interchangeable	--	FEP, PTFE, PVC, TFE, neoprene, polyimide or marked 600V, VW-1; min. 125°C.	UL 1441, UL 224	--	
Insulation Sheet (Between metal enclosure and primary components)	Chengdu Kanglongxin Plastics Co., Ltd.	KLX PP BK-10	Min. 0.4 mm, V-0, 110°C	UL 94	UL E315185	
Alt.	Interchangeable	--	Min. 0.4 mm, V-0	UL 94	--	
Supplementary information:						
¹⁾ Provided evidence ensures the agreed level of compliance. See OD-CB2039.						
²⁾ License available upon request						

4.8.4, 4.8.5	TABLE: Lithium coin/button cell batteries mechanical tests			N/A
(The following mechanical tests are conducted in the sequence noted.)				
4.8.4.2	TABLE: Stress Relief test			—
Part		Material	Oven Temperature (°C)	Comments
4.8.4.3	TABLE: Battery replacement test			—
Battery part no.:				—
Battery Installation/withdrawal			Battery Installation/Removal Cycle	Comments
			1	
			2	
			3	
			4	
			5	
			6	
			8	
			9	
4.8.4.4	TABLE: Drop test			—
Impact Area		Drop Distance	Drop No.	Observations
			1	
			2	
			3	
4.8.4.5	TABLE: Impact			—
Impacts per surface		Surface tested	Impact energy (Nm)	Comments

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
4.8.4, 4.8.5	TABLE: Lithium coin/button cell batteries mechanical tests		N/A
(The following mechanical tests are conducted in the sequence noted.)			
4.8.4.6	TABLE: Crush test		—
Test position	Surface tested	Crushing Force (N)	Duration force applied (s)
Supplementary information:			

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

4.8.5	TABLE: Lithium coin/button cell batteries mechanical test result			N/A
Test position	Surface tested	Force (N)	Duration force applied (s)	
Supplementary information:				

5.2	Table: Classification of electrical energy sources						P
5.2.2.2 – Steady State Voltage and Current conditions							
No.	Supply Voltage	Location (e.g. circuit designation)	Test conditions	Parameters			ES Class
				U (Vrms or Vpk)	I (A _{pk} or A _{rms})	Hz	
1	457 Vac	Primary circuit	Normal	457 Vrms	--	60	ES3
			Abnormal	457 Vrms	--	60	
			Single fault – See appended table B.4	457 Vrms	--	60	
2	457 Vac	USB port	Normal	5.05	--	DC	ES1
			Abnormal	5.05	--	DC	
			Single fault – See appended table B.4	5.05	--	DC	

5.2.2.3 - Capacitance Limits						
No.	Supply Voltage	Location (e.g. circuit designation)	Test conditions	Parameters		ES Class
				Capacitance, nF	Upk (V)	
--	--	--	Normal	--	--	--
			Abnormal	--	--	
			Single fault – SC/OC	--	--	

5.2.2.4 - Single Pulses							
No.	Supply Voltage	Location (e.g. circuit designation)	Test conditions	Parameters			ES Class
				Duration (ms)	Upk (V)	Ipk (mA)	
--	--	--	Normal	--	--	--	--
			Abnormal	--	--	--	
			Single fault – SC/OC	--	--	--	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

5.2.2.5 - Repetitive Pulses

No.	Supply Voltage	Location (e.g. circuit designation)	Test conditions	Parameters			ES Class
				Off time (ms)	Upk (V)	l _{pk} (mA)	
--	--	--	Normal	--	--	--	--
			Abnormal	--	--	--	
			Single fault – SC/OC	--	--	--	

Test Conditions:

Normal –

Abnormal -

Supplementary information: SC=Short Circuit, OC=Open Circuit

5.4.1.4, 6.3.2, 9.0, B.2.6	TABLE: Temperature measurements					P
	Supply voltage (V)	See below.		See below.		—
	Ambient T _{min} (°C)	--	--	--	--	—
	Ambient T _{max} (°C)	--	--	--	--	—
	T _{ma} (°C)	45				—
Maximum measured temperature T of part/at:		T (°C)				Allowed T _{max} (°C)
Tested with model XBSPOX60-4232A3P-Vxx		342V		456.5V		--
Power plug		50.3	75.1	53.0	77.8	85
Power cord		54.5	79.3	57.2	82.0	85
M1 body on Inlet_board_L1		80.7	105.5	83.4	108.2	Ref.
T3 winding on Inlet_board_L1		68.8	93.6	71.5	96.3	100
C87 body on Inlet_board_L1		63.7	88.5	66.4	91.2	105
PCB near U9 on Inlet_board_L1		61.9	86.7	64.6	89.4	130
PCB between R316 & F5 on Inlet_board_L1		60.0	84.8	62.7	87.5	130
J1 connector on Inlet_board_L1		60.1	84.9	62.8	87.6	Ref.
R3 body on Inlet_board_L2&L3		59.8	84.6	62.5	87.3	105
Internal primary wire		69.2	94.0	71.9	96.7	105
PCB between U2 & ISO2 on SNMP_Bridge_Board		67.4	92.2	70.1	94.9	130
PCB near U3 on Outlet_PMU_Board_SKU*2		61.3	86.1	64.0	88.8	130
PCB near ISO4 on Outlet_PMU_Board_SKU*2		66.0	90.8	68.7	93.5	130
Crystal connector body		57.0	81.8	59.7	84.5	Ref.

IEC 62368-1					
Clause	Requirement + Test		Result - Remark		Verdict
PCB near U1 on Outlet_PMU_Board_C13~C19*6	66.1	90.9	68.8	93.6	130
Appliance outlet internal	62.3	87.1	65.0	89.8	Ref.
Ambient	25.2	→50	25.2	→50	--
Following for accessible touch temperature:					
Left end plastic enclosure	37.1	36.9	39.6	39.4	77
Top enclosure near left end	44.4	44.2	46.9	46.7	60
Top enclosure near circuit breaker 4L2	41.1	40.9	43.6	43.4	60
Enclosure near 2 ports outlet	43.5	43.3	46.0	45.8	77
Enclosure near 6 ports outlet	39.9	39.7	42.4	42.2	77
Button near display	45.2	45.0	47.7	47.5	77
Enclosure near USB port	62.4	62.2	64.9	64.7	77
Ambient	25.2	→25	25.2	→25	--
Tested with model XBSPOX60-4232A1P-Vxx	171V		264V		--
Power plug	38.3	63.1	38.2	62.4	85
Power cord	42.5	67.3	43.8	68.0	85
M1 body on Inlet_board_L1	77.7	102.5	81.1	105.3	Ref.
T3 winding on Inlet_board_L1	56.8	81.6	58.7	82.9	100
C87 body on Inlet_board_L1	51.7	76.5	53.8	78.0	105
PCB near U9 on Inlet_board_L1	49.9	74.7	53.6	77.8	130
PCB between R316 & F5 on Inlet_board_L1	48.0	72.8	50.1	74.3	130
J1 connector on Inlet_board_L1	48.1	72.9	49.8	74.0	Ref.
Internal primary wire	57.2	82.0	58.5	82.7	105
PCB between U2 & ISO2 on SNMP_Bridge_Board	55.4	80.2	56.1	80.3	130
PCB near U3 on Outlet_PMU_Board_SKU*2	49.3	74.1	49.0	73.2	130
PCB near ISO4 on Outlet_PMU_Board_SKU*2	54.0	78.8	49.2	73.4	130
Crystal connector body	45.0	69.8	46.4	70.6	Ref.
PCB near U1 on Outlet_PMU_Board_C13~C19*6	54.1	78.9	58.7	82.9	130
Appliance outlet internal	50.3	75.1	53.1	77.3	Ref.
Ambient	25.2	→50	25.2	→50	--
Following for accessible touch temperature:					
Left end plastic enclosure	30.6	30.4	31.6	30.8	77
Top enclosure near left end	44.1	43.9	44.9	44.1	60
Top enclosure near circuit breaker 4L2	41.2	41.0	42.9	42.1	60
Enclosure near 2 ports outlet	42.4	42.2	44.0	43.2	77

IEC 62368-1							
Clause	Requirement + Test			Result - Remark			Verdict
Enclosure near 6 ports outlet	41.2	41.0	42.7	41.9	77		
Button near display	35.8	35.6	36.2	35.4	77		
Enclosure near USB port	42.5	42.3	44.3	43.5	77		
Ambient	25.2	→25	25.2	→25	--		
Supplementary information:							
Touch temperature limit under normal operating conditions for TS1 (> 1 s and < 10 s)							
Temperature T of winding:	t ₁ (°C)	R ₁ (Ω)	t ₂ (°C)	R ₂ (Ω)	T (°C)	Allowed T _{max} (°C)	Insulation class
--	--	--	--	--	--	--	--
Supplementary information:							
Supplementary information:							
Note 1: Tma should be considered as directed by applicable requirement							
Note 2: Tma is not included in assessment of Touch Temperatures (Clause 9)							

5.4.1.10.2	TABLE: Vicat softening temperature of thermoplastics		N/A
Penetration (mm)			—
Object/ Part No./Material	Manufacturer/trademark	T softening (°C)	
Supplementary information:			

5.4.1.10.3	TABLE: Ball pressure test of thermoplastics			P
Allowed impression diameter (mm) :		≤ 2 mm		—
Object/Part No./Material	Manufacturer/trademark	Test temperature (°C)	Impression diameter (mm)	
Wire connector	WAGO GmbH & Co. KG	125	1.0	
*	*	*	*	
Supplementary information:				
* Evaluated in approved power supply unit and approved appliance outlet				

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

5.4.2.2, 5.4.2.4 and 5.4.3	TABLE: Minimum Clearances/Creepage distance						P
Clearance (cl) and creepage distance (cr) at/of/between:	Up (V)	U r.m.s. (V)	Frequency (kHz) ¹	Required cl (mm)	cl (mm) ²	Required ³ cr (mm)	cr (mm)
Basic insulation							
L/N to GND	≤420	≤250	--	1.27 for 5.4.2.2 1.5 for 5.4.2.3	>3.0	2.5	>3.0
L1/L2/L3/N to GND	≤420	≤250	--	1.5	>3.0	2.5	>3.0
L to N	≤420	≤250	--	1.5	>3.0	2.5	>3.0
All Y capacitor to GND	≤420	≤250	--	1.5	>3.0	2.5	>3.0
L to N of Switching power supply (M1) on Simple Inlet_Three Phase Board of NPIM series	≤420	≤250	--	1.5	8.5	2.5	8.5
L to N of Switching power supply (M1) on Simple Inlet_Single Phase Board of NPIM series	≤420	≤250	--	1.5	2.8	2.5	2.8
Reinforced insulation							
On SNMP_Bridge_board of SPIM, SPOM, SPOS, SPOX series							
Optocoupler (ISO1, ISO2)	≤420	≤250	--	2.54 for 5.4.2.2 3.0 for 5.4.2.3	7.0	5.0	7.0
Isolating IC (U2)	≤420	≤250	--	3.0	8.0	5.0	8.0
On Simple Inlet_Three Phase Board of NPIM series							
Optocoupler (ISO1)	≤420	≤250	--	3.0	3.9	5.0	5.2
Optocoupler (ISO2, ISO3)	≤420	≤250	--	3.0	7.8	5.0	7.8
Switching power supply (M1)	≤420	≤250	--	3.0	7.8	5.0	7.8
On Simple Inlet_Single Phase Board of NPIM series							
Optocoupler (ISO1)	≤420	≤250	--	3.0	5.4	5.0	5.4
Optocoupler (ISO2)	≤420	≤250	--	3.0	3.9	5.0	5.2
Switching power supply (M1) prim. to sec.	≤420	≤250	--	3.0	5.1	5.0	5.1
Supplementary information:							
Note 1: Only for frequency above 30 kHz							
Note 2: See table 5.4.2.4 if this is based on electric strength test							
Note 3: Provide Material Group							

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
5.4.2.3	TABLE: Minimum Clearances distances using required withstand voltage		P
	Overvoltage Category (OV):		II
	Pollution Degree:		2
Clearance distanced between:		Required withstand voltage	Required cl (mm)
Measured cl (mm)			
See table 5.4.2.4 and 5.4.3			
Supplementary information:			

5.4.2.4	TABLE: Clearances based on electric strength test			N/A
Test voltage applied between:		Required cl (mm)	Test voltage (kV) peak/ r.m.s. / d.c.	Breakdown Yes / No
Supplementary information:				

5.4.4.2, 5.4.4.5 c) 5.4.4.9	TABLE: Distance through insulation measurements					P
Distance through insulation di at/of:		Peak voltage (V)	Frequency (kHz)	Material	Required DTI (mm)	DTI (mm)
RI: Mylar sheet		≤420	--	--	Min. 0.4	0.4
On SNMP_Bridge_board of SPIM, SPOM, SPOS, SPOX series						
RI: Optocoupler (ISO1, ISO2)		≤420	--	--	Min. 0.4	0.4
RI: Isolating IC (U2)		≤420	--	--	Min. 0.4	0.4
On Simple Inlet_Three Phase Board of NPIM series						
RI: Optocoupler (ISO1)		≤420	--	--	Min. 0.4	0.4
RI: Optocoupler (ISO2, ISO3)		≤420	--	--	Min. 0.4	0.4
On Simple Inlet_Single Phase Board of NPIM series						
RI: Optocoupler (ISO1)		≤420	--	--	Min. 0.4	0.4
RI: Optocoupler (ISO2)		≤420	--	--	Min. 0.4	0.4
Supplementary information:						

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

5.4.9	TABLE: Electric strength tests			P
Test voltage applied between:		Voltage shape (AC, DC)	Test voltage (V)	Breakdown Yes / No
Basic/supplementary:				
Primary to metal chassis		DC	2500	No
Reinforced:				
Primary to plastic cover on two ends		DC	4000	No
Primary to display, button		DC	4000	No
Primary to USB ports		DC	4000	No
Primary to Ethernet ports		DC	4000	No
Supplementary information:				

5.5.2.2	TABLE: Stored discharge on capacitors					N/A
Supply Voltage (V), Hz	Test Location	Operating Condition (N, S)	Switch position On or off	Measured Voltage (after 2 seconds)	ES Classification	
Supplementary information:						
X-capacitors installed for testing are: [] bleeding resistor rating: [] ICX: Notes: A. Test Location: Phase to Neutral; Phase to Phase; Phase to Earth; and/or Neutral to Earth B. Operating condition abbreviations: N – Normal operating condition (e.g., normal operation, or open fuse); S –Single fault condition						

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

5.6.6.2	TABLE: Resistance of protective conductors and terminations				P
Accessible part	Test current (A)	Duration (min)	Voltage drop (V)	Resistance (Ω)	
Earthing pin of industrial power plug to metal enclosure	40	2	0.64	0.016	
Earthing pin of industrial power plug to metal enclosure	32	2	0.576	0.018	
Supplementary information:					
Tested with model XBSPOX60-4232A3P-Vxx					

5.7.2.2, 5.7.4	TABLE: Earthed accessible conductive part		P
Supply voltage :		456.5 V/ 60 Hz	—
Location		Test conditions specified in 6.1 of IEC 60990 or Fault Condition No in IEC 60990 clause 6.2.2.1 through 6.2.2.8, except for 6.2.2.7	Touch current (mA peak)
Tested with model XBSPOX60-4232A3P-Vxx			
Line / Neutral to earth (metal chassis)		1	0.060
		2*	N/A
		3	N/A
		4	0.082
		5	N/A
		6	N/A
		8	N/A
Tested with model XBSPOX60-4232A1P-Vxx			
Line / Neutral to earth (metal chassis)		1	0.068
		2*	N/A
		3	N/A
		4	0.092
		5	N/A
		6	N/A
		8	N/A
Supplementary Information:			
Notes: [1] Supply voltage is the anticipated maximum Touch Voltage [2] Earthed neutral conductor [Voltage differences less than 1% or more] [3] Specify method used for measurement as described in IEC 60990 sub-clause 4.3 [4] IEC60990, sub-clause 6.2.2.7, Fault 7 not applicable. [5] (*) IEC60990, sub-clause 6.2.2.2 is not applicable if switch or disconnect device (e.g., appliance coupler) provided.			

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

6.2.2	Table: Electrical power sources (PS) measurements for classification					P
Source	Description	Measurement	Max Power after 3 s	Max Power after 5 s ^{*)}	PS Classification	
All circuits except output terminals	Normal/abnormal/ single fault	Power (W) :	--	> 100 W	PS3 (declared)	
		V _A (V) :	--	--		
		I _A (A) :	--	--		
Supplementary Information:						
(*) Measurement taken only when limits at 3 seconds exceed PS1 limits						

6.2.3.1	Table: Determination of Potential Ignition Sources (Arcing PIS)				P
Location		Open circuit voltage After 3 s (V _p)	Measured r.m.s current (I _{rms})	Calculated value (V _p x I _{rms})	Arcing PIS? Yes / No
Primary circuits are considered as arcing PIS		--	--	--	Yes
Supplementary information:					
An Arcing PIS requires a minimum of 50 V (peak) a.c. or d.c. An Arcing PIS is established when the product of the open circuit voltage (V _p) and normal operating condition rms current (I _{rms}) is greater than 15.					

6.2.3.2	Table: Determination of Potential Ignition Sources (Resistive PIS)				P
Circuit Location (x-y)	Operating Condition (Normal / Describe Single Fault)	Measured wattage or VA During first 30 s (W / VA)	Measured wattage or VA After 30 s (W / VA)	Protective Circuit, Regulator, or PTC Operated? Yes / No (Comment)	Resistive PIS? Yes/No
All components located within the EUT are considered as resistive PIS	--	--	--	--	Yes
Supplementary Information:					
A combination of voltmeter, V _A and ammeter I _A may be used instead of a wattmeter. If a separate voltmeter and ammeter are used, the product of (V _A x I _A) is used to determine Resistive PIS classification. A Resistive PIS: (a) dissipates more than 15 W, measured after 30 s of normal operation, <u>or</u> (b) under single fault conditions has either a power exceeding 100 W measured immediately after the introduction of the fault if electronic circuits, regulators or PTC devices are used, or has an available power exceeding 15 W measured 30 s after introduction of the fault.					

8.5.5	TABLE: High Pressure Lamp			N/A
Description		Values	Energy Source Classification	
Lamp type			—	
Manufacturer			—	
Cat no.			—	
Pressure (cold) (MPa).....			MS_	
Pressure (operating) (MPa).....			MS_	

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict
Operating time (minutes)..... :			—
Explosion method			—
Max particle length escaping enclosure (mm). :			MS_
Max particle length beyond 1 m (mm)..... :			MS_
Overall result			
Supplementary information:			

B.2.5		TABLE: Input test						P
U (V)	Hz	I (A)	I rated (A)	P (W)	P rated (W)	Fuse No	I fuse (A)	Condition/status
Tested with model XBSPOX60-4232A3P-Vxx								
342	50	32.28	--	5503.97	--	--	--	Normal work with full load. The input voltages are three phases.
342	60	32.28	--	5503.97	--	--	--	
380	50	32.26	32	6113.61	--	--	--	
380	60	32.26	32	6113.61	--	--	--	
415	50	32.23	32	8039.54	--	--	--	
415	60	32.23	32	8039.54	--	--	--	
457	50	32.22	--	8842.52	--	--	--	
457	60	32.22	--	8842.52	--	--	--	
Tested with model XBSPOX60-4232A1P-Vxx								
171	50	32.27	--	5502.47	--	--	--	Normal work with full load. The input voltages are single phase.
171	60	32.27	--	5502.47	--	--	--	
190	50	32.25	32	6112.11	--	--	--	
190	60	32.25	32	6112.11	--	--	--	
240	50	32.22	32	8038.04	--	--	--	
240	60	32.22	32	8038.04	--	--	--	
264	50	32.21	--	8841.02	--	--	--	
264	60	32.21	--	8841.02	--	--	--	
Supplementary information:								
Equipment may be have rated current or rated power or both. Both should be measured								

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

B.3	TABLE: Abnormal operating condition tests							P
Ambient temperature (°C)					25		—	
Power source for EUT: Manufacturer, model/type, output rating ..					See appended table 4.1.2		—	
Component No.	Abnormal Condition	Supply voltage, (V)	Test time (ms)	Fuse no.	Fuse current, (A)	T-couple	Temp. (°C)	Observation
Tested with model XBSPOX60-4232A1P-Vxx								
USB 1	Overload	264	3 h	--	--	Type K	Metal enclosure 45.2°C	USB port shutdown when load to 1.6A, No damage. No hazard.
Supplementary information:								
Test table is provided to record abnormal and fault conditions for all applicable energy sources including Thermal burn injury. Column "Abnormal/Fault." Specify if test condition by indicating "Abnormal" then the condition for a Clause B.3 test or "Single Fault" then the condition for Clause B.4.								

B.4	TABLE: Fault condition tests							P
Ambient temperature (°C)					See table 5.4.1.4, 6.3.2, 9.0, B.2.6		—	
Power source for EUT: Manufacturer, model/type, output rating ..					See appended table 4.1.2		—	
Component No.	Fault Condition	Supply voltage, (V)	Test time (ms)	Fuse no.	Fuse current, (A)	T-couple	Temp. (°C)	Observation
Tested with model XBSPOX60-4232A1P-Vxx								
D16 on Inlet_board_L1 board	SC	264	20 min	--	--	--	--	F5 opened immediately. The display shutdown. Other part of the PSU was in normal work. No hazards.
ISO2 on Inlet_board_L1 board pin 1-3	SC	264	20 min	--	--	--	--	F5 opened immediately. The display shutdown. Other part of the PSU was in normal work. No hazards.

IEC 62368-1								
Clause	Requirement + Test			Result - Remark				Verdict
ISO2 on Inlet_board_L1 board pin 1-4	SC	264	20 min	--	--	--	--	F5 opened immediately. The display shutdown. Other part of the PSU was in normal work. No hazards.
D19 on Inlet_board_L1 board	OC	264	20 min	--	--	--	--	F5 opened immediately. The display shutdown. Other part of the PSU was in normal work. No hazards.
R315 on Inlet_board_L1 board	SC	264	20 min	--	--	--	--	F5 opened immediately. The display shutdown. Other part of the PSU was in normal work. No hazards.
Supplementary information:								
SC= short circuit; OC= open circuit								

IEC 62368-1									
Clause	Requirement + Test					Result - Remark			Verdict
Annex M.3	TABLE: Batteries								P
The tests of Annex M are applicable only when appropriate battery data is not available								P	
Is it possible to install the battery in a reverse polarity position?..... :						Not possible.			P
	Non-rechargeable batteries			Rechargeable batteries					
	Discharging		Un-intentional charging	Charging		Discharging		Reversed charging	
	Meas. current	Manuf. Specs.		Meas. current	Manuf. Specs.	Meas. current	Manuf. Specs.	Meas. current	Manuf. Specs.
Max. current during normal condition	2.4 μA	--	Max. 10mA	--	--	--	--	--	--
Max. current during fault condition (R102 SC)	2.1 mA	--	0.1mA	--	--	--	--	--	--
Test results:								Verdict	
- Chemical leaks						No chemical leaks		P	
- Explosion of the battery						No explosion		P	
- Emission of flame or expulsion of molten metal						No emission of flame or expulsion of molten metal		P	
- Electric strength tests of equipment after completion of tests								N/A	
Supplementary information:									
SC= short circuit; OC= open circuit									

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

Annex M.4 Table: Additional safeguards for equipment containing secondary lithium batteries					N/A
Battery/Cell No.	Test conditions	Measurements			Observation
		U (V)	I (A)	Temp (C)	
Supplementary Information:					
Battery identification	Charging at T_{lowest} (°C)	Observation	Charging at T_{highest} (°C)	Observation	
Supplementary Information:					

Annex Q.1	TABLE: Circuits intended for interconnection with building wiring (LPS)					P
Note: Measured UOC (V) with all load circuits disconnected:						
Output Circuit	Components	U _{oc} (V)	I _{sc} (A)		S (VA)	
			Meas.	Limit	Meas.	Limit
USB 1 port	normal	5.05	1.6	≤ 8	7.13	≤ 100
	FB1 SC	5.04	1.7	≤ 8	7.67	≤ 100
USB 2 port	normal	5.04	1.6	≤ 8	7.14	≤ 100
	FB1 SC	5.04	1.7	≤ 8	7.67	≤ 100
Supplementary Information:						

T.2, T.3, T.4, T.5 TABLE: Steady force test					P
Part/Location	Material	Thickness (mm)	Force (N)	Test Duration (sec)	Observation
Main enclosure	Metal	1.5	250	5	No damage and all other safeguards remain effective.
Side ends cover	Plastic	2.3	250	5	No damage and all other safeguards remain effective.
Supplementary information:					
The steady force was applied in turn to the top, bottom and sides					

IEC 62368-1			
Clause	Requirement + Test	Result - Remark	Verdict

T.6, T.9	TABLE: Impact tests				P
Part/Location	Material	Thickness (mm)	Vertical distance (mm)	Observation	
Main enclosure	Metal	1.5	1300	No damage and all other safeguards remain effective.	
Side ends cover	Plastic	2.3	1300	No damage and all other safeguards remain effective.	
Supplementary information:					

T.7	TABLE: Drop tests				N/A
Part/Location	Material	Thickness (mm)	Drop Height (mm)	Observation	
Supplementary information:					
The complete equipment is subjected to three drops					

T.8	TABLE: Stress relief test					P
Part/Location	Material	Thickness (mm)	Oven Temperature (°C)	Duration (h)	Observation	
Side ends cover	Plastic	2.3	70	7	No damage and all other safeguards remain effective.	
Supplementary information:						

--End of test report--

Attachment					Model Difference List		CN25FJQ7 001	
Series name	Model Name	Voltage(V)	Current(A)	No. Of outlets	Power Capacity(kVA)	Plug type	Form Factor	Power cord type, rating & length
BPDU	XNBPDU19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPDU55-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPDU55-1816A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPDU55-2416A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPDU55-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBBPDU19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPDU19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPDU55-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPDU55-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPDU55-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNBPDU19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPDU19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPDU55-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPDU55-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPDU55-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPDU55-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBBPDU19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPDU19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPDU55-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPDU55-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPDU55-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPDU19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBBPDU19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBBPDU60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBBPDU60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
BPIM	XNBPIM19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPIM55-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPIM55-1816A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPIM55-2416A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNBPIM55-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBBPIM19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPIM19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPIM55-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPIM55-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBBPIM55-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNBPIM19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPIM19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPIM55-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPIM55-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPIM55-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNBPIM55-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBBPIM19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPIM19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPIM55-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPIM55-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPIM55-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBBPIM19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBBPIM19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBBPIM60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBBPIM60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h

Attachment				Model Difference List			CN25FJQ7 001	
Series name	Model Name	Voltage(V)	Current(A)	No. Of outlets	Power Capacity(kVA)	Plug type	Form Factor	Power cord type, rating & length
NPIM	XNNPIM19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNNPIM55-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNNPIM55-1816A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNNPIM55-2416A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNNPIM55-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBNPIM19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBNPIM19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBNPIM55-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBNPIM55-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBNPIM55-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNNPIM19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNNPIM19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNNPIM55-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNNPIM55-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNNPIM55-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNNPIM55-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBNPIM19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBNPIM19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBNPIM55-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBNPIM55-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBNPIM55-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBNPIM19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBNPIM19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBNPIM60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBNPIM60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
SPIM	XNSPIM19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPIM60-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPIM60-1816A1P-Vxx	230	16	18	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPIM60-2416A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPIM60-3016A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPIM60-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBSPIM19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPIM19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPIM60-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPIM60-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPIM60-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNSPIM19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPIM19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPIM60-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPIM60-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPIM60-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPIM60-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBSPIM19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPIM19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPIM60-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPIM60-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPIM60-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPIM19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPIM19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPIM60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPIM60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h

Attachment					Model Difference List			CN25FJQ7 001
Series name	Model Name	Voltage(V)	Current(A)	No. Of outlets	Power Capacity(kVA)	Plug type	Form Factor	Power cord type, rating & length
SPOS	XNSPOS19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOS19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNSPOS60-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOS60-1816A1P-Vxx	230	16	18	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOS60-2416A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOS60-3016A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOS60-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBSPOS19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOS19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOS60-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOS60-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOS60-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOS60-4232A1P-Vxx	230	32	42	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNSPOS19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOS19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOS60-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOS60-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOS60-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOS60-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBSPOS19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOS19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOS60-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOS60-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOS60-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOS19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOS19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOS60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOS60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
SPOM	XNSPOM19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOM60-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOM60-2416A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOM60-3016A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOM60-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBSPOM19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOM19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOM60-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOM60-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOM60-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOM60-4232A1P-Vxx	230	32	42	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNSPOM19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOM19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOM60-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOM60-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOM60-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOM60-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBSPOM19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOM19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOM60-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOM60-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOM60-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
XBSPOM19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h	

Attachment				Model Difference List			CN25FJQ7 001	
Series name	Model Name	Voltage(V)	Current(A)	No. Of outlets	Power Capacity(kVA)	Plug type	Form Factor	Power cord type, rating & length
	XBSPOM19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOM60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOM60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h

Attachment				Model Difference List				CN25FJQ7 001
Series name	Model Name	Voltage(V)	Current(A)	No. Of outlets	Power Capacity(kVA)	Plug type	Form Factor	Power cord type, rating & length
SPOX	XNSPOX19-1216A1P-Hxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOX19-2416A1P-Hxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Horizontal	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOX60-1216A1P-Vxx	230	16	12	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOX60-1816A1P-Vxx	230	16	18	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOX60-2416A1P-Vxx	230	16	24	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOX60-3016A1P-Vxx	230	16	30	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XNSPOX60-3616A1P-Vxx	230	16	36	3.6	1P+N+E 16A CEE 6h	Vertical	H05VV-F3G1,5mm2 3M 16A CEE plug 6h
	XBSPOX19-1232A1P-Hxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOX19-2432A1P-Hxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Horizontal	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOX60-1232A1P-Vxx	230	32	12	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOX60-2432A1P-Vxx	230	32	24	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOX60-3632A1P-Vxx	230	32	36	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XBSPOX60-4232A1P-Vxx	230	32	42	7.2	1P+N+E 32A CEE 6h	Vertical	H07RN-F3G4mm2 3M 32A CEE plug 6h
	XNSPOX19-1216A3P-Hxx	380-415	16	12	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOX19-2416A3P-Hxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Horizontal	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOX60-1816A3P-Vxx	380-415	16	18	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOX60-2416A3P-Vxx	380-415	16	24	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOX60-3616A3P-Vxx	380-415	16	36	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XNSPOX60-4216A3P-Vxx	380-415	16	42	11.1	3P+N+E 16A CEE 6h	Vertical	H07RN-F5G2,5mm2 3M 16A CEE plug 6h
	XBSPOX19-1232A3P-Hxx	380-415	32	12	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOX19-2432A3P-Hxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Horizontal	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOX60-2432A3P-Vxx	380-415	32	24	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOX60-3632A3P-Vxx	380-415	32	36	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOX60-4232A3P-Vxx	380-415	32	42	22.2	3P+N+E 32A CEE 6h	Vertical	H07RN-F5G4mm2 3M 32A CEE plug 6h
	XBSPOX19-1263A3P-Hxx	380-415	63	12	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOX19-2463A3P-Hxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Horizontal	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOX60-2463A3P-Vxx	380-415	63	24	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h
	XBSPOX60-3663A3P-Vxx	380-415	63	36	44.4	3P+N+E 63A CEE 6h	Vertical	H07RN-F5G16mm2 3M 63A CEE plug 6h

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
ATTACHMENT TO TEST REPORT IEC 62368-1 EUROPEAN GROUP DIFFERENCES AND NATIONAL DIFFERENCES (Audio/video, information and communication technology equipment - Part 1: Safety requirements)			
Differences according to : EN 62368-1:2014+A11:2017			
Attachment Form No. : EU_GD_IEC62368_1D_II			
Attachment Originator : Nemko AS			
Master Attachment : Date 2021-02-04			
Copyright © 2021 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			

	CENELEC COMMON MODIFICATIONS (EN)					P																																				
	Clauses, subclauses, notes, tables, figures and annexes which are additional to those in IEC 62368-1:2014 are prefixed “Z”.					P																																				
CONTENTS	Add the following annexes: Annex ZA (normative) Normative references to international publications with their corresponding European publications Annex ZB (normative) Special national conditions Annex ZC (informative) A-deviations Annex ZD (informative) IEC and CENELEC code designations for flexible cords					P																																				
	Delete all the “country” notes in the reference document (IEC 62368-1:2014) according to the following list: <table><tr><td>0.2.1</td><td>Note</td><td>1</td><td>Note 3</td><td>4.1.15</td><td>Note</td></tr><tr><td>4.7.3</td><td>Note 1 and 2</td><td>5.2.2.2</td><td>Note</td><td>5.4.2.3.2.2 Table 13</td><td>Note c</td></tr><tr><td>5.4.2.3.2.4</td><td>Note 1 and 3</td><td>5.4.2.5</td><td>Note 2</td><td>5.4.5.1</td><td>Note</td></tr><tr><td>5.5.2.1</td><td>Note</td><td>5.5.6</td><td>Note</td><td>5.6.4.2.1</td><td>Note 2 and 3</td></tr><tr><td>5.7.5</td><td>Note</td><td>5.7.6.1</td><td>Note 1 and 2</td><td>10.2.1 Table 39</td><td>Note 2, 3 and 4</td></tr><tr><td>10.5.3</td><td>Note 2</td><td>10.6.2.1</td><td>Note 3</td><td>F.3.3.6</td><td>Note 3</td></tr></table>					0.2.1	Note	1	Note 3	4.1.15	Note	4.7.3	Note 1 and 2	5.2.2.2	Note	5.4.2.3.2.2 Table 13	Note c	5.4.2.3.2.4	Note 1 and 3	5.4.2.5	Note 2	5.4.5.1	Note	5.5.2.1	Note	5.5.6	Note	5.6.4.2.1	Note 2 and 3	5.7.5	Note	5.7.6.1	Note 1 and 2	10.2.1 Table 39	Note 2, 3 and 4	10.5.3	Note 2	10.6.2.1	Note 3	F.3.3.6	Note 3	P
0.2.1	Note	1	Note 3	4.1.15	Note																																					
4.7.3	Note 1 and 2	5.2.2.2	Note	5.4.2.3.2.2 Table 13	Note c																																					
5.4.2.3.2.4	Note 1 and 3	5.4.2.5	Note 2	5.4.5.1	Note																																					
5.5.2.1	Note	5.5.6	Note	5.6.4.2.1	Note 2 and 3																																					
5.7.5	Note	5.7.6.1	Note 1 and 2	10.2.1 Table 39	Note 2, 3 and 4																																					
10.5.3	Note 2	10.6.2.1	Note 3	F.3.3.6	Note 3																																					
	For special national conditions, see Annex ZB.					P																																				
1	Add the following note: NOTE Z1 The use of certain substances in electrical and electronic equipment is restricted within the EU: see Directive 2011/65/EU.					P																																				

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
4.Z1	<p>Add the following new subclause after 4.9:</p> <p>To protect against excessive current, short-circuits and earth faults in circuits connected to an a.c. mains, protective devices shall be included either as integral parts of the equipment or as parts of the building installation, subject to the following, a), b) and c):</p> <p>a) except as detailed in b) and c), protective devices necessary to comply with the requirements of B.3.1 and B.4 shall be included as parts of the equipment;</p> <p>b) for components in series with the mains input to the equipment such as the supply cord, appliance coupler, r.f.i. filter and switch, short-circuit and earth fault protection may be provided by protective devices in the building installation;</p> <p>c) it is permitted for pluggable equipment type B or permanently connected equipment, to rely on dedicated overcurrent and short-circuit protection in the building installation, provided that the means of protection, e.g. fuses or circuit breakers, is fully specified in the installation instructions.</p> <p>If reliance is placed on protection in the building installation, the installation instructions shall so state, except that for pluggable equipment type A the building installation shall be regarded as providing protection in accordance with the rating of the wall socket outlet.</p>	Considered	P
5.4.2.3.2.4	<p>Add the following to the end of this subclause:</p> <p>The requirement for interconnection with external circuit is in addition given in EN 50491-3:2009.</p>		N/A
10.2.1	<p>Add the following to ^{c)} and ^{d)} in table 39:</p> <p>For additional requirements, see 10.5.1.</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
10.5.1	<p>Add the following after the first paragraph: <i>For RS 1 compliance is checked by measurement under the following conditions:</i></p> <p><i>In addition to the normal operating conditions, all controls adjustable from the outside by hand, by any object such as a tool or a coin, and those internal adjustments or presets which are not locked in a reliable manner, are adjusted so as to give maximum radiation whilst maintaining an intelligible picture for 1 h, at the end of which the measurement is made.</i></p> <p>NOTE Z1 Soldered joints and paint lockings are examples of adequate locking.</p> <p><i>The dose-rate is determined by means of a radiation monitor with an effective area of 10 cm², at any point 10 cm from the outer surface of the apparatus.</i></p> <p><i>Moreover, the measurement shall be made under fault conditions causing an increase of the high-voltage, provided an intelligible picture is maintained for 1 h, at the end of which the measurement is made.</i></p> <p><i>For RS1, the dose-rate shall not exceed 1 µSv/h taking account of the background level.</i></p> <p>NOTE Z2 These values appear in Directive 96/29/Euratom of 13 May 1996.</p>	No such x-radiation generated from the equipment.	N/A
10.6.1	<p>Add the following paragraph to the end of the subclause: EN 71-1:2011, 4.20 and the related tests methods and measurement distances apply.</p>		N/A
10.Z1	<p>Add the following new subclause after 10.6.5. 10.Z1 Non-ionizing radiation from radio frequencies in the range 0 to 300 GHz</p> <p>The amount of non-ionizing radiation is regulated by European Council Recommendation 1999/519/EC of 12 July 1999 on the limitation of exposure of the general public to electromagnetic fields (0 Hz to 300 GHz).</p> <p>For intentional radiators, ICNIRP guidelines should be taken into account for Limiting Exposure to Time-Varying Electric, Magnetic, and Electromagnetic Fields (up to 300 GHz). For hand-held and body-mounted devices, attention is drawn to EN 50360 and EN 50566</p>		N/A
G.7.1	<p>Add the following note: NOTE Z1 The harmonized code designations corresponding to the IEC cord types are given in Annex ZD.</p>		P

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
Bibliography	<p>Add the following standards:</p> <p>Add the following notes for the standards indicated:</p> <p>IEC 60130-9 NOTE Harmonized as EN 60130-9.</p> <p>IEC 60269-2 NOTE Harmonized as HD 60269-2.</p> <p>IEC 60309-1 NOTE Harmonized as EN 60309-1.</p> <p>IEC 60364 NOTE some parts harmonized in HD 384/HD 60364 series.</p> <p>IEC 60601-2-4 NOTE Harmonized as EN 60601-2-4.</p> <p>IEC 60664-5 NOTE Harmonized as EN 60664-5.</p> <p>IEC 61032:1997 NOTE Harmonized as EN 61032:1998 (not modified).</p> <p>IEC 61508-1 NOTE Harmonized as EN 61508-1.</p> <p>IEC 61558-2-1 NOTE Harmonized as EN 61558-2-1.</p> <p>IEC 61558-2-4 NOTE Harmonized as EN 61558-2-4.</p> <p>IEC 61558-2-6 NOTE Harmonized as EN 61558-2-6.</p> <p>IEC 61643-1 NOTE Harmonized as EN 61643-1.</p> <p>IEC 61643-21 NOTE Harmonized as EN 61643-21.</p> <p>IEC 61643-311 NOTE Harmonized as EN 61643-311.</p> <p>IEC 61643-321 NOTE Harmonized as EN 61643-321.</p> <p>IEC 61643-331 NOTE Harmonized as EN 61643-331.</p>		P
ZB	ANNEX ZB, SPECIAL NATIONAL CONDITIONS (EN)		P
4.1.15	<p>Denmark, Finland, Norway and Sweden</p> <p>To the end of the subclause the following is added:</p> <p>Class I pluggable equipment type A intended for connection to other equipment or a network shall, if safety relies on connection to reliable earthing or if surge suppressors are connected between the network terminals and accessible parts, have a marking stating that the equipment shall be connected to an earthed mains socket-outlet.</p> <p>The marking text in the applicable countries shall be as follows:</p> <p>In Denmark: "Apparatets stikprop skal tilsluttes en stikkontakt med jord som giver forbindelse til stikproppens jord."</p> <p>In Finland: "Laite on liitettävä suojakoskettimilla varustettuun pistorasiaan"</p> <p>In Norway: "Apparatet må tilkoples jordet stikkontakt"</p> <p>In Sweden: "Apparaten skall anslutas till jordat uttag"</p>	Class I pluggable equipment type B	N/A
4.7.3	<p>United Kingdom</p> <p>To the end of the subclause the following is added:</p> <p>The torque test is performed using a socket-outlet complying with BS 1363, and the plug part shall be assessed to the relevant clauses of BS 1363. Also see Annex G.4.2 of this annex</p>	The equipment is not direct plug-in equipment.	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.2.2.2	Denmark After the 2nd paragraph add the following: A warning (marking safeguard) for high touch current is required if the touch current exceeds the limits of 3,5 mA a.c. or 10 mA d.c.	No high touch current.	N/A
5.4.11.1 and Annex G	Finland and Sweden To the end of the subclause the following is added: For separation of the telecommunication network from earth the following is applicable: If this insulation is solid, including insulation forming part of a component, it shall at least consist of either <ul style="list-style-type: none"> • two layers of thin sheet material, each of which shall pass the electric strength test below, or • one layer having a distance through insulation of at least 0,4 mm, which shall pass the electric strength test below. If this insulation forms part of a semiconductor component (e.g. an optocoupler), there is no distance through insulation requirement for the insulation consisting of an insulating compound completely filling the casing, so that clearances and creepage distances do not exist, if the component passes the electric strength test in accordance with the compliance clause below and in addition <ul style="list-style-type: none"> • passes the tests and inspection criteria of 5.4.8 with an electric strength test of 1,5 kV multiplied by 1,6 (the electric strength test of 5.4.9 shall be performed using 1,5 kV), and • is subject to routine testing for electric strength during manufacturing, using a test voltage of 1,5kV. It is permitted to bridge this insulation with a capacitor complying with EN 60384-14:2005, subclass Y2. A capacitor classified Y3 according to EN 60384-14:2005, may bridge this insulation under the following conditions: <ul style="list-style-type: none"> • the insulation requirements are satisfied by having a capacitor classified Y3 as defined by EN 60384-14, which in addition to the Y3 testing, is tested with an impulse test of 2,5 kV defined in 5.4.11; • the additional testing shall be performed on all the test specimens as described in EN 60384-14; the impulse test of 2,5 kV is to be performed before the endurance test in EN 60384-14, in the sequence of tests as described in EN 60384-14. 	Class I pluggable equipment type B	N/A
5.5.2.1	Norway After the 3rd paragraph the following is added: Due to the IT power system used, capacitors are required to be rated for the applicable line-to-line voltage (230 V).	TN power system	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.5.6	Finland, Norway and Sweden To the end of the subclause the following is added: Resistors used as basic safeguard or bridging basic insulation in class I pluggable equipment type A shall comply with G.10.1 and the test of G.10.2.	Class I pluggable equipment type B	N/A
5.6.1	Denmark Add to the end of the subclause Due to many existing installations where the socket-outlets can be protected with fuses with higher rating than the rating of the socket-outlets the protection for pluggable equipment type A shall be an integral part of the equipment. <i>Justification:</i> In Denmark an existing 13 A socket outlet can be protected by a 20 A fuse.		P
5.6.4.2.1	Ireland and United Kingdom After the indent for pluggable equipment type A , the following is added: – the protective current rating is taken to be 13 A, this being the largest rating of fuse used in the mains plug.	Class I pluggable equipment type B	N/A
5.6.5.1	To the second paragraph the following is added: The range of conductor sizes of flexible cords to be accepted by terminals for equipment with a rated current over 10 A and up to and including 13 A is: 1,25 mm ² to 1,5 mm ² in cross-sectional area.		N/A
5.7.5	Denmark To the end of the subclause the following is added: The installation instruction shall be affixed to the equipment if the protective conductor current exceeds the limits of 3,5 mA a.c. or 10 mA d.c.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.7.6.1	<p>Norway and Sweden</p> <p>To the end of the subclause the following is added:</p> <p>The screen of the television distribution system is normally not earthed at the entrance of the building and there is normally no equipotential bonding system within the building. Therefore the protective earthing of the building installation needs to be isolated from the screen of a cable distribution system.</p> <p>It is however accepted to provide the insulation external to the equipment by an adapter or an interconnection cable with galvanic isolator, which may be provided by a retailer, for example.</p> <p>The user manual shall then have the following or similar information in Norwegian and Swedish language respectively, depending on in what country the equipment is intended to be used in:</p> <p>“Apparatus connected to the protective earthing of the building installation through the mains connection or through other apparatus with a connection to protective earthing – and to a television distribution system using coaxial cable, may in some circumstances create a fire hazard. Connection to a television distribution system therefore has to be provided through a device providing electrical isolation below a certain frequency range (galvanic isolator, see EN 60728-11)”</p> <p>NOTE In Norway, due to regulation for CATV-installations, and in Sweden, a galvanic isolator shall provide electrical insulation below 5 MHz. The insulation shall withstand a dielectric strength of 1,5 kV r.m.s., 50 Hz or 60 Hz, for 1 min.</p> <p>Translation to Norwegian (the Swedish text will also be accepted in Norway):</p> <p>“Apparater som er koplet til beskyttelsesjord via nettplugg og/eller via annet jordtilkoplet utstyr – og er tilkoplet et koaksialbasert kabel-TV nett, kan forårsake brannfare. For å unngå dette skal det ved tilkopling av apparater til kabel-TV nett installeres en galvanisk isolator mellom apparatet og kabel-TV nettet.”</p> <p>Translation to Swedish:</p> <p>“Apparater som är kopplad till skyddsjord via jordat vägguttag och/eller via annan utrustning och samtidigt är kopplad till kabel-TV nät kan i vissa fall medföra risk för brand. För att undvika detta skall vid anslutning av apparaten till kabel-TV nät galvanisk isolator finnas mellan apparaten och kabel-TV nätet.”.</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.7.6.2	Denmark To the end of the subclause the following is added: The warning (marking safeguard) for high touch current is required if the touch current or the protective current exceed the limits of 3,5 mA .		N/A
B.3.1 and B.4	Ireland and United Kingdom The following is applicable: To protect against excessive currents and short-circuits in the primary circuit of direct plug-in equipment , tests according to Annexes B.3.1 and B.4 shall be conducted using an external miniature circuit breaker complying with EN 60898-1, Type B, rated 32A. If the equipment does not pass these tests, suitable protective devices shall be included as an integral part of the direct plug-in equipment , until the requirements of Annexes B.3.1 and B.4 are met	Not a direct plug-in type equipment	N/A
G.4.2	Denmark To the end of the subclause the following is added: Supply cords of single phase appliances having a rated current not exceeding 13 A shall be provided with a plug according to DS 60884-2-D1:2011. CLASS I EQUIPMENT provided with socket-outlets with earth contacts or which are intended to be used in locations where protection against indirect contact is required according to the wiring rules shall be provided with a plug in accordance with standard sheet DK 2-1a or DK 2-5a. If a single-phase equipment having a RATED CURRENT exceeding 13 A or if a poly-phase equipment is provided with a supply cord with a plug, this plug shall be in accordance with the standard sheets DK 6-1a in DS 60884-2-D1 or EN 60309-2. Mains socket outlets intended for providing power to Class II apparatus with a rated current of 2,5 A shall be in accordance DS 60884-2-D1:2011 standard sheet DKA 1-4a. Other current rating socket outlets shall be in compliance with Standard Sheet DKA 1-3a or DKA 1-1c. Mains socket-outlets with earth shall be in compliance with DS 60884-2-D1:2011 Standard Sheet DK 1-3a, DK 1-1c, DK1-1d, DK 1-5a or DK 1-7a <i>Justification:</i> Heavy Current Regulations, Section 6c		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
G.4.2	United Kingdom To the end of the subclause the following is added: The plug part of direct plug-in equipment shall be assessed to BS 1363: Part 1, 12.1, 12.2, 12.3, 12.9, 12.11, 12.12, 12.13, 12.16, and 12.17, except that the test of 12.17 is performed at not less than 125 °C. Where the metal earth pin is replaced by an Insulated Shutter Opening Device (ISOD), the requirements of clauses 22.2 and 23 also apply.		N/A
G.7.1	United Kingdom To the first paragraph the following is added: Equipment which is fitted with a flexible cable or cord and is designed to be connected to a mains socket conforming to BS 1363 by means of that flexible cable or cord shall be fitted with a 'standard plug' in accordance with the Plugs and Sockets etc (Safety) Regulations 1994, Statutory Instrument 1994 No. 1768, unless exempted by those regulations. NOTE "Standard plug" is defined in SI 1768:1994 and essentially means an approved plug conforming to BS 1363 or an approved conversion plug.	To be considered in the national approval	N/A
G.7.1	Ireland To the first paragraph the following is added: Apparatus which is fitted with a flexible cable or cord shall be provided with a plug in accordance with Statutory Instrument 525: 1997, "13 A Plugs and Conversion Adapters for Domestic Use Regulations: 1997. S.I. 525 provides for the recognition of a standard of another Member State which is equivalent to the relevant Irish Standard	To be considered in the national approval	N/A
G.7.2	Ireland and United Kingdom To the first paragraph the following is added: A power supply cord with a conductor of 1,25 mm ² is allowed for equipment which is rated over 10 A and up to and including 13 A.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
ZC	ANNEX ZC, NATIONAL DEVIATIONS (EN)		N/A
10.5.2	<p>Germany</p> <p>The following requirement applies:</p> <p>For the operation of any cathode ray tube intended for the display of visual images operating at an acceleration voltage exceeding 40 kV, authorization is required, or application of type approval (Bauartzulassung) and marking.</p> <p><i>Justification:</i></p> <p>German ministerial decree against ionizing radiation (Röntgenverordnung), in force since 2002-07-01, implementing the European Directive 96/29/EURATOM.</p> <p>NOTE Contact address:</p> <p>Physikalisch-Technische Bundesanstalt, Bundesallee 100, D-38116 Braunschweig, Tel.: Int +49-531-592-6320, Internet: http://www.ptb.de</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
<p align="center">ATTACHMENT TO TEST REPORT IEC 62368-1 DENMARK NATIONAL DIFFERENCES Audio/video, information and communication technology equipment – Part 1: Safety requirements</p>			
Differences according to : DS/EN 62368-1:2014			
Attachment Form No. : DK_ND_IEC62368_1D			
Attachment Originator : UL (Demko)			
Master Attachment : 2021-02-04			
Copyright © 2021 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			

	National Differences		
4.1.15	<p>To the end of the subclause the following is added:</p> <p>Class I pluggable equipment type A intended for connection to other equipment or a network shall, if safety relies on connection to reliable earthing or if surge suppressors are connected between the network terminals and accessible parts, have a marking stating that the equipment shall be connected to an earthed mains socket-outlet.</p> <p>The marking text in the applicable countries shall be as follows: “Apparatets stikprop skal tilsluttes en stikkontakt med jord som giver forbindelse til stikproppens jord.”</p>	Class I pluggable equipment type B	N/A
5.2.2.2	<p>After the 2nd paragraph add the following: A warning (marking safeguard) for high touch current is required if the touch current exceeds the limits of 3,5 mA a.c. or 10 mA d.c.</p>	No high touch current.	N/A
5.6.1	<p>Add to the end of the subclause:</p> <p>Due to many existing installations where the socket-outlets can be protected with fuses with higher rating than the rating of the socket-outlets the protection for pluggable equipment type A shall be an integral part of the equipment.</p> <p>Justification: In Denmark an existing 13 A socket outlet can be protected by a 20 A fuse.</p>	Class I pluggable equipment type B	N/A
5.7.5	<p>To the end of the subclause the following is added:</p> <p>The installation instruction shall be affixed to the equipment if the protective conductor current exceeds the limits of 3,5 mA a.c. or 10 mA d.c.</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.7.6.2	<p>To the end of the subclause the following is added:</p> <p>The warning (marking safeguard) for high touch current is required if the touch current or the protective current exceed the limits of 3,5 mA.</p>		N/A
G.4.2	<p>To the end of the subclause the following is added:</p> <p>Supply cords of single phase appliances having a rated current not exceeding 13 A shall be provided with a plug according to DS 60884-2-D1:2011.</p> <p>CLASS I EQUIPMENT provided with socket-outlets with earth contacts or which are intended to be used in locations where protection against indirect contact is required according to the wiring rules shall be provided with a plug in accordance with standard sheet DK 2-1a or DK 2-5a.</p> <p>If a single-phase equipment having a RATED CURRENT exceeding 13 A or if a poly-phase equipment is provided with a supply cord with a plug, this plug shall be in accordance with the standard sheets DK 6-1a in DS 60884-2-D1 or EN 60309-2.</p> <p>Mains socket outlets intended for providing power to Class II apparatus with a rated current of 2,5 A shall be in accordance DS 60884-2-D1:2011 standard sheet DKA 1-4a.</p> <p>Other current rating socket outlets shall be in compliance with Standard Sheet DKA 1-3a or DKA 1-1c.</p> <p>Mains socket-outlets with earth shall be in compliance with DS 60884-2-D1:2011 Standard Sheet DK 1-3a, DK 1-1c, DK1-1d, DK 1-5a or DK 1-7a</p> <p>Justification: Heavy Current Regulations, Section 6c</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
<p align="center">ATTACHMENT TO TEST REPORT IEC 62368-1 ITALY NATIONAL DIFFERENCES (Audio/video, information and communication technology equipment – Part 1: Safety requirements)</p>			
Differences according to : CEI EN 62368-1:2016			
Attachment Form No. : IT_ND_IEC62368_1D			
Attachment Originator : IMQ S.p.A.			
Master Attachment : Date 2021-02-04			
Copyright © 2021 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			

	National Differences	P
F.1	<p>Italy</p> <p>The following requirements shall be fulfilled:</p> <ul style="list-style-type: none"> • The power consumption in Watts (W) shall be indicated on TV receivers and in their instruction for use (Measurement according to EN 60555-2). <p><i>Note: EN 60555-2 has since been replaced by IEC 60107-1:1997.</i></p> <ul style="list-style-type: none"> • TV receivers shall be provided with an instruction for use, schematic diagrams and adjustments procedure in Italian language. • Marking for controls and terminals shall be in Italian language. Abbreviation and international symbols are allowed provided that they are explained in the instruction for use. • The ECC manufacturers are bound to issue a conformity declaration according to the above requirements in the instruction manual. The correct statement for conformity to be written in the instruction manual, shall be: <p><i>Questo apparecchio è fabbricato nella CEE nel rispetto delle disposizioni del D.M. marzo 1992 ed è in particolare conforme alle prescrizioni dell'art. 1 dello stesso D.M.</i></p> <ul style="list-style-type: none"> • The first importers of TV receivers manufactured outside EEC are bound to submit the TV receivers for previous conformity certification to the Italian Post Ministry (PP.TT). The TV receivers shall have on the backcover the certification number in the following form: <p>D.M. 26/03/1992 xxxxx/xxxxx/S or T or pT S for stereo T for Teletext pT for retrofitable teletext</p> <p><i>Justification:</i> Ministerial Decree of 26 March 1992 : National rules for television receivers trade.</p> <p><i>NOTE/: Ministerial decree above contains additional, but not safety relevant requirements</i></p>	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
<p align="center">ATTACHMENT TO TEST REPORT IEC 62368-1 U.S.A. AND CANADA NATIONAL DIFFERENCES (Audio/video, information and communication technology equipment – Part 1: Safety requirements)</p>			
Differences according to : CSA/UL 62368-1:2014			
TRF template used : IECEE OD-2020-F3, Ed. 1.1			
Attachment Form No : US_CA_ND_IEC62368_1D			
Attachment Originator : UL(US)			
Master Attachment : Dated 2021-02-04			
Copyright © 2021 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			

IEC 62368-1 - US and Canada National Differences Special National Conditions based on Regulations and Other National Differences			
1.1	All equipment is to be designed to allow installation according to the National Electrical Code (NEC), ANSI/NFPA 70, the Canadian Electrical Code (CEC), Part I, CAN/CSA C22.1, and when applicable, the National Electrical Safety Code, IEEE C2. Also, for such equipment marked or otherwise identified, installation is allowed per the Standard for the Protection of Information Technology Equipment, ANSI/NFPA 75.		P
1.4	Additional requirements apply to some forms of power distribution equipment, including sub-assemblies.		P
4.1.17	For lengths exceeding 3.05 m, external interconnecting flexible cord and cable assemblies are required to be a suitable cable type (e.g., DP, CL2) specified in the NEC.		N/A
	For lengths 3.05 m or less, external interconnecting flexible cord and cable assemblies that are not types specified in the NEC generally are required to have special construction features and identification markings.		P
4.8	Lithium coin / button cell batteries have modified special construction and performance requirements.	Equipment for use in locations where it is unlikely that children will be present	N/A
5.6.3	Protective earthing conductors comply with the minimum conductor sizes in Table G.5, except as required by Table G.7ADV.1 for cord connected equipment, or Annex DVH for permanently connected equipment		P
5.7.7	Equipment intended to receive telecommunication ringing signals complies with a special touch current measurement tests.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
6.5.1	PS3 wiring outside a fire enclosure complies with single fault testing in B.4, or be current limited per one of the permitted methods.		N/A
Annex F (F.3.3.8)	Output terminals provided for supply of other equipment, except mains, supply are marked with a maximum rating or references to which equipment it is permitted to be connected.		N/A
Annex G (G.7.1)	Permanent connection of equipment to the mains supply by a power supply cord is not permitted, except for certain equipment, such as ATMs.		N/A
Annex G (G.7.3)	Power supply cords are required to have attachment plugs rated not less than 125 percent of the rated current of the equipment.		N/A
	Flexible power supply cords are required to be compatible with Article 400 of the NEC, and Tables 11 and 12 of the CEC.		P
Annex G (G.7.5)	Minimum cord length is required to be 1.5 m, with certain constructions such as external power supplies allowed to consider both input and output cord lengths into the requirement. Power supply cords are required to be no longer than 4.5 m in length if used in ITE Rooms.		P
Annex H.2	Continuous ringing signals under normal operating conditions up to 16 mA only are permitted if the equipment is subjected to special installation and performance restrictions.		N/A
Annex H.4	For circuits with other than ringing signals and with voltages exceeding 42.4 V _{peak} or 60 V d.c., the maximum acceptable current through a 2000 ohm resistor (or greater) connected across the voltage source with other loads disconnected is 7.1 mA peak or 30 mA d.c. under normal operating conditions.		N/A
Annex M	Battery packs for stationary applications comply with special component requirements.	No such application	N/A
Annex DVA (1)	Equipment intended for use in spaces used for environmental air are subjected to special flammability requirements for heat and visible smoke release.		N/A
	For ITE room applications, automated information storage systems with combustible media greater than 0.76 m ³ (27 cu ft) have a provision for connection of either automatic sprinklers or a gaseous agent extinguishing system with an extended discharge.	No such application	N/A
	Consumer products designed or intended primarily for children 12 years of age or younger are subject to additional requirements in accordance with U.S. & Canadian Regulations.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	Baby monitors additionally comply with ASTM F2951, Consumer Safety Specification for Baby Monitors.		N/A
Annex DVA (5.6.3)	For Pluggable Equipment Type A, the protection in the installation is assumed to be 20A.		N/A
Annex DVA (6.3)	The maximum quantity of flammable liquid stored in equipment complies with NFPA 30.		N/A
Annex DVA (6.4.8)	For ITE room applications, enclosures with combustible material measuring greater than 0.9 m ² (10 sq ft) or a single dimension greater than 1.8 m (6 ft) have a flame spread rating of 50 or less. For equipment with the same dimensions for other applications, an external surface that is not a fire enclosure requires a min. flammability classification of V-1.		N/A
Annex DVA (10.3.1)	Equipment with lasers meets the U.S. Code of Federal Regulations 21 CFR 1040 (and the Canadian Radiation Emitting Devices Act, REDR C1370).		N/A
Annex DVA (10.5.1)	Equipment that produces ionizing radiation complies with the U.S. Code of Federal Regulations, 21 CFR 1020 (and the Canadian Radiation Emitting Devices Act, REDR C1370).	No such radiation.	N/A
Annex DVA (F.3.3.3)	Equipment for use on a.c. mains supply systems with a neutral and more than one phase conductor (e.g. 120/240 V, 3-wire) require a special marking format for electrical ratings. Additional considerations apply for voltage ratings that exceed the attachment cap rating or are lower than the "Normal Operating Condition" in Table 2 of CAN/CSA C22.2 No. 235."		N/A
Annex DVA (F.3.3.5)	Equipment identified for ITE (computer) room installation is marked with the rated current		N/A
Annex DVA (G.1)	Vertically-mounted disconnect switches and circuit breakers have the "on" position indicated by the handle in the up position		N/A
Annex DVA (G.3.4)	Suitable NEC/CEC branch circuit protection rated at the maximum circuit rating is required for all standard supply outlets and receptacles (such as supplied in power distribution units) if the supply branch circuit protection is not suitable.		N/A
Annex DVA (G.4.2)	Equipment with isolated ground (earthing) receptacles complies with NEC 250.146(D) and CEC 10-112 and 10-906(8).		N/A
Annex DVA (G.4.3)	Where a fuse is used to provide Class 2 or Class 3 current limiting, it is not operator-accessible unless it is non- interchangeable.		N/A
Annex DVA (G.5.3)	Power distribution transformers distributing power at 100 volts or more, and rated 10 kVA or more, require special transformer overcurrent protection.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
Annex DVA (G.5.4)	Motor control devices are required for cord-connected equipment with a mains-connected motor if the equipment is rated more than 12 A, or if the equipment has a nominal voltage rating greater than 120 V, or if the motor is rated more than 1/3 hp (locked rotor current over 43 A).		N/A
Annex DVA (Annex M)	For ITE room applications, equipment with battery systems capable of supplying 750 VA for five minutes have a battery disconnect means that may be connected to the ITE room remote power-off circuit.		N/A
Annex DVA (Q)	Wiring terminals intended to supply Class 2 outputs according to the NEC or CEC Part 1 are marked with the voltage rating and "Class 2" or equivalent; marking is located adjacent to the terminals and visible during wiring.		N/A
Annex DVB (1)	Additional requirements apply for equipment used for entertainment purposes intended for installation in general patient care areas of health care facilities.		N/A
Annex DVC (1)	Additional requirements apply for equipment intended for mounting under kitchen cabinets.		N/A
Annex DVE (4.1.1)	Some equipment, components, sub-assemblies and materials associated with the risk of fire, electric shock, or personal injury have component or material ratings in accordance with the applicable national (U.S. and Canadian) component or material requirements. Components required to comply include: appliance couplers, attachment plugs, battery back-up systems, battery packs, circuit breakers, communication circuit accessories, connectors (used for current interruption of non-LPS circuits), power supply cords, direct plug-in equipment, electrochemical capacitor modules (energy storage modules with ultra-capacitors), enclosures (outdoor), flexible cords and cables, fuses (branch circuit), ground-fault current interrupters, interconnecting cables, data storage equipment, printed wiring, protectors for communications circuits, receptacles, surge protective devices, vehicle battery adapters, wire connectors, and wire and cables.		P
Annex DVH	Equipment for permanent connection to the mains supply is subjected to additional requirements.		N/A
Annex DVH (DVH.1)	Wiring methods (terminals, leads, etc.) used for the connection of the equipment to the mains are in accordance with the NEC/CEC.		N/A
Annex DVH (DVH.3.2)	Terminals for permanent wiring, including protective earthing terminals, are suitable for U.S./Canadian wire gauge sizes, rated 125 percent of the equipment rating, and are specially marked when specified.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
Annex DVH (DVH.3.2)	Wire binding screws are not permitted to attach conductors larger than 10 AWG (5.3 mm ²).		N/A
Annex DVH (DVH.4)	Permanently connected equipment is required to have a suitable wiring compartment and wire bending space.		N/A
Annex DVH (DVH 5.5)	Equipment connected to a centralized d.c. power system, and having one pole of the DC mains input terminal connected to the main protective earthing terminal in the equipment, complies with special earthing, wiring, marking and installation instruction requirements.		N/A
Annex DVI (6.7)	Equipment intended for connection to telecommunication network outside plant cable is required to be protected against overvoltage from power line crosses.		N/A
Annex DVJ (10.6.1)	Equipment connected to a telecommunication and cable distribution networks and supplied with an earphone intended to be held against, or in the ear is required to comply with special acoustic pressure requirements.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
<p align="center">ATTACHMENT TO TEST REPORT IEC 62368-1 (JAPAN) NATIONAL DIFFERENCES (Audio/video, information and communication technology equipment – Part 1: Safety requirements)</p>			
Differences according to: J62368-1 (2020)			
TRF template used: : IECEE OD-2020-F3, Ed. 1.1			
Attachment Form No.: JP_ND_IEC62368_1D			
Attachment Originator: UL (JP)			
Master Attachment: Date 2021-02-04			
Copyright © 2021 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			
	National Differences		—
4.1.2	Where the component, or a characteristic of a component, is a safeguard or a part of a safeguard, components shall comply with the requirements of this standard or, where specified in a requirements clause, with the safety aspects of the relevant JIS component standards or IEC component standards, or components shall have properties equivalent to or better than these.		P
5.6.1	Mains socket-outlet and appliance outlet shall comply with Clause G.4.2A if they are incorporated as part of the equipment.		P
5.6.2.1	Mains connection of class 0I equipment: Instructional safeguard in accordance with Clause F.3.6.1A; Mains plug having a lead wire for protective earthing connection of class 0I equipment; Independent main protective earthing terminal installed by ordinary person.		N/A
5.6.2.2	This requirement does not apply to internal conductor of the cord set that is covered by the sheath of mains cord and is formed together with mains plug and appliance connector.		P
5.6.3	In case of class 0I equipment using power supply cord having two conductors (no earthing conductor), the conductor of protective earthing lead wire shall comply with either of the following: – use of annealed copper wire with 1.6 mm diameter or corrosion-inhibiting metal wire having size and strength that are equivalent to or more than the above copper wire – single core cord or single core cable with 1.25 mm ² or more cross-sectional area		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.7.3	For class 0I equipment that is provided with mains socket-outlet in the configuration as specified in JIS C 8282 series or JIS C 8303, or otherwise being considered to comply with relevant regulations, or that is provided with mains appliance outlet as specified in JIS C 8283-2-2 for the purpose of interconnection, the measurement is conducted on the system of the interconnected equipment having a single connection to the mains.		N/A
5.7.4	In case of class 0I equipment, touch current shall not exceed 1.41 mA peak or for sinusoidal wave, 1.0 mA r.m.s. when measured using the network specified in Figure 4 of IEC 60990.		N/A
6.4.3.3	A fuse complying with JIS C 6575 series or a fuse having equivalent characteristics shall open within 1 s. For Class A fuse of JIS C 6575, replace "2.1 times" by "1.35 times" and in case of Class B fuse of JIS C 6575, replace "2.1 times" by "1.6 times". A fuse not complying with JIS C 6575 series shall be tested with the breaking capacity taken into account.		N/A
8.5.4.2.1	Only three-phase stationary equipment rated more than 200 V ac can be considered as being for use in locations where children are not likely to be present, when complying with Clause F.4.		N/A
8.5.4.2.2	For equipment installed where children may be present, an instructional safeguard shall be provided by easily understandable wording in accordance with Clause F.5, except that element 3 is optional.		N/A
8.5.4.2.4	The media destruction device is tested according to Clause V.1.2 with applicable jointed test probes to the opening. And then the wedge probe per Figure V.4 shall not contact any moving part.		N/A
8.5.4.2.5	The wedge probe of Figure V.4 and applicable jointed test probes specified in Clause V.1.2 shall not contact any moving part. Instructional safeguard shall not be used instead of equipment safeguard for preventing access to hazardous moving parts.		N/A
9.2.6, Table 38	Handles, Knobs, grips, etc. and external surfaces either held, touched or worn against the body in normal use (> 1 min) ^{b,c}	Noted	P
F.3.5.1	Instructional safeguard of class 0I equipment in accordance with Clause F.5 when a mains socket-outlet as specified in JIS C 8282 series, JIS C 8303 or relevant regulation to which class I equipment can be connected is provided in accordance with Clause G.4.2A except for the cases where the socket-outlet is accessible only to skilled persons.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
F.3.5.3	If the fuse is necessary for the safeguard function, the symbols indicating pre-arcing time-current characteristic.	Replaceable by only skilled person.	N/A
F.3.6.1A	Marking for class 0I equipment The requirements of Clauses F.3.6.1.1 and F.3.6.1.3 shall be applied to class 0I equipment. For class 0I equipment, a marking of instructions and instructional safeguard shall be provided regarding the earthing connection.		N/A
F.3.6.2.1	Symbols, IEC 60417-5172 (2003-02) or IEC 60417-6092 (2011-10), shall not be used for class I equipment or class 0I equipment.		N/A
F.4	Instruction for audio equipment with terminals classified as ES3 in accordance with Table E.1, and for other equipment with terminals marked in accordance with F.3.6.1 and F.3.6.1A. Installation instruction for the protective earthing connection for class 0I equipment provided with independent main protective earthing terminal, where the cord for the protective earthing connection is not provided within the package for the equipment.		N/A
G.3.2.1	The thermal link when tested as a separate component, shall comply with the requirements of JIS C 6691 or have properties equivalent to or better than that.		N/A
G.3.4	Except for devices covered by Clause G.3.5, overcurrent protective devices used as a safeguard shall comply with the relevant part of JIS C 6575 (corresponding to IEC60127) or shall have equivalent characteristics. If there are no applicable IEC standards, overcurrent protective devices used as a safeguard shall comply with their applicable IEC standards.		N/A
G.4.1	This requirement is not applicable to Clauses G.4.2 and G.4.2A.		P

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
G.4.2	<p>Mains connector shall comply with JIS C 8282 series, JIS C 8283 series, JIS C 8285, JIS C 8303 or IEC 60309 series.</p> <p>Mains plugs and socket-outlets shall comply with JIS C 8282 series, JIS C 8303, IEC 60309 series, or have equivalent or better performance.</p> <p>A power supply cord set provided with appliance connector that can fit appliance inlet complying with JIS C 8283-1 shall comply with JIS C 8286.</p> <p>Construction preventing mechanical stress not to transmit to the soldering part of inlet terminal.</p> <p>Consideration for an equipment rated not more than 125 V provided with Type C14 and C18 appliance coupler complying with JIS C 8283 series.</p>		N/A
G.4.2A	Mains socket-outlet and interconnection coupler provided with the class II, class I and class 0I equipment respectively.		P
G.7.1	A mains supply cord need not include the protective earthing conductor for class 0I equipment provided with independent protective earthing conductor.		N/A
G.8.3.3	Withstand $1,71 \times 1.1 \times U_0$ for 5 s.		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
ATTACHMENT TO TEST REPORT			
IEC 62368-1 (AUSTRALIA / NEW ZEALAND) NATIONAL DIFFERENCES (Audio/video, information and communication technology equipment)			
Differences according to AS/NZS 62368.1:2018			
TRF template used:..... IEC62368-1:2018, Ed. 1.2			
Attachment Form No. AU_NZ_ND_IEC62368_1D			
Attachment Originator..... JAS-ANZ			
Master Attachment 2023-11-14			
Copyright © 2023 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			
	National Differences		P
Appendix ZZ	Variations to IEC 62368-1:2014 (ED. 2.0) for Australia and New Zealand		P
ZZ1 Scope	This Appendix lists the normative variations to IEC 62368-1:2014 (ED. 2.0)		P
ZZ2 Variations	The following modifications are required for Australian/New Zealand conditions:		P
2	<p>Add the following to the list of normative references:</p> <p>The following normative documents are referenced in Appendix ZZ:</p> <p>-AS/NZS 3112, <i>Approval and test specification—Plugs and socket-outlets</i></p> <p>-AS/NZS 3123, <i>Approval and test specification—Plugs, socket-outlets and couplers for general industrial application</i></p> <p>-AS/NZS 3191, <i>Electric flexible cords</i></p> <p>-AS/NZS 60065, <i>Audio, video and similar electronic apparatus—Safety requirements (IEC 60065:2015 (ED.8.0) MOD)</i></p> <p>-AS/NZS 60320.1, <i>Appliance couplers for household and similar general purposes, Part 1: General requirements (IEC 60320-1, Ed.2.1 (2007) MOD)</i></p> <p>-AS/NZS 60320.2.2, <i>Appliance couplers for household and similar general purposes Part 2.2: Interconnection couplers for household and similar equipment (IEC 60320-2-2, Ed.2.0 (1998) MOD)</i></p> <p>-AS/NZS 60695.2.11, <i>Fire hazard testing, Part 2.11: Glowing/hot wire based test methods—Glow-wire flammability test method for end-products</i></p> <p>-AS/NZS 60695.11.5, <i>Fire hazard testing, Part 11.5: Test flames—Needle-flame test method—Apparatus, confirmatory test arrangement and guidance</i></p> <p>-AS/NZS 60695.11.10, <i>Fire hazard testing, Part 11.10: Test flames—50 W horizontal and vertical flame test methods</i></p> <p>-AS/NZS 60884.1, <i>Plugs and socket-outlets for</i></p>	Added.	P

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	<p><i>household and similar purposes,</i> <i>Part 1: General requirements</i> -AS/NZS 60950.1:2015, <i>Information technology equipment—Safety, Part 1: General requirements (IEC 60950-1, Ed.2.2 (2013), MOD)</i> IEC 61032:1997, <i>Protection of persons and equipment by enclosures—Probes for verification</i> -AS/NZS 61558.1:2008 (including Amendment 2:2015), <i>Safety of Power Transformers, Power Supplies, Reactors and Similar Products, Part 1: General requirements and tests (IEC 61558-1 Ed 2.1, MOD)</i> -AS/NZS 61558.2.16, <i>Safety of transformers, reactors, power supply units and similar products for voltages up to 1 100 V, Part 2.16: Particular requirements and tests for switch mode power supply units and transformers for switch mode power supply units.</i></p>		
4.1.1	<p>Application of requirements and acceptance of materials, components and subassemblies</p> <p>1 <i>Replace</i> the text 'IEC 60950-1' with 'AS/NZS 60950.1:2015'.</p> <p>2 <i>Replace</i> the text 'IEC 60065' with 'AS/NZS 60065'.</p>		N/A
4.7	Equipment for direct insertion into mains socket-outlets		N/A
4.7.2	<p>Requirements</p> <p><i>Delete</i> the text of the second paragraph and <i>replace</i> with the following: Equipment with a plug portion, suitable for insertion into a 10 A 3-pin flat-pin socket-outlet complying with AS/NZS 3112 shall comply with the requirements in AS/NZS 3112 for equipment with integral pins for insertion into socket-outlets.</p>	The equipment is not direct plug-in equipment.	N/A
4.7.3	<p>Compliance Criteria</p> <p><i>Delete</i> the first paragraph and Note 1 and Note 2 and <i>replace</i> with the following: <i>Compliance is checked by inspection and, if necessary, by the tests in AS/NZS 3112.</i></p>		N/A
4.8	<p><i>Delete</i> existing clause title and <i>replace</i> with the following: 4.8 Products containing coin/button cell batteries</p>		N/A
4.8.1	<p>General</p> <p>1 Second dashed point, <i>delete</i> the text and <i>replace</i> with the following: – include coin/button cell batteries with a diameter of 32 mm or less.</p> <p>2 After the second dashed point, <i>insert</i> the following Note: NOTE 1: Batteries are specified in IEC 60086-2.</p> <p>3 After the third dashed point, <i>renumber</i> the existing Note as 'NOTE 2'.</p> <p>4 Fifth dashed point, <i>delete</i> the word 'lithium'.</p>	No battery provided.	N/A

IEC62368_1D - ATTACHMENT					
Clause	Requirement + Test		Result - Remark		Verdict
4.8.2	Instructional Safeguard First line, <i>delete</i> the word 'lithium'.				N/A
4.8.3	Construction First line, after the word 'Equipment' <i>insert</i> the words 'containing one or more coin/button batteries and'				N/A
4.8.5	Compliance criteria <i>Delete</i> the first paragraph and <i>replace</i> with the following: <i>Compliance is checked by applying a force of 30 N +/- 1 N for 10 s to the battery compartment door/cover by a rigid test finger according to test probe 11 of IEC 61032:1997 at the most unfavourable place and in the most unfavourable direction. The force shall be applied in one direction at a time.</i>				N/A
5.4.10.2	Test methods				N/A
5.4.10.2.1	General <i>Delete</i> the first paragraph and <i>replace</i> with the following: In Australia only, the separation is checked by the test of both Clause 5.4.10.2.2 and Clause 5.4.10.2.3. In New Zealand, the separation is checked by the test of either Clause 5.4.10.2.2 or Clause 5.4.10.2.3.				N/A
Table 29	<i>Replace</i> the table with the following:				N/A
Parts		Impulse test		Steady state test	
		New Zealand	Australia	New Zealand	Australia
Parts indicated in Clause 5.4.10.1 a) ^a		2.5 kV 10/700 µs	7.0 kV for hand-held telephones and headsets, 2.5 kV for other equipment. 10/700 µs	1.5 kV	3 kV
Parts indicated in Clause 5.4.10.1 b) and c) ^b		1.5 kV 10/700 µs ^c		1.0 kV	1.5 kV
^a Surge suppressors shall not be removed. ^b Surge suppressors may be removed, provided that such devices pass the impulse test of Clause 5.4.10.2.2 when tested as components outside the equipment. ^c During this test, it is allowed for a surge suppressor to operate and for a sparkover to occur in a GDT.					
5.4.10.2.2	After the first paragraph, <i>insert</i> new Notes 201 and 202 as follows: NOTE 201 For Australia, the 7 kV impulse simulates lightning surges on typical rural and semi-rural network lines. NOTE 202 For Australia, the value of 2.5 kV for Clause 5.4.10.1 a) was chosen to ensure the adequacy of the insulation concerned and does not necessarily simulate likely overvoltages.				N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
5.4.10.2.3	After the first paragraph, <i>insert</i> new Notes 201 and 202 as follows: NOTE 201 For Australia, where there are capacitors across the insulation under test, it is recommended that d.c. test voltages are used. NOTE 202 The 3 kV and 1.5 kV values for Australia have been determined considering the low frequency induced voltages from the power supply distribution system.		N/A
6	Electrically-caused fire		P
6.1	General After the first paragraph, <i>insert</i> the following new paragraph: Alternatively, the requirements of Clauses 6.2 to 6.5.2 are considered to be fulfilled if the equipment complies with the requirements of Clause 6.202	Inserted.	P
6.6	After Clause 6.6, <i>add</i> the new Clauses 6.201 and 6.202 as follows: 6.201 External power supplies, docking stations and other similar devices and 6.202 Resistance to fire—Alternative tests (see special national conditions)		P
8.5.4	Special categories of equipment comprising moving parts		N/A
8.5.4.1	Large data storage equipment In the first dashed row and the second dashed rows <i>replace</i> 'IEC 60950-1:2005' with 'AS/NZS 60950.1:2015'.		N/A
8.6	Stability of equipment		N/A
8.6.1 and Table 36	Requirements 1. Table 36, <i>insert</i> Footnote c at the end of the 'Glass slide' heading, and <i>add</i> a new Footnote c after the text of Footnote b in the last row of Table 36 as follows: c The glass slide test is not applicable to floor standing equipment, even though the equipment may have controls or a display. 2. Table 36, fifth row, <i>insert</i> ²⁰¹ at the end of 'No stability requirements' 3. Table 36, ninth row, <i>insert</i> ²⁰¹ at the end of 'No stability requirements' 4. Table 36, <i>add</i> the following new footnote: 201 MS2 and MS3 television sets and display devices, designed only for fixing to a wall, ceiling or equipment rack, are not subjected to stability requirements only if the instructional safeguard of Clause 8.6.1.201 is provided. Otherwise, the glass slide requirements of Clause 8.6.4 and horizontal force requirements of Clause 8.6.5 apply. 5. Second paragraph beneath Table 36, <i>delete</i> the words 'MS2 and MS3 television sets' and <i>replace</i> with 'MS2 and MS3 television sets and display devices'		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
8.6.1	After Clause 8.6.1 <i>add</i> the following new clauses: 8.6.1.201 Instructional safeguard for fixed-mount television sets (see special national conditions)		N/A
Annex F Paragraph F.3.5.1	Mains appliance outlet and socket-outlet markings <i>Replace</i> 'IEC 60320-2-2' with 'AS/NZS 60320.2.2'.		N/A
Annex G Paragraph G.4.2	Mains connectors 1 In the second line <i>insert</i> 'or AS/NZS 3123' after 'IEC 60906-1'. 2 In the second line <i>insert</i> 'or AS/NZS 60320 series' after 'IEC 60320 series' 3 <i>Add</i> the following new paragraph: 10 A or 15 A 250 V flat pin plugs for the connection of equipment to mains-powered socket-outlets for household or similar general use shall comply with AS/NZS 3112 or AS/NZS 60884.1.		N/A
Paragraph G.5.3.1	Transformers, General 1 In the third dashed point <i>replace</i> 'IEC 61558-1 and the relevant parts of IEC 61558-2' with 'AS/NZS 61558-1 and the relevant parts of AS/NZS 61558.2' 2 In the fourth dashed point <i>replace</i> 'IEC 61558-2-16' with 'AS/NZS 61558.2.16'.		N/A
Paragraph G.7.1	Mains supply cords, General In the fourth dashed paragraph, <i>replace</i> 'IEC 60320-1' with 'AS/NZS 60320.1'		N/A
Table G.5	Sizes of conductors 1 In the second row, first column, <i>delete</i> '6' and <i>replace</i> with '7.5' 2 In the second row, second column, <i>delete</i> '0,75' and <i>replace</i> with '0.75 ^b ' 3 <i>Delete</i> Note 1. 4 <i>Replace</i> 'NOTE 2' with 'NOTE:'. 5 <i>Delete</i> the text of 'Footnote b' and <i>replace</i> with the following: ^b This nominal cross-sectional area is only allowed for Class II appliances if the length of the power supply cord, measured between the point where the cord, or cord guard, enters the appliance, and the entry to the plug does not exceed 2 m (0.5 mm ² three-core supply flexible cords are not permitted; see AS/NZS 3191). 6 In Footnote c <i>replace</i> 'IEC 60320-1' with 'AS/NZS 60320.1' 7 In Footnote d <i>replace</i> 'IEC 60320-1' with 'AS/NZS 60320.1'	No power supply cord provided.	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
Annex M Paragraph M.3.2	Protection circuits for batteries provided within the equipment, Test method After the first dashed point <i>add</i> the following Note: NOTE 201: In cases where the voltage source is provided by power from an unassociated power source, consideration should be given to the effects of possible single fault conditions in the unassociated equipment. If the power source is unknown then it should be assumed that the maximum limit of SELV may be applied to the source input under assumed single fault conditions in the source when assessing the charging circuit in the equipment under test.	No Battery provided.	N/A
	Special national conditions (if any)		P
6.201	External power supplies, docking stations and other similar devices For external power supplies, docking stations and other similar devices, during and after abnormal operating conditions and during single fault conditions the output voltage— – at all ES1 outlets or connectors shall not increase by more than 10% of its rated output voltage under normal operating condition; and – of a USB outlet or connector shall not increase by more than 3 V or 10% of its rated output voltage under normal operating conditions, whichever is higher. For equipment with multiple rated output voltages, the requirements apply with the equipment configured for each rated output voltage in turn. NOTE: This is intended to reduce the possibility of battery fire or explosion in attached equipment or accessories when charging secondary lithium batteries. <i>Compliance shall be checked by measurement, taking into account the abnormal operating conditions of Annex B.3 and the simulated single-fault conditions of Annex B.4</i>	The output voltage is not increased by more than 10% after abnormal operating conditions and during single fault conditions.	P
6.202	Resistance to fire—Alternative tests		N/A
6.202.1	General Parts of non-metallic material shall be resistant to ignition and spread of fire. This requirement does not apply to decorative trims, knobs and other parts unlikely to be ignited or to propagate flames from inside the equipment, or the following: a) Components that are contained in an enclosure having a flammability category of V-0 according to AS/NZS 60695.11.10 and having openings only for the connecting wires filling the openings completely, and for ventilation not exceeding 1 mm in width regardless of length. b) The following parts which would contribute		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	<p>negligible fuel to a fire:</p> <ul style="list-style-type: none"> – small mechanical parts, the mass of which does not exceed 4 g, such as mounting parts, gears, cams, belts and bearings; – small electrical components, such as capacitors with a volume not exceeding 1 750 mm³, integrated circuits, transistors and optocoupler packages, if these components are mounted on material of flammability category V-1, or better, according to AS/NZS 60695.11.10. <p>NOTE: In considering how to minimize propagation of fire and what 'small parts' are, account should be taken of the cumulative effect of small parts adjacent to each other for the possible effect of propagating the fire from one part to another.</p>		
	<p><i>Compliance shall be checked by the tests of Clauses 6.202.2, 6.202.3 and 6.202.4.</i></p> <p>For the base material of printed boards, compliance shall be checked by the test of Clause 6.202.5.</p> <p>The tests shall be carried out on parts of non-metallic material which have been removed from the equipment. When the glow-wire test is carried out, the parts shall be placed in the same orientation as they would be in normal use. These tests are not carried out on internal wiring.</p>		N/A
6.202.2	<p>Testing of non-metallic materials</p> <p>Parts of non-metallic material shall be subject to the glow-wire test of AS/NZS 60695.2.11 which shall be carried out at 550°C.</p> <p>Parts for which the glow-wire test cannot be carried out, such as those made of soft or foamy material, shall meet the requirements specified in ISO 9772 for category FH-3 material. The glow-wire test shall be not carried out on parts of material classified at least FH-3 according to ISO 9772 provided that the relevant part is not thinner than the sample tested.</p>		N/A
6.202.3	<p>Testing of insulating materials</p> <p>Parts of insulating material supporting Potential Ignition Sources shall be subject to the glow-wire test of AS/NZS 60695.2.11 which shall be carried out at 750°C.</p> <p>The test shall be also carried out on other parts of insulating material which are within a distance of 3 mm of the connection.</p> <p>NOTE: Contacts in components such as switch contacts are considered to be connections</p>		N/A
	<p>For parts which withstand the glow-wire test but produce a flame, other parts above the connection within the envelope of a vertical cylinder having a diameter of 20 mm and a height of 50 mm shall be subjected to the needle-flame test.</p> <p>However, parts shielded by a barrier which meets the needle-flame test need not be tested</p>		N/A

IEC62368_1D - ATTACHMENT				
Clause	Requirement + Test		Result - Remark	Verdict
	The needle-flame test shall be made in accordance with AS/NZS 60695.11.5 with the following modifications:			N/A
	Clause of AS/NZS 60695.11.5	Change		
	9 Test procedure			
	9.2 Application of needle-flame	<i>Delete</i> the first and second paragraphs and <i>replace</i> with the following: The specimen shall be arranged so that the flame can be applied to a vertical or horizontal edge as shown in the examples of Figure 1. If possible the flame shall be applied at least 10 mm from a corner. The duration of application of the test flame shall be 30 s □ 1 s.		
	9.3 Number of test specimens	<i>Replace</i> with the following: The test shall be made on one specimen. If the specimen does not withstand the test, the test may be repeated on two further specimens, both of which shall withstand the test.		
	11 Evaluation of test results	<i>Replace</i> with the following: The duration of burning (tb) shall not exceed 30 s. However, for printed circuit boards, it shall not exceed 15 s.		
	The needle-flame test shall not be carried out on parts of material classified as V-0 or V-1 according to AS/NZS 60695.11.10, provided that the relevant part is not thinner than the sample tested.			
6.202.4	Testing in the event of non-extinguishing			N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	<p>material</p> <p>If parts, other than enclosures, do not withstand the glow wire tests of Clause 6.202.3, by failure to extinguish within 30 s after the removal of the glowwire tip, the needle-flame test detailed in Clause 6.202.3 shall be made on all parts of non-metallic material which are within a distance of 50 mm or which are likely to be impinged upon by flame during the tests of Clause 6.202.3. Parts shielded by a separate barrier which meets the needle-flame test need not be tested.</p> <p>NOTE 1: If the enclosure does not withstand the glow-wire test the equipment is considered to have failed to meet the requirements of Clause 6.202 without the need for consequential testing.</p> <p>NOTE 2: If other parts do not withstand the glow-wire test due to ignition of the tissue paper and if this indicates that burning or glowing particles can fall onto an external surface underneath the equipment, the equipment is considered to have failed to meet the requirements of Clause 6.202 without the need for consequential testing.</p> <p>NOTE 3: Parts likely to be impinged upon by the flame are considered to be those within the envelope of a vertical cylinder having a radius of 10 mm and a height equal to the height of the flame, positioned above the point of the material supporting, in contact with, or in close proximity to, connections.</p>		
6.202.5	<p>Testing of printed boards</p> <p>The base material of printed boards shall be subjected to the needle-flame test of Clause 6.202.3. The flame shall be applied to the edge of the board where the heat sink effect is lowest when the board is positioned as in normal use. The flame shall not be applied to an edge, consisting of broken perforations, unless the edge is less than 3 mm from a potential ignition source.</p> <p>The test is not carried out if—</p> <ul style="list-style-type: none"> – the printed board does not carry any potential ignition source; – the base material of printed boards, on which the available apparent power at a connection exceeds 15 VA operating at a voltage exceeding 50 V and equal or less than 400 V (peak) a.c. or d.c. under normal operating conditions, is of flammability category V-1 or better according to AS/NZS 60695.11.10, or the printed boards are protected by an enclosure meeting the flammability category V-0 according to AS/NZS 60695.11.10, or made of metal, having openings only for connecting wires which fill the openings completely; or – the base material of printed boards, on which the available equipment power at a connection exceeds 15 VA operating at a voltage exceeding 400 V (peak) a.c. or d.c. under normal operating conditions, and base material of printed boards 		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	<p>supporting spark gaps which provides protection against overvoltages, is of flammability category V-0 according to AS/NZS 60695.11.10 or the printed boards are contained in a metal enclosure, having openings only for connecting wires which fill the openings completely.</p> <p><i>Conformance shall be determined using the smallest thickness of the material.</i></p> <p>NOTE: Available apparent power is the maximum apparent power which can be drawn from the supplying circuit through a resistive load whose value is chosen to maximize the apparent power for more than 2 min when the circuit supplied is disconnected.</p>		
6.202.6	<p>For open circuit voltages greater than 4 kV</p> <p>Potential ignition sources with open circuit voltages exceeding 4 kV (peak) a.c. or d.c. under normal operating conditions shall be contained in a FIRE ENCLOSURE which shall comply with flammability category V-1 or better according to AS/NZS 60695.11.10.</p>		N/A
8.6.1.201	<p>8.6.1.201 Instructional safeguard for fixed-mount television sets</p> <p>MS2 and MS3 television sets and display devices designed only for fixed mounting to a wall of ceiling or equipment rack shall, where required in Table 36, footnote 201, have an instructional safeguard in accordance with Clause F.5 which may be on the equipment or included in the installation instructions or equivalent document accompanying the equipment.</p> <p>The elements of the instructional safeguard shall be as follows:</p> <ul style="list-style-type: none"> – element 1a: not available; – element 2: 'Stability Hazard' or equivalent wording; – element 3: 'The television set may fall, causing serious personal injury or death' or equivalent text; – element 4: the following or equivalent text: To prevent injury, this television set must be securely attached to the floor/wall in accordance with the installation instructions 		N/A
8.6.1.202	<p>Restraining device</p> <p>MS2 and MS3 television sets and display devices that are not solely fixed-mounted should be provided with a restraining device such as a fixing point to facilitate restraining the equipment from toppling forward. The restraining device shall be capable of withstanding a pull of 100 N in all directions without damage.</p> <p>Where a restraining device is provided, instructions shall be provided in the instructions for installation or instructions for use to ensure correct and safe installation.</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
<p align="center">ATTACHMENT TO TEST REPORT AS_NZS_3112:2017 +A1:2021 Appendix J AUSTRALIAN / NEW ZEALAND NATIONAL DIFFERENCES (Approval and test specification—Plugs and socket-outlets)</p>			
Differences according to..... : AS_NZS_3112:2017_Amendment 1:2021_Appendix J			
TRF template used:..... : IEC EE OD-2020-F3, Ed. 1.1			
Attachment Form No. : AS_NZS_3112:2017_Appendix J			
Attachment Originator JAS-ANZ			
Master Attachment..... : 2021-11			
Copyright © 2020 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.			
NOTE	This TRF only relates to Appendix J requirements		N/A
	National Differences		N/A
	APPENDIX J INTEGRAL OR DETACHABLE PLUG PORTIONS OF EQUIPMENT FOR INSERTION INTO SOCKET-OUTLETS		N/A
J1 SCOPE	<p>General: This Appendix specifies additional dimensional and constructional requirements for detachable plug portions, or equipment incorporating integral supply pins or equipment incorporating detachable plug portions.</p> <p>This Appendix shall be read in conjunction with Section 2 of this Standard.</p> <p>For the purposes of this Appendix, where the term 'plug' is used in Section 2 it shall be taken to mean the plug portion of equipment or the detachable plug portion.</p> <p>The equipment shall comply with the relevant product Standard. The tests and requirements specified in this Appendix are in addition to any test and requirements of the relevant product Standard for the equipment. (AS/NZS 3112:2017/A1:2021)</p>		N/A
J2	DEFINITION		N/A
J2.1	<p>Detachable plug portion</p> <p>A plug portion that is detachable from the equipment and with connections including the following standardized outputs and other contacts</p> <p>(a) Type A (see Figure J1):</p> <p>A detachable plug portion with a connection intended for plugging directly into equipment. The connection being via the equipment group 1 appliance inlet within the scope of AS/NZS 60320.1.</p> <p>(b) Type B (see Figure J2):</p> <p>A detachable plug portion with a non-standardized connection intended for plugging directly into equipment</p> <p>(c) Type C (see Figure J3):</p> <p>A detachable plug portion with a connection intended for use with an adaptor connected to a flexible cord so as to replicate a supply plug and flexible cord configuration. The connection being via a group 1 appliance outlet within scope of AS/NZS 60320.2.2, which is integral with the plug portion (AS/NZS 3112:2017)</p>		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
J2.2	Integral plug portion A plug portion that is integral to the equipment enclosure and is not detachable (AS/NZS 3112:2017)		N/A
J2.3	Plug portion A plug portion is that portion of equipment with pins for insertion into a socket-outlet, including the plug pins, terminals of the plug pins, external dimensions of the 'maximum projection' and any connections of a detachable plug portion. (AS/NZS 3112:2017/A1:2021)		N/A

J3	REQUIREMENTS FOR THE PLUG PORTION	N/A
-----------	--	-----

J3.1	General The following provisions apply to the dimensional and constructional requirements of plug portions of equipment and any detachable connection between the plug portion and the equipment:		N/A
(a)	For detachable plug portions intended for connection to the equipment in multiple orientations, the relevant tests are performed in the most onerous orientation.		N/A
(b)	For Type A detachable plug portion, the relevant requirements of AS/NZS 3105:2014 are applicable, in addition to conformance with relevant clauses of this Appendix		N/A
(c)	For Type B detachable plug portions, the conformance is shown by the relevant clauses of this Appendix.		N/A
(d)	For Type C detachable plug portions, conformance is shown by assessment to Section 2 of this Standard (plugs) and relevant clauses of this Appendix (AS/NZS 3112:2017)		N/A

J3.2	Plug pins of plug portions The requirements of Clause 2.2 are applicable for plug pins.	N/A
------	---	-----

2.2	PLUG PINS		N/A
2.2.1	Current carrying parts of plug pins of metal having sufficient mechanical strength, electrical conductivity and resistance to corrosion adequate for the intended use	Not provided, shall be checked before national approval.	N/A
	Plug pin material?		
2.2.2	Pins that may become detached from plug yet remain attached to cord conductors; not possible		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	for plug to be assembled with any pin located in a position other than that intended		
	Plug made of resilient insulating material; pins and terminals held securely in position (AS/NZS 3112:2017)		N/A

2.2.3	Plug pins adequately proportioned throughout and portion adjacent to the connection designed to not introduce a stress concentration which may lead to a fracture of the pin, and suitably shaped to prevent abrasion or cutting of conductor strands due to flexure in normal use		N/A
	Exposed ends of plug pins have a lead-in, bevel or radius to facilitate entry into socket-outlets and to operate shutters		N/A
	Round pins have a semi-circular end profile		N/A
	Flat-pins with the following profile are deemed to comply:		--
(a)	Flat-pins with a radius on the end with side bevels may have a width and thickness profile as specified in Figure 2.1(h)		N/A
(b)	Flat-pins square on the end with corner and side bevels may have a width and thickness profile as specified in Figure 2.1(i)		N/A
(c)	Flat-pins square on the end with corner bevels and a radius on the sides may have a width and thickness profile as specified in Figure 2.1(j)		N/A
	Contact portion of the pins smooth and free from openings or indentations		N/A
	Flat pin plugs having a longitudinal seam or opening in the contact portion of one face; width not exceeding 0.3 mm and		N/A
	Thickness not exceeding 1.58 mm		N/A
	Exposed portion of earthing pins and pins other than insulated pins free from any non-metallic coverings or coatings (AS/NZS 3112:2017)		N/A
2.2.4	Live parts of insulated pin plugs not exposed when plug is partially or fully engaged with associated socket		N/A
	Compliance by measurement to Figure 2.4	(see appended table)	N/A
	Lacquer, enamel or sprayed insulating coating not considered to be insulation material		N/A
	All live pins on low voltage plugs except for those shown in Figure 2.1 (a2), (b) and (g) of the insulated pin type		N/A
	Colour green or green / yellow not used for insulation of insulated pins		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	(AS/NZS 3112:2017)		

J3.3	Ratings and dimensions for low-voltage plug portions Requirements of clauses 2.8.1 and 2.8.4 apply for rating and dimensions	N/A
------	--	-----

2.8	Ratings and Dimensions of Low Voltage Plugs		N/A
2.8.1	Low voltage flat-pin plugs and low voltage plugs having one round earth pin and two flat pins or two round live pins and one flat earth pin, having ratings up to and including 20A; compliance with Figure 2.1	(see appended results)	N/A
	Rating of plug	___A	N/A
	Nominal dimensions covering disposition of pins checked by gauge of Appendix A		N/A
	Distance between live pin and edge of moulding to not less than 9 mm		N/A
	Measured distance	___mm	N/A
	No point on plug face protrudes more than 0.5 mm		N/A
	Measured protrusion	___mm	N/A
	Dimensional requirements of Figure 2.1(e2) did not applied to plugs with greater than three pins (AS/NZS 3112:2017)		N/A
2.8.4	Low voltage plugs comply with dimensions of Figure 2.1	(see appended table 2.8.1)	N/A
	Disposition of pins checked by gauge complying with Appendix A, B or F as appropriate		N/A
	Low voltage plug having rating up to 15A and of the Figure 2.1 (a1), (c), (d), (f) or (g) type; comply with dimensional requirements of Figure 2.1 (e1 and e2)		N/A
	20A plug of Figure 2.1(a2) type complies with dimensional requirements of Figure 2.1 (e2)		N/A
	Plugs with insulated pins need not comply with dimension $R20.0 \pm 1$ mm requirement of Figure 2.1 (e3) provided there is at least 9mm from the edge of the live pins to the edge of the plug face Figure 2.1(e3). (AS/NZS 3112:2017)		N/A

J3.4	Internal connections for plug portions Requirements of clause 2.9 apply for internal connections; unless requirements contained in the relevant product standard (AS/NZS 3112:2017)	N/A
------	--	-----

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
2.9	INTERNAL CONNECTIONS		N/A
	Plug provided with earthing connections designed and constructed so that when plug is correctly wired and assembled:		N/A
(a)	Loose terminal screw or conductive material cannot bridge any live or earthed parts		N/A
(b)	Earthing parts effectively isolated from contact with live conductor which may become detached		N/A
(c)	Live parts effectively isolated from contact with any earthing conductor which may become detached		N/A
	Any connections for auxiliary devices comply with above requirements (AS/NZS 3112:2017)		N/A

J3.5	Arrangement of earthing connections for plug portions Requirements of clause 2.10 apply for arrangement of earthing connections	N/A
------	--	-----

2.10	Arrangement of earthing connections		N/A
	Earthing pin radial to the circle embracing the pins (AS/NZS 3112:2017)		N/A

J3.6	Configuration of plug portions Requirements of clause 2.12.6 apply for configuration of the plug portion (AS/NZS 3112:2017)	N/A
------	--	-----

2.12	Marking		N/A
2.12.6	Configuration of plugs		N/A
	Pins disposed so that configuration, as viewed from the pins, is earth, neutral and active in a clockwise direction		N/A
	Where there is no earthing pin; live pins conform to this configuration (AS/NZS 3112:2017)		N/A

J4	Tests	N/A
----	--------------	-----

J4.1	General Plug portions of equipment shall be subjected to the following tests and unless stated otherwise, shall comply with the requirements specified in Section 2 for each	N/A
------	---	-----

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	<p>test. The number of test samples shall be in accordance with Table J1</p> <p>For equipment with a detachable plug portion, the assessment(s) of Table J1 _tests 2, 3, 5, 10 and 11 shall be conducted on the—</p> <p>(a) assembled equipment with the detachable plug portion connected; and</p> <p>(b) the detachable plug portion after it has been separated from the equipment</p> <p>(AS/NZS 3112:2017/A1:2021)</p>		

J4.2	<p>High voltage test</p> <p>The requirements of Clause 2.13.3 are applicable unless requirements are contained in the relevant product standard</p> <p>(AS/NZS 3112:2017)</p>	N/A
------	--	-----

2.13.3	Test No.1 - High voltage test	N/A
	<p>Plug withstands without failure electric strength test as specified</p> <p>(AS/NZS 3112:2017)</p>	(see appended table) N/A

J4.3	Mechanical strength	N/A
J4.3.1	<p>Tumbling barrel test</p> <p>-The tumbling barrel test is applied to determine the mechanical strength of the plug portions and equipment having integral or detachable plug portions.</p> <p>For equipment with a detachable plug portion, the detachable plug portion may become detached during the test. If this occurs the detachable plug portion shall be reassembled with the equipment when the pins are straightened as per (a) and (b) below.</p> <p>Three samples that have not been subjected to any previous test are tested to the requirements of Clause 2.13.7.1, however the test is modified as follows:</p>	N/A
	<p>A sample is dropped—</p> <p>(a) 500 times if the mass of the specimen does not exceed 250 g.</p> <p>The pins being straightened after each 100 drops and at the completion of the test to pass through the appropriate gauge of Figure A1, Figure B1 or Figure F1; and</p> <p>(b) 250 times if the mass of the specimen exceeds 250 g. The pins being straightened after each 25 drops and at the completion of the test to pass through the appropriate gauge of Figures A1, Figure B1 or Figure F1.</p> <p>(AS/NZS 3112:2017/A1:2021)</p>	N/A

2.13.7.1	Test No.2 – Tumbling barrel test	N/A
	Three plugs tested as specified in tumbling barrel	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	as specified		
	Mass of sample	grams	N/A
	Number of drops	500 / 250	N/A
	After the test, samples show no damage and in particular:		N/A
(a)	Live parts not exposed to the standard test finger		N/A
(b)	Earth pin resistance complies with clause 3.14.7; resistance not exceeding 0.1 Ω		N/A
	Measured earth pin resistance	___ Ω	N/A
(c)	Functions affecting safety not impaired		N/A
(d)	No live part detached or loosened		N/A
(e)	Pins not broken or showing signs of cracking (AS/NZS 3112:2017)		N/A

J4.3.2	Test No.3 Impact test. Plug portions and equipment having integral plug portions or detachable plug portions shall withstand lateral impact forces. All samples that were subjected to the tests in Paragraph J4.3.1 shall be tested as follows:		N/A
	(a) The sample shall be positioned at the centre of a steel plate with a thickness of at least 6 mm. Apertures in the steel plate for the plug pins to pass through shall conform to the corresponding socket Standard. The sample shall be held against the steel plate by clamping all the pins.		N/A
	(b) Samples shall be subjected to blows, with an impact energy of 1.0 ± 0.05 J by any means having the same performance as the spring-operated impact-test apparatus of AS/NZS 3100.		N/A
	(c) Three blows shall be applied to every point that is most likely to directly or indirectly stress the enclosure joints of the sample		N/A
	Compliance shall be checked by Paragraph J4.3.3		N/A

J4.3.3	Specific compliance criteria This Paragraph provides the common compliance assessment criteria for tests specified in Paragraphs J4.3.1 and J4.3.2 .		N/A
	For equipment with an integral plug portion, the assessment(s) shall be made on the complete equipment.		N/A
	For equipment with a detachable plug portion, the assessment(s) shall be conducted on the—		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	(a) assembled equipment with the detachable plug portion connected; and (b) the detachable plug portion after it has been separated from the equipment		
	Following each test the samples shall comply with Clause 2.13.7.1		N/A
	(a) assembled equipment with the detachable plug portion connected;		N/A
	(a) Live parts shall not have become exposed to the standard test finger.		N/A
	(b) For earth pins, the resistance of the plug/socket-outlet circuit shall be such that conformance with Clause 3.14.7 is maintained The resistance shall not exceed 0.1 Ω.	___ Ω.	N/A
	(c) Any other function affecting safety shall not be impaired		N/A
	(d) No live part shall have become detached or loosened, to the extent that a hazardous situation is created		N/A
	The sample shall conform to the 'Guarding of live parts' requirements of AS/NZS 3100:2015 cl 5.1.		N/A
	Following each test, no internal conductive material or conductive part shall have become detached or loosened, to the extent that it creates a hazardous situation. The sample shall conform to the 'Separation of live parts from non-current-carrying conductive parts' requirements of AS/NZS 3100. <i>NOTE Specific attention is drawn to the separation of any live parts to exposed metal parts or low voltage to extra low voltage parts.</i>		N/A
	(e) The pins shall be inspected with normal, or corrected to normal, vision. Insulation may be removed if necessary. Pins shall not be broken or show cracking.		N/A
	(b) the detachable plug portion after it has been separated from the equipment.		N/A
	(a) Live parts shall not have become exposed to the standard test finger.		N/A
	(b) For earth pins, the resistance of the plug/socket-outlet circuit shall be such that conformance with Clause 3.14.7 is maintained The resistance shall not exceed 0.1 Ω.	___ Ω.	N/A
	(c) Any other function affecting safety shall not be impaired		N/A
	(d) No live part shall have become detached or loosened, to the extent that a hazardous situation is created		N/A
	(e) The pins shall be inspected with normal, or corrected to normal, vision. Insulation may be		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	removed if necessary. Pins shall not be broken or show cracking.		
	The sample shall conform to the 'Guarding of live parts' requirements of AS/NZS 3100:2015 cl 5.1.		N/A
	<p>Following each test, no internal conductive material or conductive part shall have become detached or loosened, to the extent that it creates a hazardous situation. The sample shall conform to the 'Separation of live parts from non-current-carrying conductive parts' requirements of AS/NZS 3100.</p> <p><i>NOTE Specific attention is drawn to the separation of any live parts to exposed metal parts or low voltage to extra low voltage parts.</i></p> <p>(AS/NZS 3112:2017/A1:2021)</p>		N/A

J4.3.4	Pin bending test The pins of the plug portion of three samples not subjected to any previous tests shall be tested for compliance with the pin bending test of Clause 2.13.7.2 (AS/NZS 3112:2017/A1:2021)	N/A
--------	--	-----

2.13.7.2	Test No.4 – Pin bending test	N/A
	All flat-pin plugs rated up to and including 15 A shall be subjected to the pin bending test	N/A
	Three samples are subjected by clamping the plug in a rigid holding block and applying the bending force as specified	N/A
	After the test the pins shall not be broken off. (AS/NZS 3112:2017)	N/A

J4.8.3	Test No.5 Plug portion detachment requirements	N/A
	For all Type B or C devices and for Type A devices where the outlet of the detachable plug portion is parallel to the plug supply pins, disengagement of the detachable plug portion from the equipment shall require at least two simultaneous independent actions or the use of a tool.	N/A
	Disengagement of the detachable plug portion requires two simultaneous independent actions, or	N/A
	The plug portion and the equipment/adaptor shall be connected and disconnected 50 times (100 strokes).	N/A
	Compliance is verified by inspection and the plugging test.	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	During the test plug portion was not separated		N/A
	The test of AS/NZS 3112 'temperature rise test' for plugs shall be conducted immediately after the above test without disturbing the sample. (AS/NZS 3112:2017/A1:2021)		N/A

J4.4	Temperature rise test The relevant requirements of Clause 2.13.8 are applicable for the temperature rise test, except that the test current shall be that specified in the relevant product standard		N/A
	The temperature rise of the pins shall not exceed 45 K irrespective of the temperature rise of parts specified in end-product standards.		N/A
	For detachable plug portions the temperature rise of terminals and contacts shall not exceed 45 K. (AS/NZS 3112:2017)		N/A

2.13.8	Test No.6 – Temperature rise test		N/A
(a)	Non-rewireable plugs tested as delivered with minimum cross-sectional area of conductor size for each respective current rating		N/A
(b)	Rewireable plugs fitted with PVC flexible cords having minimum cross-sectional area specified in manufacturer's instructions		N/A
	Terminal screws or nuts tightened with torque equal to two-thirds of value specified in Table 2.2.		N/A
	Conductors have length of at least 1 m		N/A
	Plug tested in draught free environment as specified using clamping units as specified in Figure 2.10		N/A
	Plug fitted with cord and inserted into socket-outlet as specified		N/A
	Test Current		N/A
	Temperature of terminals and contacts of detachable plug portion not exceeding 45 K (AS/NZS 3112:2017)	(see appended table)	N/A

J4.5	Securement of pins of the plug portion The requirements of Clause 2.13.9 are applicable for the securement of pins. (AS/NZS 3112:2017)		N/A
------	---	--	-----

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
2.13.9	Test No.7. Securement of pins		N/A
2.13.9.1	Movement of pins		N/A
	Plug pins clamped 5 ± 0.5 mm from pin face; test equipment and sample pre-conditioning for 1 h at $40 \pm 1^\circ\text{C}$		N/A
	Force of 18 ± 1 N applied to pin 14 ± 0.5 mm from plug face; applied gradually over 10 s and maintained for 10 s; applied in four directions		N/A
	Maximum deflection during test not exceeding 2.0 mm	(see appended results)	N/A
	Any distortion 5 minutes after test does not prevent insertion of plug into standard gauge(s) (AS/NZS 3112:2017 + A1:2021)		N/A
2.13.9.2	Fixing of pins		N/A
	Plug heated to $50 \pm 2^\circ\text{C}$ for 1h		N/A
	Force of 60 ± 0.6 N applied to each pin over 10 s and maintained for 10 minutes; applied in two directions along length of pin		N/A
	Maximum displacement during test not exceeding 2.4 mm		N/A
	Maximum measured displacement		N/A
	Pin returns to within 0.8 mm of nominal length within 5 minutes of removal of test force (AS/NZS 3112:2017)		N/A

J4.6	Tests on the insulation material of insulated pin-plug portions The requirements of Clause 2.13.13 are applicable for insulating material of insulated plug pins. (AS/NZS 3112:2017)	N/A
------	---	-----

2.13.13	Test No.8 Tests for insulation material of insulated pin plugs		N/A
2.13.13.1	Material of pin-insulation resistant to stresses at temperature likely to occur		N/A
2.13.13.2	Pressure test at high temperature		N/A
	Specimen tested as per Figure 2.5 with force of 2.5 N applied as specified; maintained for 2 h at $160 \pm 5^\circ\text{C}$; removed and cooled by immersion in water within 10 s		N/A
	Thickness of insulation at point of impression not reduced by more than 50%		N/A
	Initial thickness	mm	N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	Thickness after test	mm	N/A
	No visible cracks on insulation material		N/A
	Dimension of insulating material not below minimum size in Figure 2.4 (AS/NZS 3112:2017)		N/A

2.13.13.3	Static damp heat test		N/A
	Specimen subjected to two damp heat cycles in accordance with AS 60068.2.30; Db (12 + 12h), 95% RH, 25 ± 3°C; 40°C		N/A
	After this treatment and recovery to room temperature; specimen subjected to:		N/A
(a)	Insulation resistance test in accordance with clause 2.13.2 (e)	(see appended table)	N/A
(b)	High voltage test in accordance with clause 2.13.3	(see appended table)	N/A
(c)	Abrasion test in accordance with clause 2.13.13.6		N/A
2.13.13.4	Low temperature test		N/A
	Plug maintained at –15 ± 2°C for minimum of 24 h and returned to room temperature; after which specimen subjected to:		N/A
(a)	Insulation resistance test in accordance with clause 2.13.2 (e)	(see appended table)	N/A
(b)	High voltage test in accordance with clause 2.13.3	(see appended table)	N/A
(c)	Abrasion test in accordance with clause 2.13.13.6		N/A
2.13.13.5	Impact test at low temperature		N/A
	Specimen maintained at –15 ± 2°C for 24 h		N/A
	Specimen placed in position and subjected to impact test as per Figure 2.6; mass of 100 ± 1 g falling through 100 mm		N/A
	Four impacts applied; specimen rotated through 90° between impacts		N/A
	After return to room temperature; no visible cracks of insulating material		N/A
2.13.13.6	Abrasion test		N/A
	Plug held in clamp and tested as per Figure 2.7; pin loaded at 4 N; 20 000 movements		N/A
	After test; pins show no damage affecting safety or impairing further use of the plug		N/A
	Insulating sleeve not punctured or rucked up (AS/NZS 3112:2017)		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict

J4.7	Test no.9 Equipment with a plug portion intended to be supported by the contacts of a socket-outlet		N/A
	Equipment with pins intended to be introduced into fixed socket-outlets not imposing undue strain on socket-outlet		N/A
	Applied torque not exceeding 0.25 Nm		N/A
	Measured torque (AS/NZS 3112:2017)	Nm	N/A

J4.8	Additional requirements for detachable plug portions		N/A
J4.8.1	Test no.10 Access to live parts		N/A
	Small test finger of Figure 13 of IEC 61032 was not possible to contact live parts with the force of 20N		N/A
	incorrectly assemble the plug portion was not possible (AS/NZS 3112:2017)		N/A

J4.8.2	Test No.11 Construction of detachable contacts where the input current of the equipment exceeds 0.2 A		N/A
	Contacts of the equipment shall be such that they make and maintain, under normal service conditions, satisfactory electrical and mechanical contact with the corresponding contact of the detachable plug portion.		N/A
	For connections intended to accommodate pins, contact shall be made on two surfaces diametrically opposite, except if a single spring-assisted contact is used.		N/A
	Contacts shall not rely exclusively on the resilience of the contact material and shall have an opposite face of material other than thermoplastic or resilient insulating material.		N/A
	The alignment and contact-making properties of contacts shall be independent of terminal screws		N/A
	The effectiveness of the contacts shall be independent of pressure from any thermoplastic or resilient moulding. □		N/A
	Effectiveness of the contacts independent of pressure from thermoplastic or resilient moulding checked by J4.8.3		N/A
	Visual inspection to determine interference between metal contacts and thermoplastic or resilient moulding to provide supplementary contact pressure to metal contacts		N/A

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	(AS/NZS 3112:2017)		

J4.8.4	Resistance of insulating material to heat and fire		N/A
J4.8.4.1	Test no.12 Resistance to heat For Type B detachable plug portions parts of non-metallic material, parts of insulating material supporting live parts including connections, and parts of thermoplastic material providing supplementary insulation or reinforced insulation, shall be sufficiently resistant to heat if their deterioration could cause the appliance to fail to comply with this Standard.		N/A
	Ball pressure test at		N/A
(a)	75°C ± 2°C, for external parts;		N/A
(b)	125°C ± 2°C, for parts supporting live parts.		N/A
J4.8.4.2	Test no.13 Resistance to fire		N/A
	Plug portions comply with resistance to fire requirements of AS/NZS 3100 as follows:		N/A
	The glow wire test temperature 'T' for 'retaining parts' of fixed socket outlets shall be 750 C (AS/NZS 3112:2017)		N/A N/A

TABLES OF RESULTS

2.2.4	TABLE: Dimensions of insulation on insulated pin plugs		N/A
Dimension (Figure 2.1 designation)		Measured (mm)	Allowed (mm)
Phase pin			8.7 ± 0.5
Neutral pin			8.7 ± 0.5

2.8.1	TABLE: Dimensions of plugs- 10A (a1)		N/A
Dimension (Figure 2.1 designation)		Measured (mm)	Allowed (mm)
Phase and neutral pin width (A)			6.35 ± 0.15
Earth pin width (B)			6.35 ± 0.15
Pin thickness (C)			1.63 + 0.15, -0.05
Pin disposition (D)			checked by test gauge
Pin disposition (E)			checked by test gauge
Phase and neutral pin length (F)			17.06 ± 0.4
Earth pin length (G)			19.94 ± 0.8
Pin boss radius - maximum			21.0 max
Pin boss height			8.6 min

IEC62368_1D - ATTACHMENT

Clause	Requirement + Test	Result - Remark	Verdict
2.8.1	TABLE: Dimensions of plugs- 15A (a1)		N/A
Dimension (Figure 2.1 designation)		Measured (mm)	Allowed (mm)
Phase and neutral pin width (A)			6.35 ± 0.15
Earth pin width (B)			9.08 ± 0.15
Pin thickness (C)			$1.63 + 0.15, -0.05$
Pin disposition (D)			checked by test gauge
Pin disposition (E)			checked by test gauge
Phase and neutral pin length (F)			17.06 ± 0.4
Earth pin length (G)			19.94 ± 0.8
Pin boss radius - maximum			21.0 max
Pin boss height			8.6 min

2.8.1	TABLE: Dimensions of plugs-20A (a2)		N/A
Dimension (Figure 2.1 designation)		Measured (mm)	Allowed (mm)
Phase and neutral pin width (A)			9.08 ± 0.15
Earth pin width (B)			9.08 ± 0.15
Pin thickness (C)			$1.63 + 0.15, -0.05$
Pin disposition (D)			checked by test gauge
Pin disposition (E)			checked by test gauge
Phase and neutral pin length (F)			17.06 ± 0.4
Earth pin length (G)			19.94 ± 0.8
Pin boss radius - maximum			21.0 max
Pin boss height			8.6 min

2.8.1	TABLE: Projection from plug face centroid		N/A
Direction of projection		Measured (mm)	Allowed (mm)
Left			≤ 21.9 or ≥ 27.0
Right			≤ 21.9 or ≥ 27.0
Up			≤ 21.9 or ≥ 27.0
Down			≤ 21.9 or ≥ 27.0

2.13.3	TABLE: Test No. 1 – High voltage test		N/A
Test voltage applied between:		Test voltage (V)	Breakdown
All poles of the plug; taken in pairs		1000	Yes / No
Live poles of the plug and any external metal		3500	Yes / No
Live poles of the plug and the earthing terminal		1000	Yes / No
Live poles of the plug and a flexible electrode		3500	Yes / No
Live poles and metal foil applied around insulation on pins		1250	Yes / No

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
2.13.8	TABLE: Test No. 6 - Temperature rise test		N/A
	Ambient temperature	°C	N/A
	Test current	A	N/A
Measured part		dT measured (K)	dT allowed (K)
Active (phase) terminal			45
Neutral terminal			45
Earthing terminal			45

2.13.9.1	TABLE: Movement of pins		N/A
	Earth and neutral pins clamped – phase pin loaded		N/A
Force direction		Measured deflection (mm)	Allowed deflection (mm)
Force towards neutral plane parallel to pin plane			2.0
Force from neutral plane parallel to pin plane			2.0
Force outwards at 90° to pin plane			2.0
Force inwards at 90° to pin plane			2.0

2.13.9.1	TABLE: Movement of pins		N/A
	Phase and neutral pins clamped – earth pin loaded		N/A
Force direction		Measured deflection (mm)	Allowed deflection (mm)
Force inwards parallel to pin plane			2.0
Force outwards parallel to pin plane			2.0
Force towards neutral			2.0
Force towards phase			2.0

2.13.9.1	TABLE: Movement of pins		N/A
	Phase and earth pins clamped – neutral pin loaded		N/A
Force direction		Measured deflection (mm)	Allowed deflection (mm)
Force towards phase plane parallel to pin plane			2.0
Force from phase plane parallel to pin plane			2.0
Force outwards at 90° to pin plane			2.0
Force inwards at 90° to pin plane			2.0

2.13.13.3	TABLE: Test No.13(b) – Insulation resistance test after static damp heat test		N/A
Applied between:		Insulation resistance (MΩ)	Minimum required (MΩ)

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict
	Live poles and metal foil applied around insulation on pins		5

2.13.13.3	TABLE: Test No.1 – High voltage test after static damp heat test		N/A
Test voltage applied between:		Test voltage (V)	Breakdown
Live poles and metal foil applied around insulation on pins		1250	Yes / No

2.13.13.4	TABLE: Test No.1 – Insulation resistance test after low temperature test		N/A
Applied between:		Insulation resistance (MΩ)	Minimum required (MΩ)
Live poles and metal foil applied around insulation on pins			5

2.13.13.4	TABLE: Test No.1 – High voltage test after low temperature test		N/A
Test voltage applied between:		Test voltage (V)	Breakdown
Live poles and metal foil applied around insulation on pins		1250	Yes / No

J4.8.4.1	TABLE: Test no.12 Resistance to heat		N/A
Component tested		Temperature (°C)	Diameter of impression (mm)

Conformance is checked by subjecting the relevant part to the ball pressure test of IEC 60695-10-2.

J4.8.4.2	TABLE: Test no.13 Resistance to Fire		N/A
	Plug portions shall comply with the requirements for resistance to fire in accordance with AS/NZS 3100:2017 Annex A. The glow-wire test temperature 'T' shall be 750°C.		N/A

Glow-wire testing was conducted in accordance with IEC 60695-2-10 and IEC 60695-2-11.

Test specimens arranged so that the surface in contact with the tip of the glow-wire was vertical and glow wire tip applied to surface of the specimen likely to be subjected to thermal stresses in normal use.

A layer of white pine board and wrapping tissue was placed beneath the sample at 200mm ± 5mm distance.

IEC62368_1D - ATTACHMENT					
Clause	Requirement + Test	Result - Remark			Verdict
SPECIMEN NUMBER		1	2	3	4
SPECIMEN DESCRIPTION					
Material					
Colour					
Test specimen					
Glow wire tip temperature (°C)		750	750	750	750
Duration of glow wire application (t _a) (s)		30	30	30	30
OBSERVATIONS					
Duration from beginning of glow-wire tip application to ignition of specimen or layer (t _i)(s)					
Duration from beginning of glow-wire tip application to when flames extinguish (t _e) (s)					
Maximum height of flames after initial 1s (to nearest 5 mm) (mm)					
Flame impingement on other parts					
Degree of tip penetration					
Degree of specimen distortion					
Scorching of pinewood board					
EVALUATION CRITERIA					
Visible flame or sustained glowing					
Visible Flame Duration in Seconds during test.					
Duration of flaming or glowing after tip removal (max. allowable 30 s) (s)					
Surrounding parts burned away completely (not permitted)					
Ignition of wrapping tissue layer (not permitted)					
RESULTS					
If parts tested withstand the glow-wire test, but during the test produce a flame that persists for longer than 2 s, then the consequential needle flame test of AS/NZS 3100:2017 Annex A 6.1.5 applies.					

LEGEND: CE Complete Equipment SA Sub Assembly

SE Self Extinguished

EBDEmitted Burning Droplets SBD

Specimen Burned and Distorted

SMD

Specimen Melted and Distorted

ME Manually Extinguished SC

Separate Component SS

Specimen Scorched

NA Not Applicable
no Ignition

SCCSpecimen Completely Consumed

WPNI Wall Penetrated but

NI No Ignition

X Flame Appeared for an Instant

IEC62368_1D - ATTACHMENT			
Clause	Requirement + Test	Result - Remark	Verdict

Glow-wire testing was conducted in accordance with IEC 60695-2-10 and IEC 60695-2-11.

Test specimens arranged so that the surface in contact with the tip of the glow-wire was vertical and glow wire tip applied to surface of the specimen likely to be subjected to thermal stresses in normal use. A layer of white pine board and wrapping tissue was placed beneath the sample at 200mm ± 5mm distance.

SPECIMEN NUMBER	5	6	7	8
SPECIMEN DESCRIPTION				
Material				
Colour				
Test specimen				
Glow wire tip temperature (°C)				
Duration of glow wire application (t _a) (s)	30	30	30	30
OBSERVATIONS				
Duration from beginning of glow-wire tip application to ignition of specimen or layer (t _i)(s)				
Duration from beginning of glow-wire tip application to when flames extinguish (t _e) (s)				
Maximum height of flames after initial 1s (to nearest 5 mm) (mm)				
Flame impingement on other parts				
Degree of tip penetration				
Degree of specimen distortion				
Scorching of pinewood board				
EVALUATION CRITERIA				
Visible flame or sustained glowing				
Visible Flame Duration in Seconds during test.				
Duration of flaming or glowing after tip removal (max. allowable 30 s) (s)				
Surrounding parts burned away completely (not permitted)				
Ignition of wrapping tissue layer (not permitted)				
RESULTS If parts tested withstand the glow-wire test, but during the test produce a flame that persists for longer than 2 s, then the consequential needle flame test of AS/NZS 3100:2017 Annex A 6.1.5 applies				

LEGEND: CE Complete Equipment SA Sub Assembly

SE Self Extinguished

EBDEmitted Burning Droplets SBD

Specimen Burned and Distorted

SMD

Specimen Melted and Distorted

ME Manually Extinguished SC

Separate Component SS

Specimen Scorched

IEC62368_1D - ATTACHMENT

Clause	Requirement + Test	Result - Remark	Verdict
--------	--------------------	-----------------	---------

NA Not Applicable SCCSpecimen Completely Consumed WPNI Wall Penetrated but no Ignition

NI No Ignition X Flame Appeared for an Inst

TABLE: Needle- flame test (NFT)					N/A
Object/ Part No./ Material	Manufacturer/ trademark	Duration of application of test flame (ta); (s)	Ignition of specified layer Yes/No	Duration of burning (tb) (s)	Verdict
Supplementary information:					
- NFT not relevant (or applicable) for Parts of material classified as V-0 or V-1					
- NFT not relevant (or applicable) for Base material of PCBs classified as V-0 or if relevant VTM-0					

PHOTOGRAPHS	N/A
-------------	-----



Photo 1: Overall view for model XBSPOX60-4232A3P-VBK



Photo 2: Overall view for model XBSPOX60-4232A3P-VBK



Photo 3: External view for model XBSPOX60-4232A3P-VBK



Photo 4: External view for model XBSPOX60-4232A3P-VBK



Photo 5: External view for model XBSPOX60-4232A3P-VBK

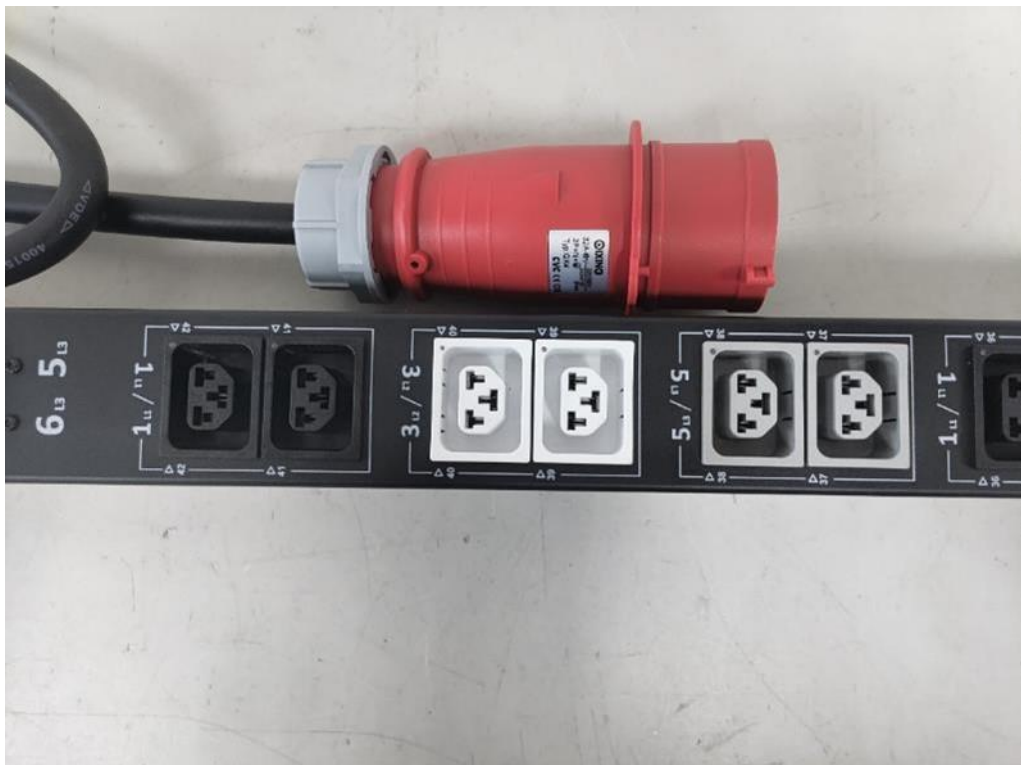


Photo 6: External view for model XBSPOX60-4232A3P-VBK



Photo 7: External view for model XBSPOX60-4232A3P-VBK



Photo 8: External view for model XBSPOX60-4232A3P-VBK



Photo 9: External view for model XBSPOX60-4232A3P-VBK



Photo 10: External view for model XBSPOX60-4232A3P-VBK



Photo 11: External rear view for model XBSPOX60-4232A3P-VBK

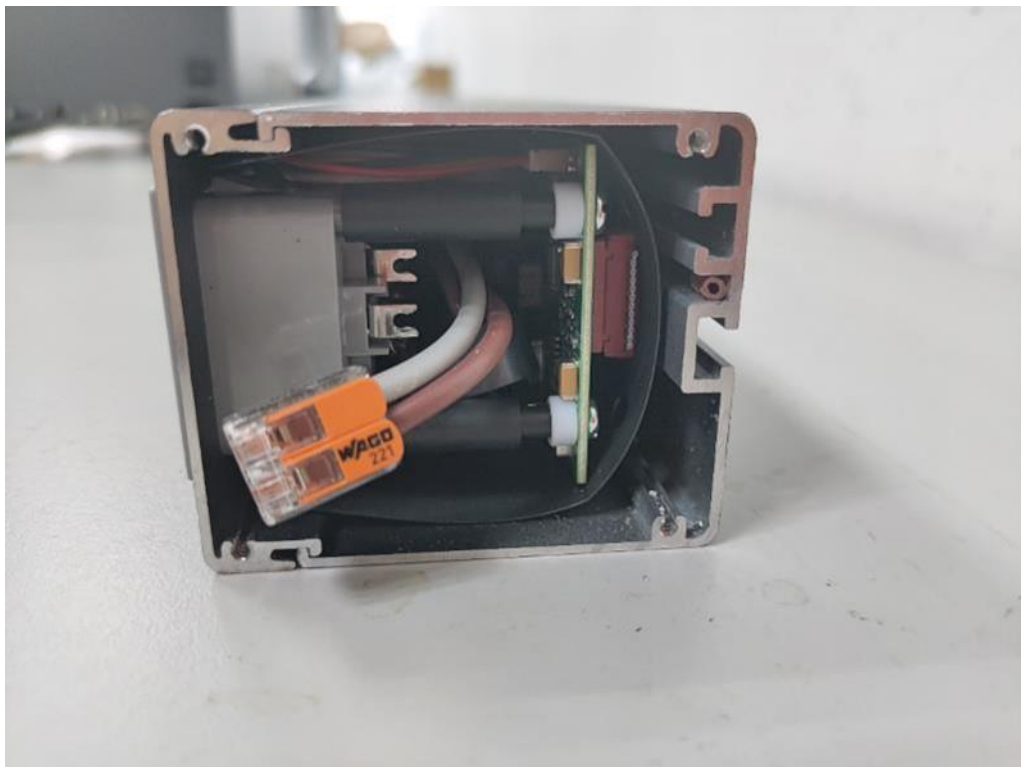


Photo 12: Right end internal view for model XBSPOX60-4232A3P-VBK

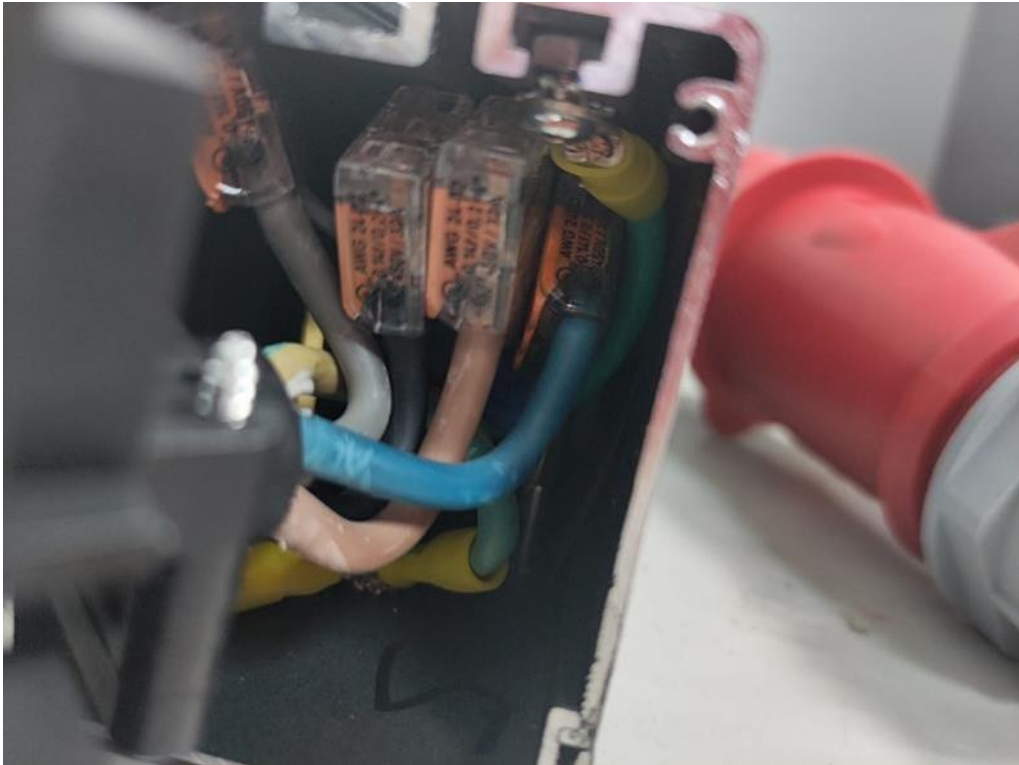


Photo 13: Left end internal view for model XBSPOX60-4232A3P-VBK

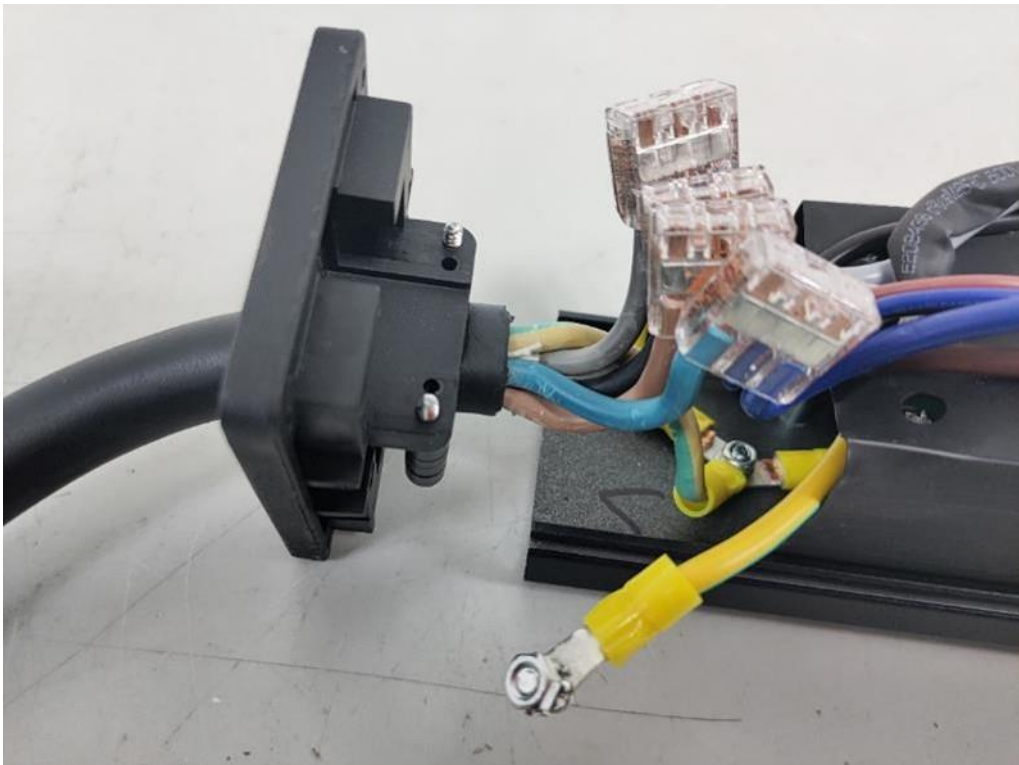


Photo 14: Left end internal view for model XBSPOX60-4232A3P-VBK

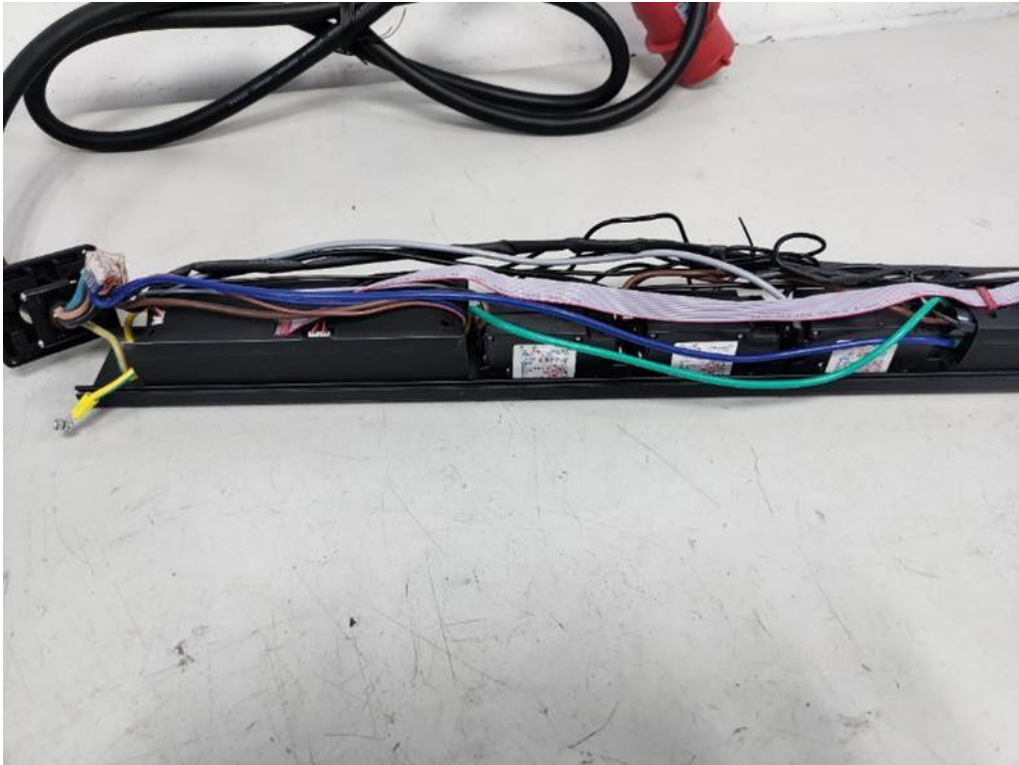


Photo 15: Internal view for model XBSPOX60-4232A3P-VBK

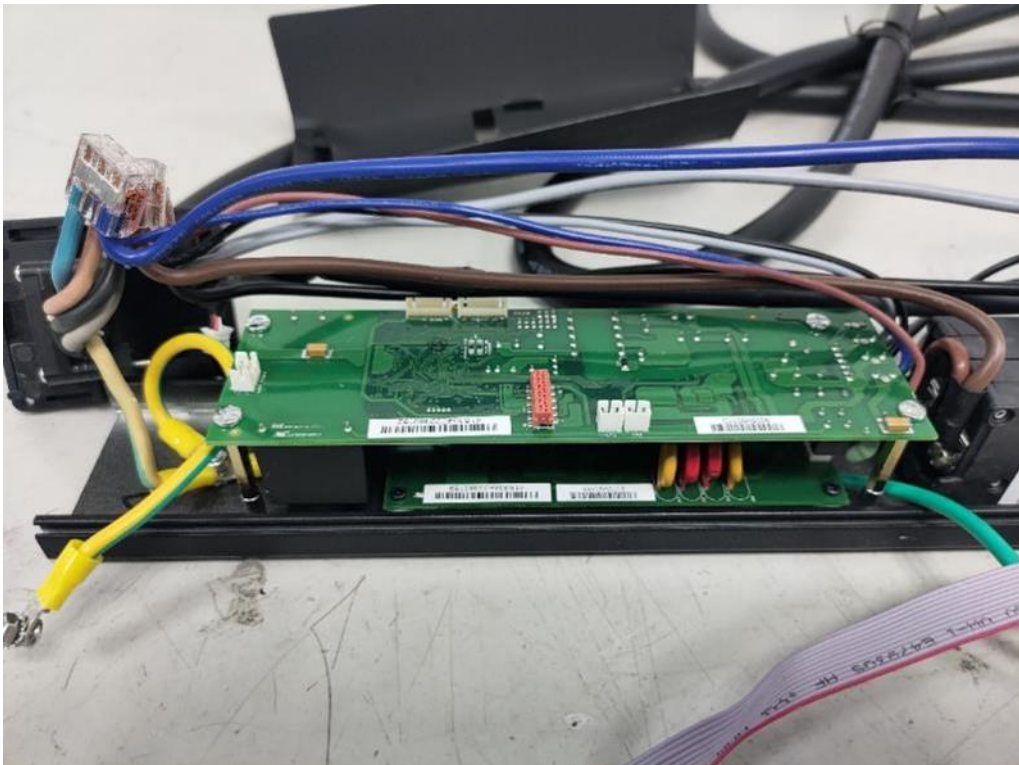


Photo 16: Internal view for model XBSPOX60-4232A3P-VBK

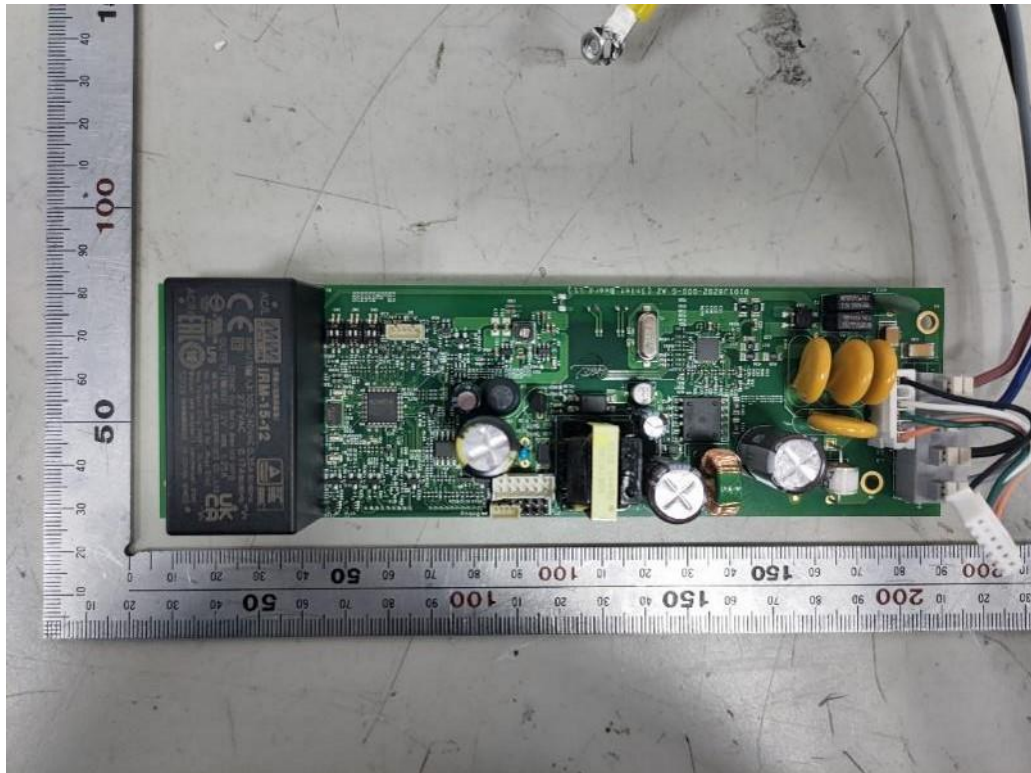


Photo 17: View of the Inlet_board_L1 of SPIM, SPOM, SPOS, SPOX series

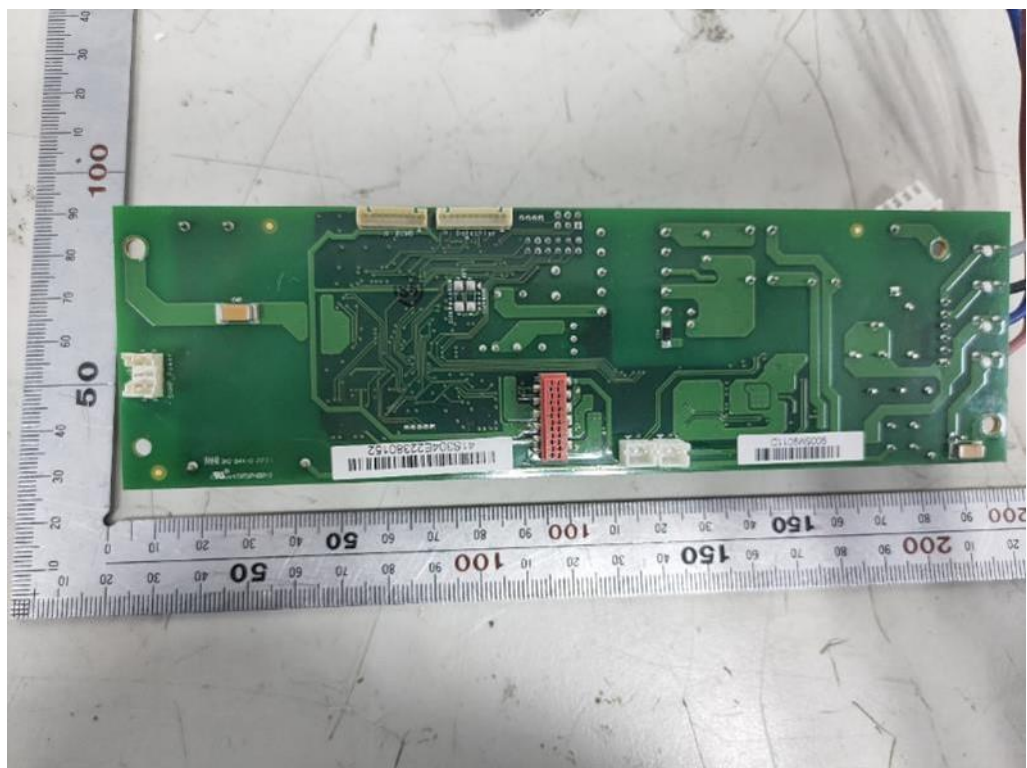


Photo 18: View of the Inlet_board_L1 of SPIM, SPOM, SPOS, SPOX series

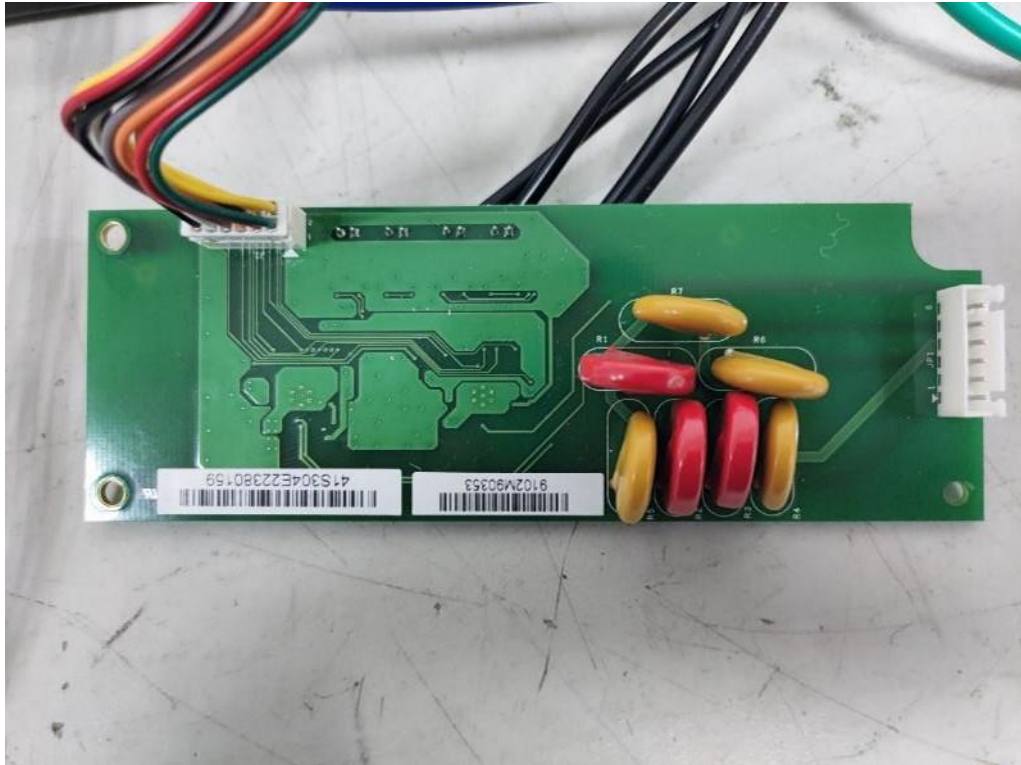


Photo 19: View of the Inlet_board_L2&L3 of models supplied by three phases

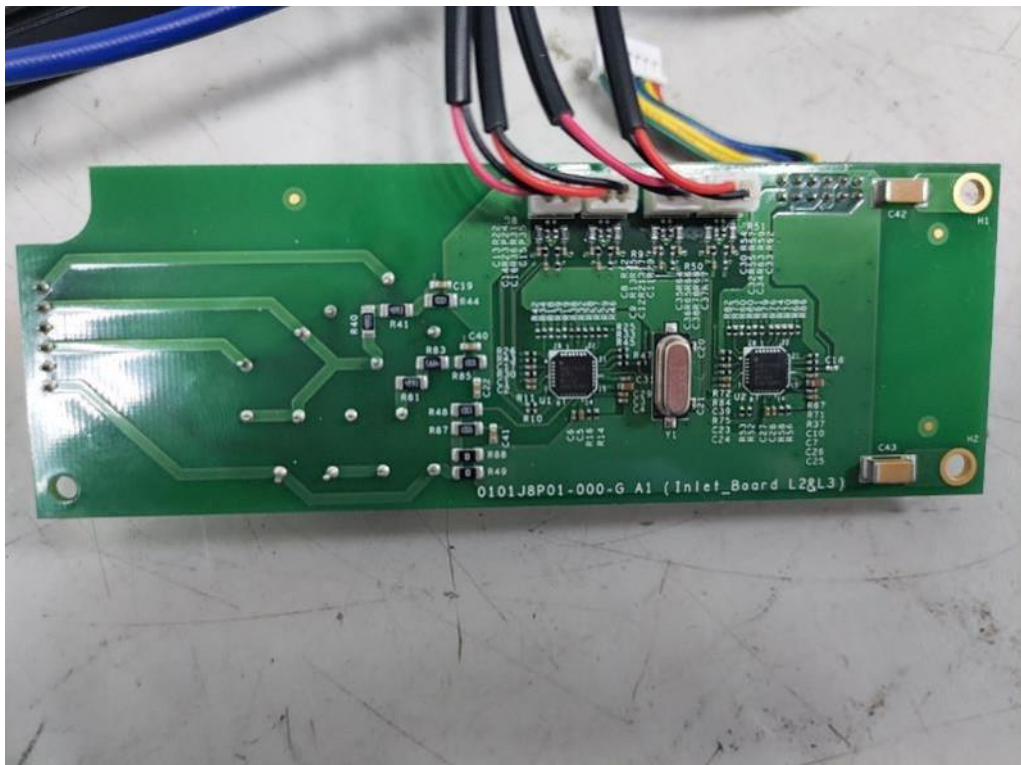


Photo 20: View of the Inlet_board_L2&L3 of models supplied by three phases

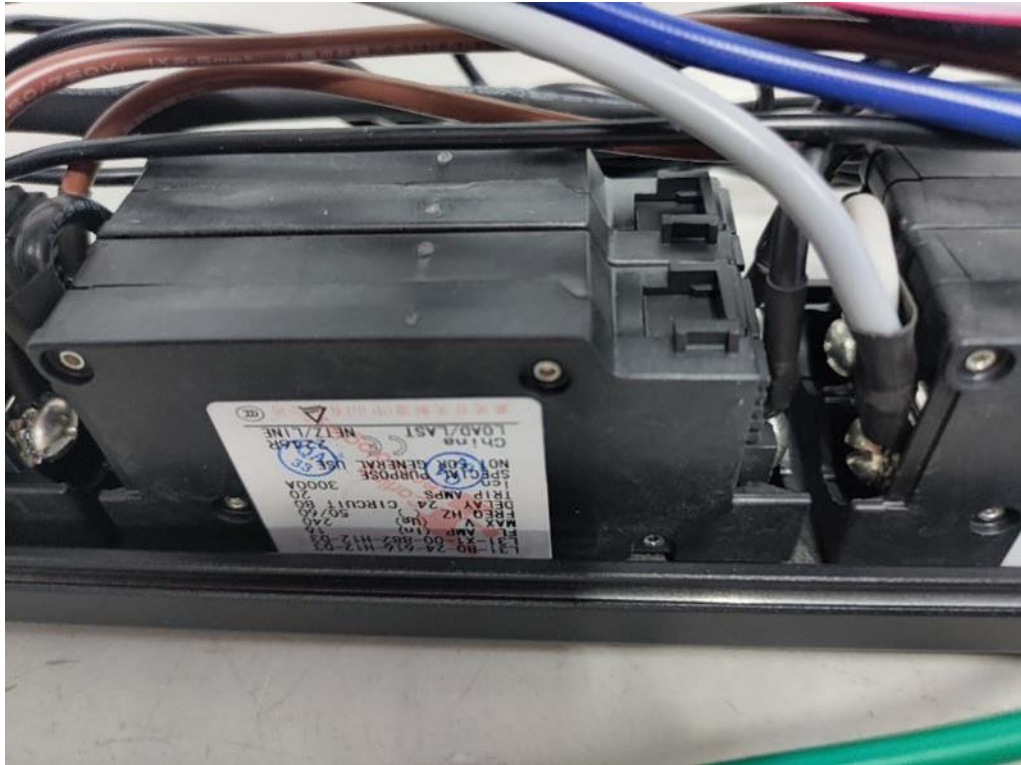


Photo 21: View of the circuit breaker

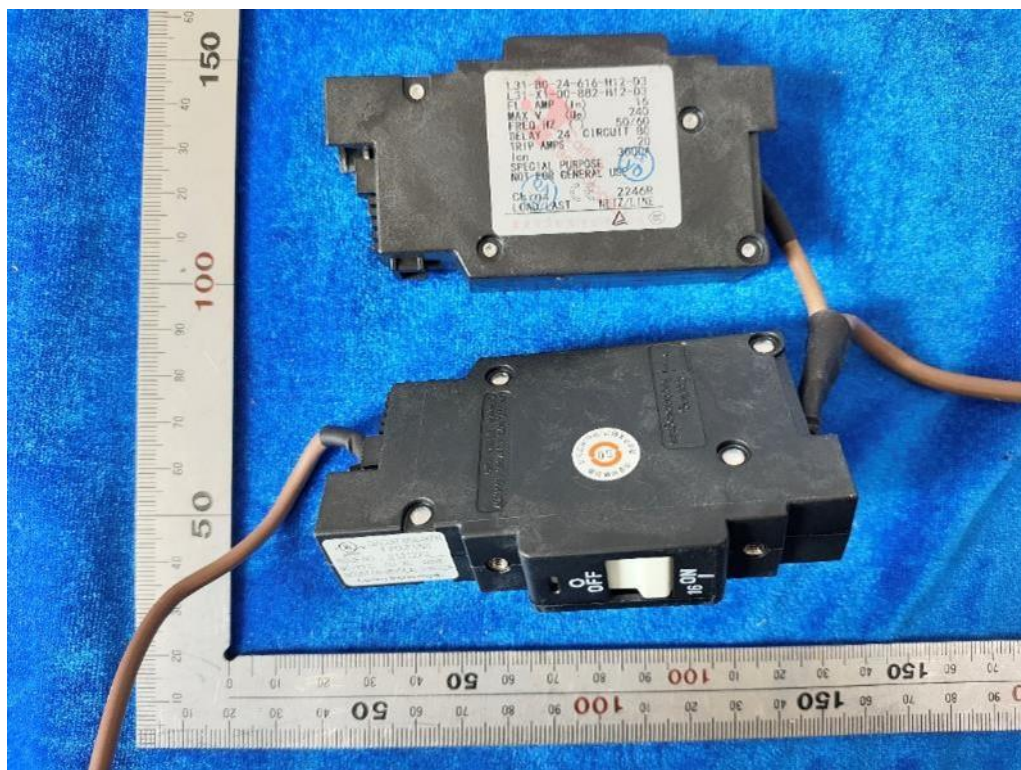


Photo 22: View of the circuit breaker

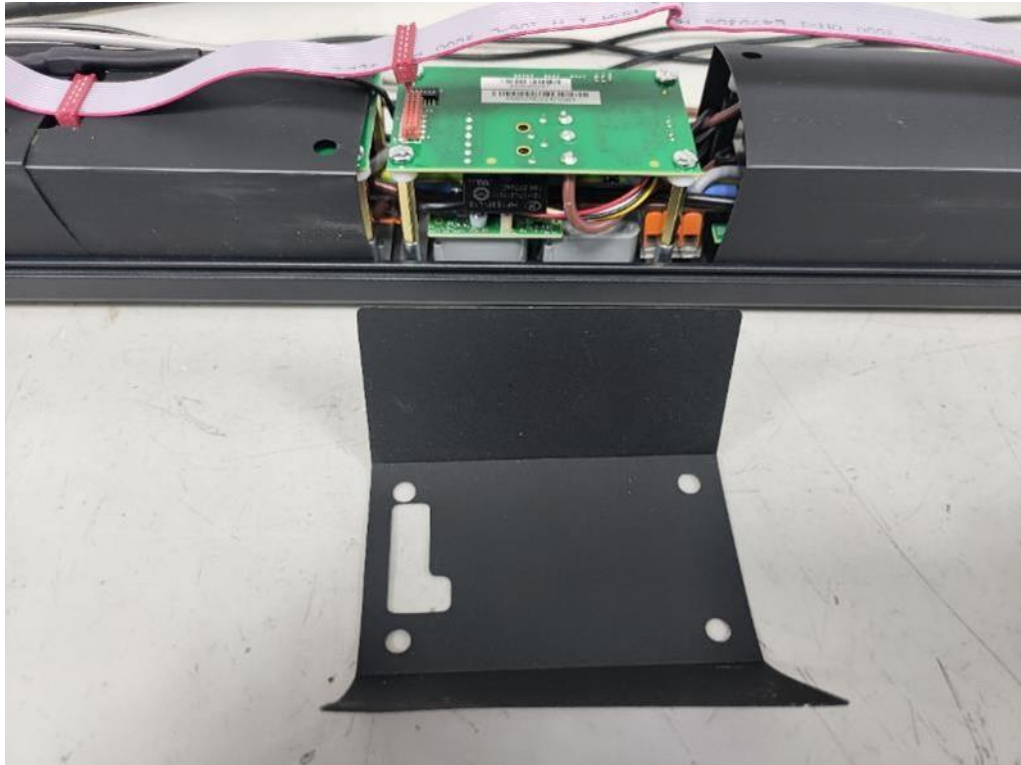


Photo 23: Internal view of SPOS, SPOX series

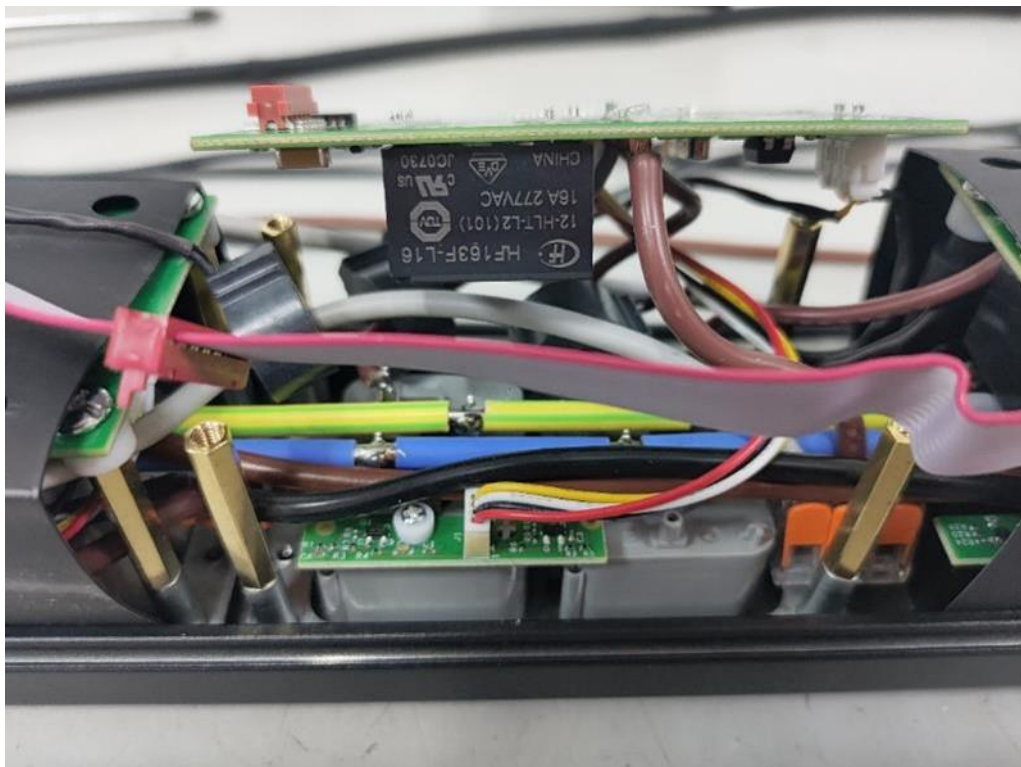


Photo 24: Internal view of SPOS, SPOX series

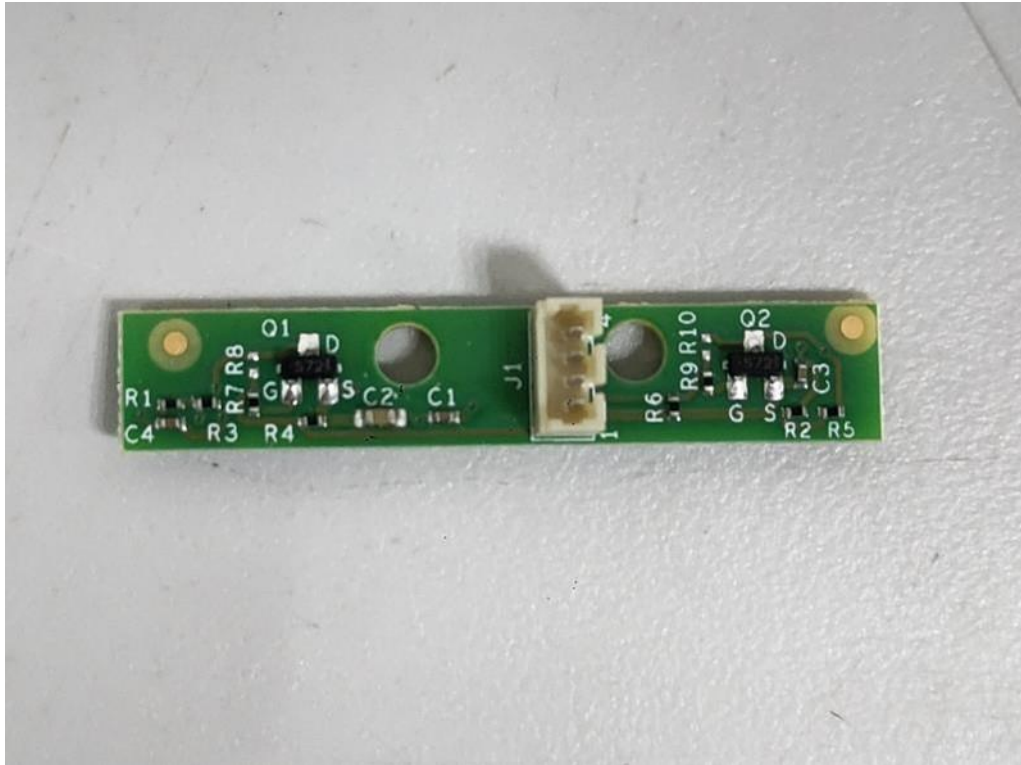


Photo 25: View of the LED board of SPOS, SPOX series

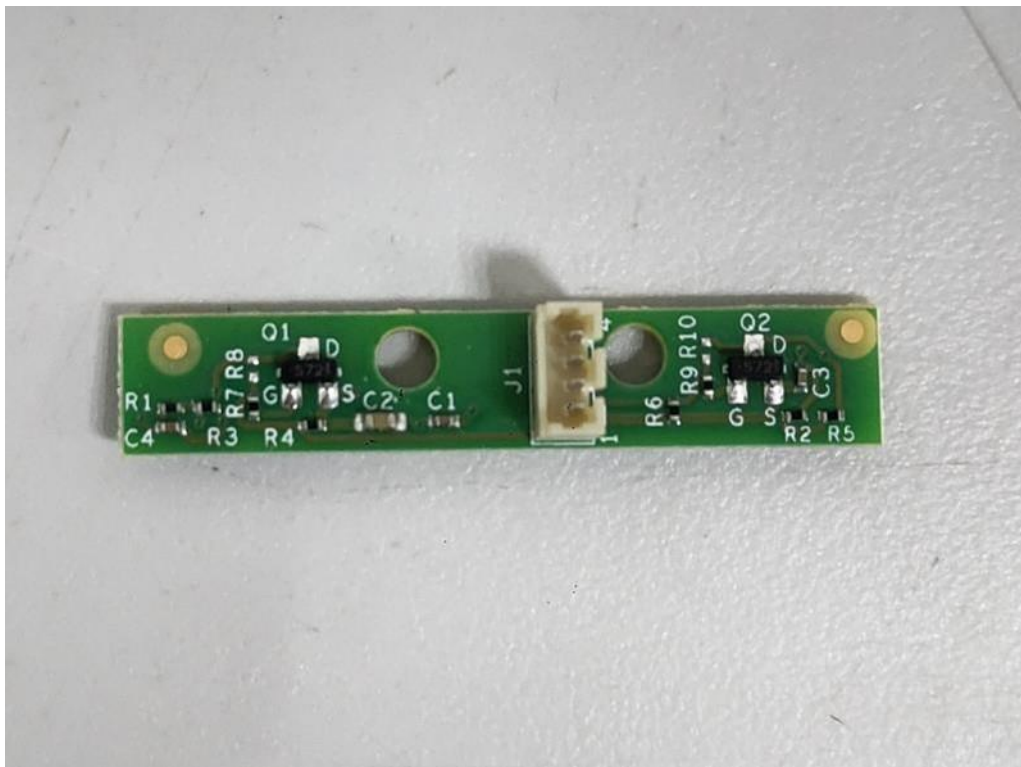


Photo 26: View of the LED board of SPOS, SPOX series



Photo 27: View of the Outlet_PMU_Board_SKU*2 of SPOM, SPOS, SPOX series

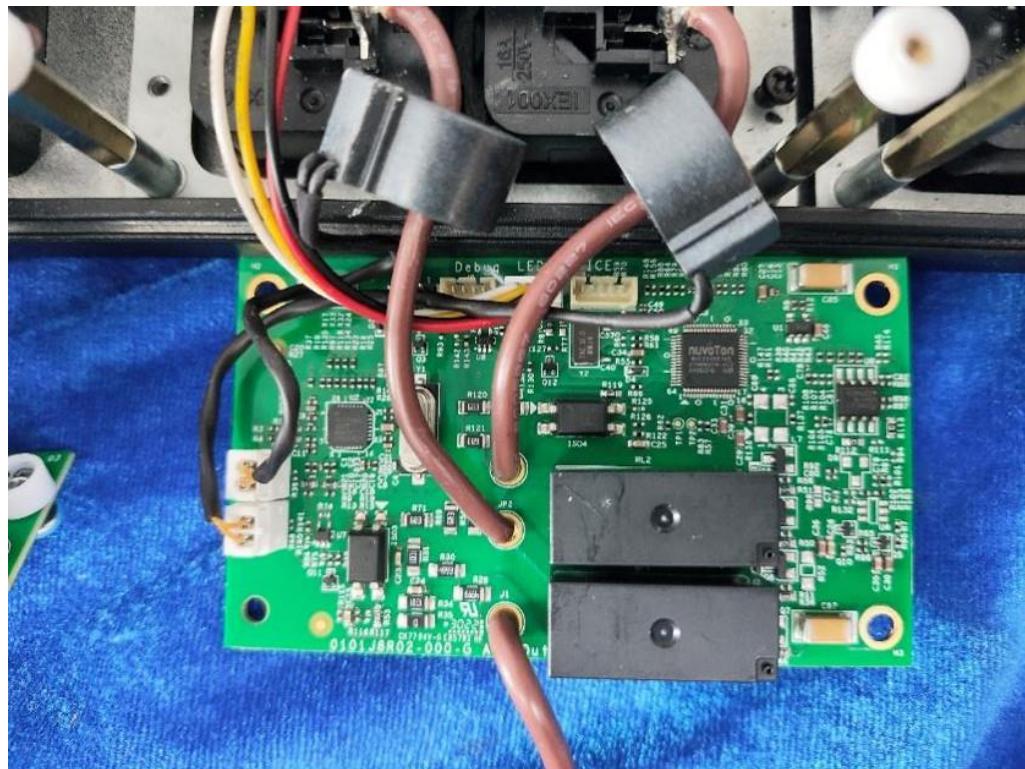


Photo 28: View of the Outlet_PMU_Board_SKU*2 of SPOM, SPOS, SPOX series



Photo 29: Internal view of SPOS, SPOX series

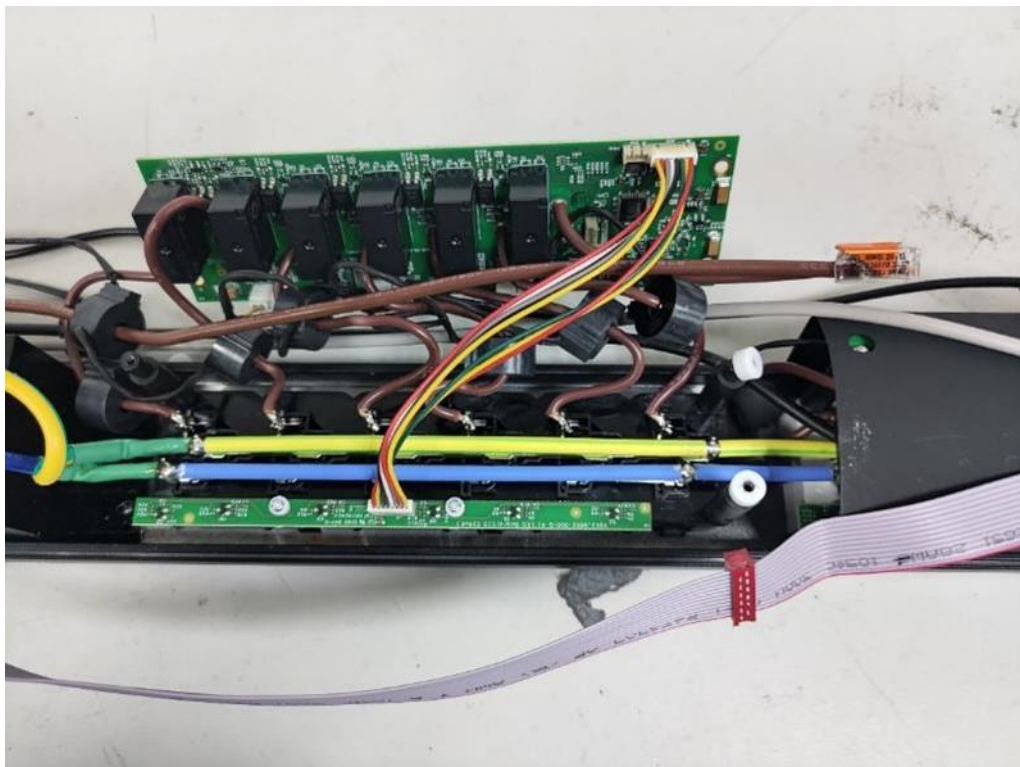


Photo 30: Internal view of SPOS, SPOX series

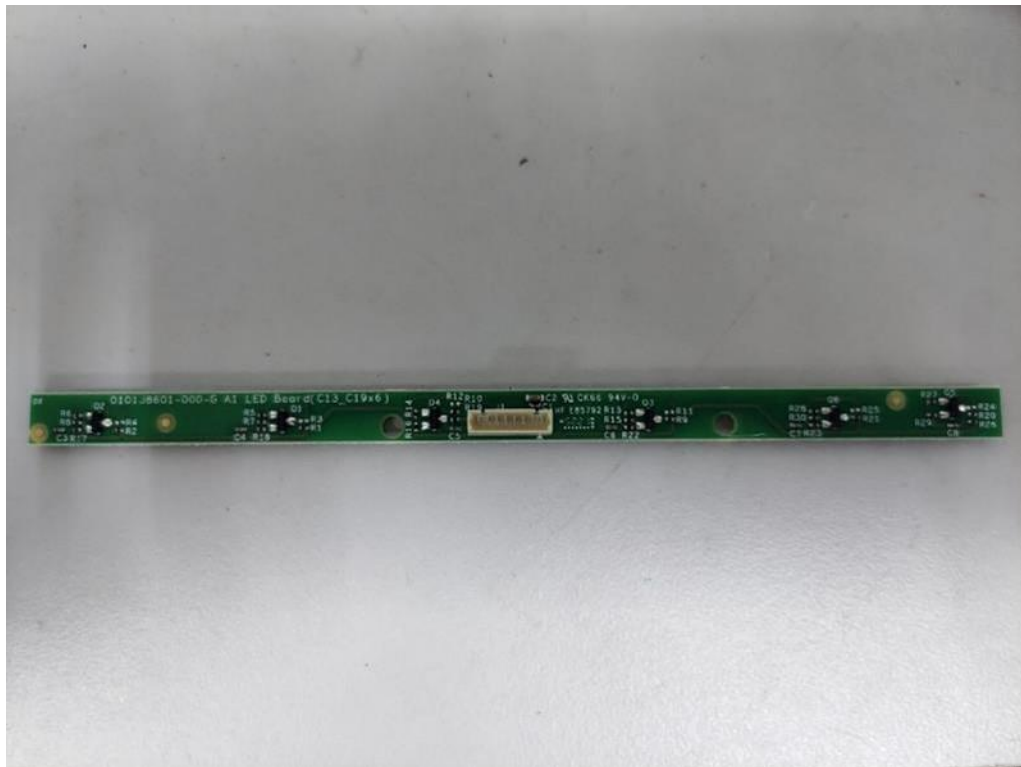


Photo 31: View of the LED board 0101J8601-000-G A1 of SPOS, SPOX series



Photo 32: View of the LED board 0101J8601-000-G A1 of SPOS, SPOX series

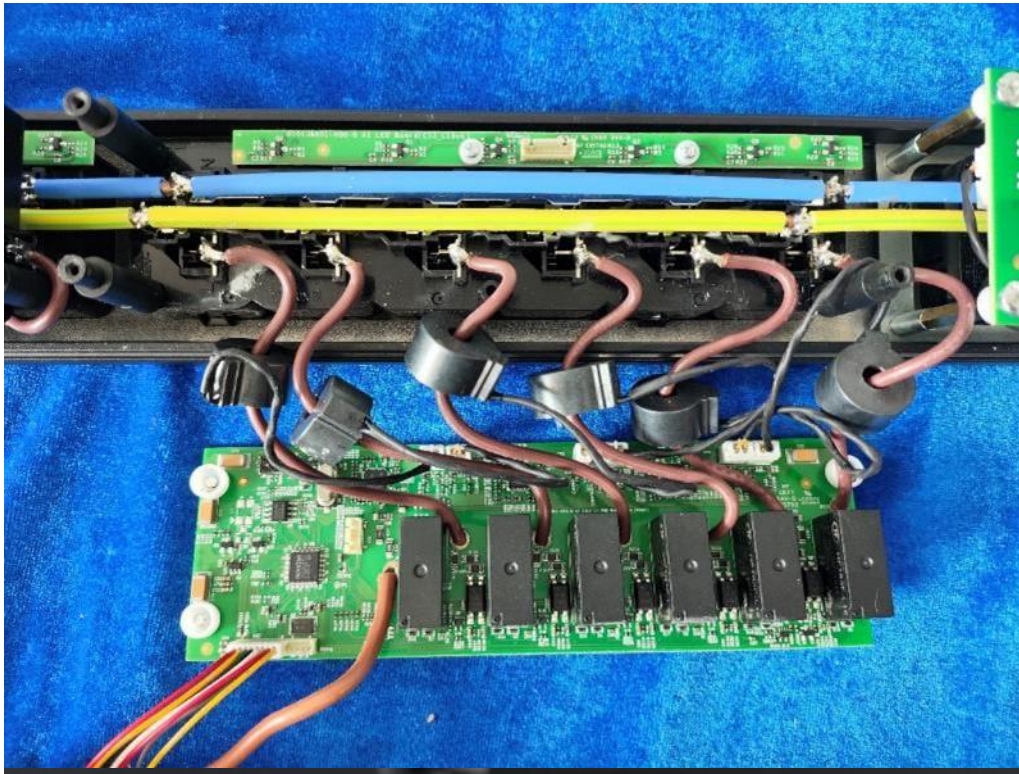


Photo 33: View of the Outlet_PMU_Board_C13~C19*6 of SPOM, SPOS, SPOX series

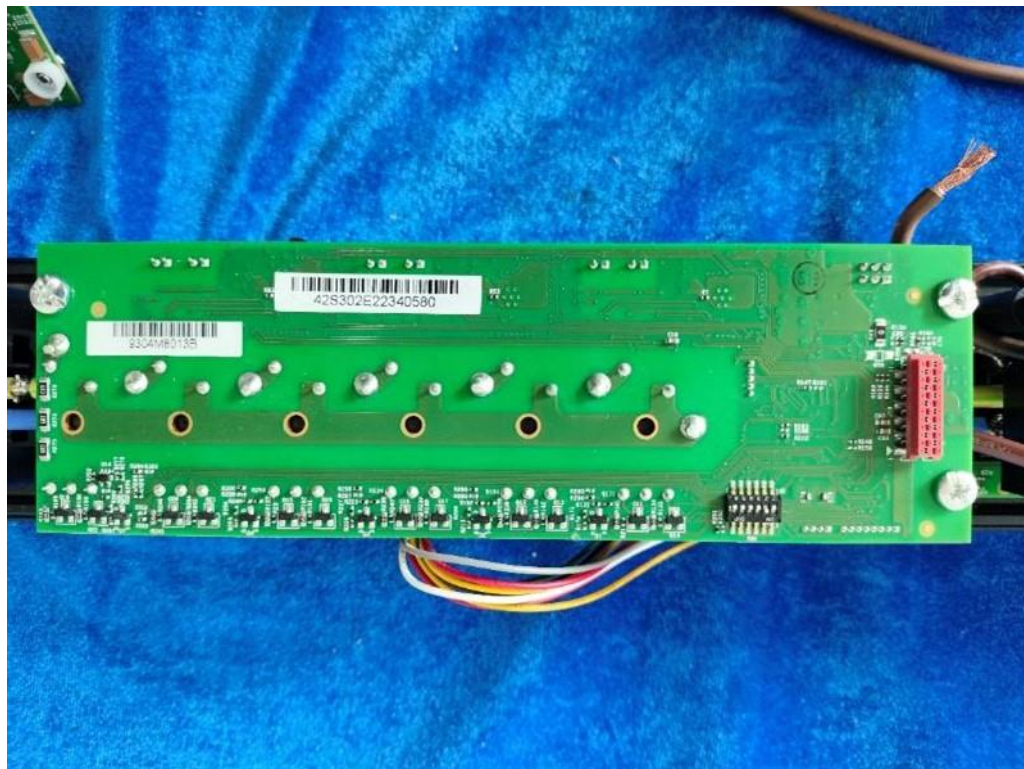


Photo 34: View of the Outlet_PMU_Board_C13~C19*6 of SPOM, SPOS, SPOX series

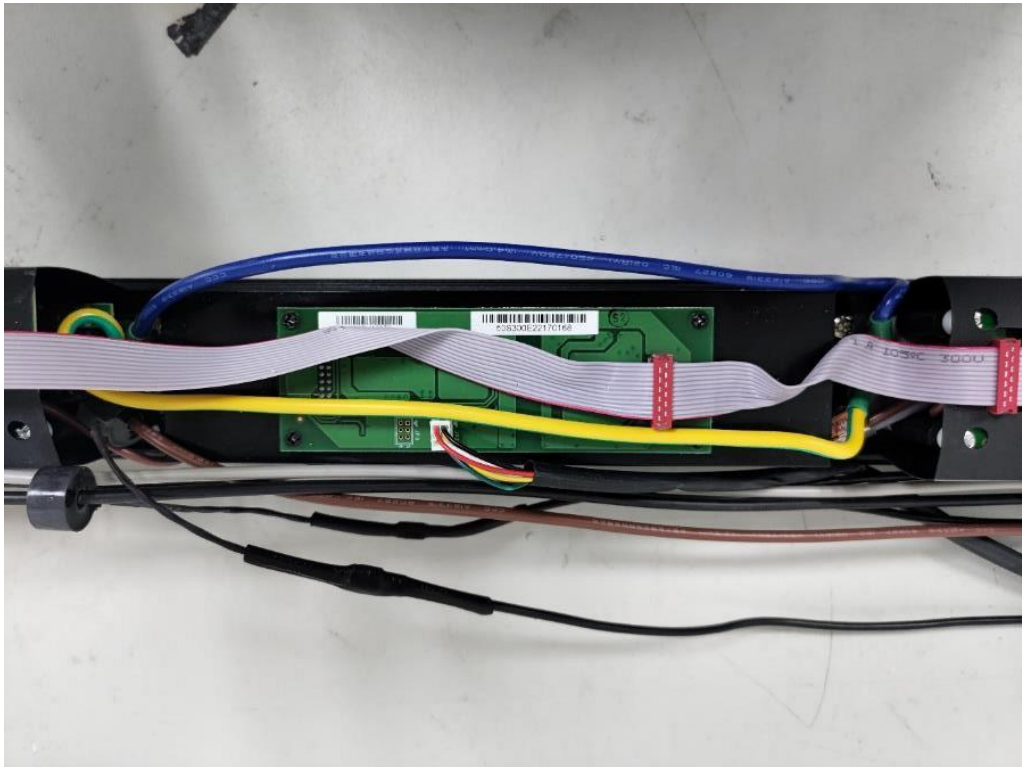


Photo 35: Internal view of SPIM, SPOM, SPOS, SPOX series

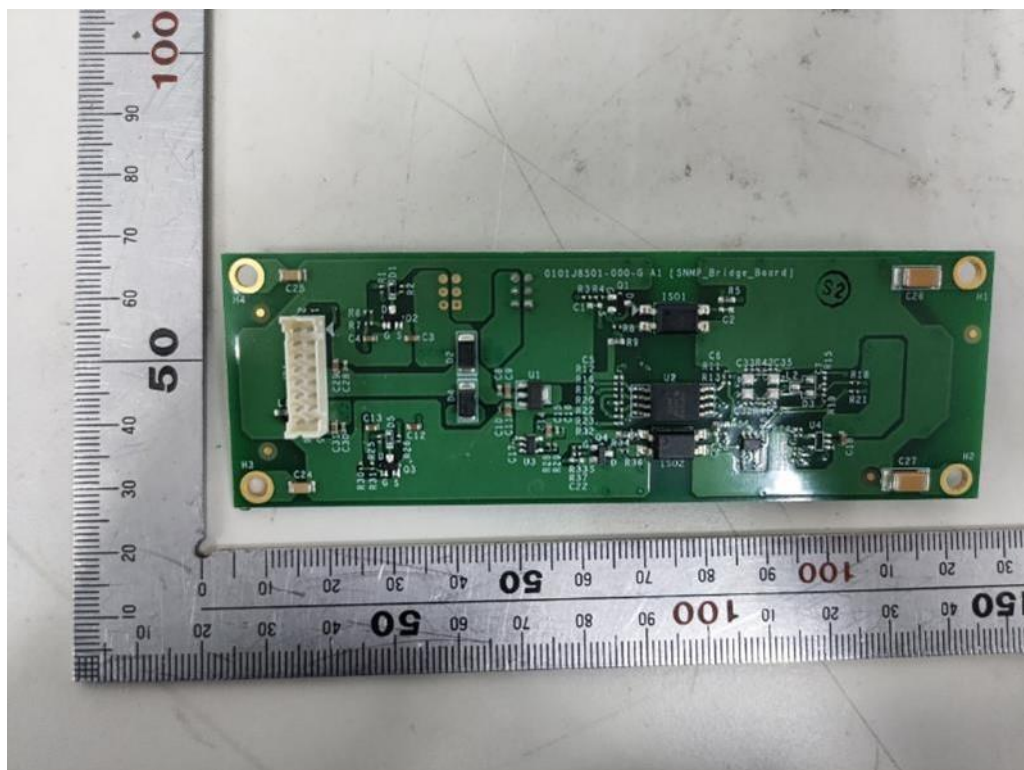


Photo 36: View of the SNMP_Bridge_Board of SPIM, SPOM, SPOS, SPOX series

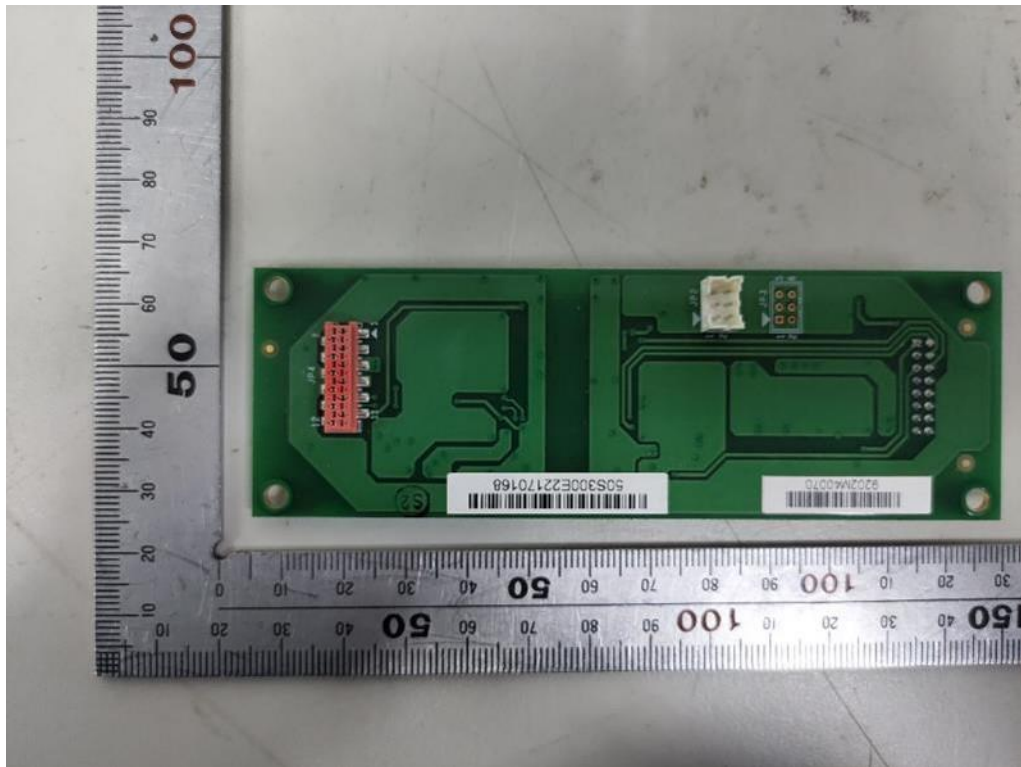


Photo 37: View of the SNMP_Bridge_Board of SPIM, SPOM, SPOS, SPOX series



Photo 38: View of the terminal, control & display module of SPIM, SPOM, SPOS, SPOX series



Photo 39: View of the terminal, control & display module of SPIM, SPOM, SPOS, SPOX series



Photo 40: View of the terminal, control & display module of SPIM, SPOM, SPOS, SPOX series



Photo 41: View of the terminal, control & display module of SPIM, SPOM, SPOS, SPOX series

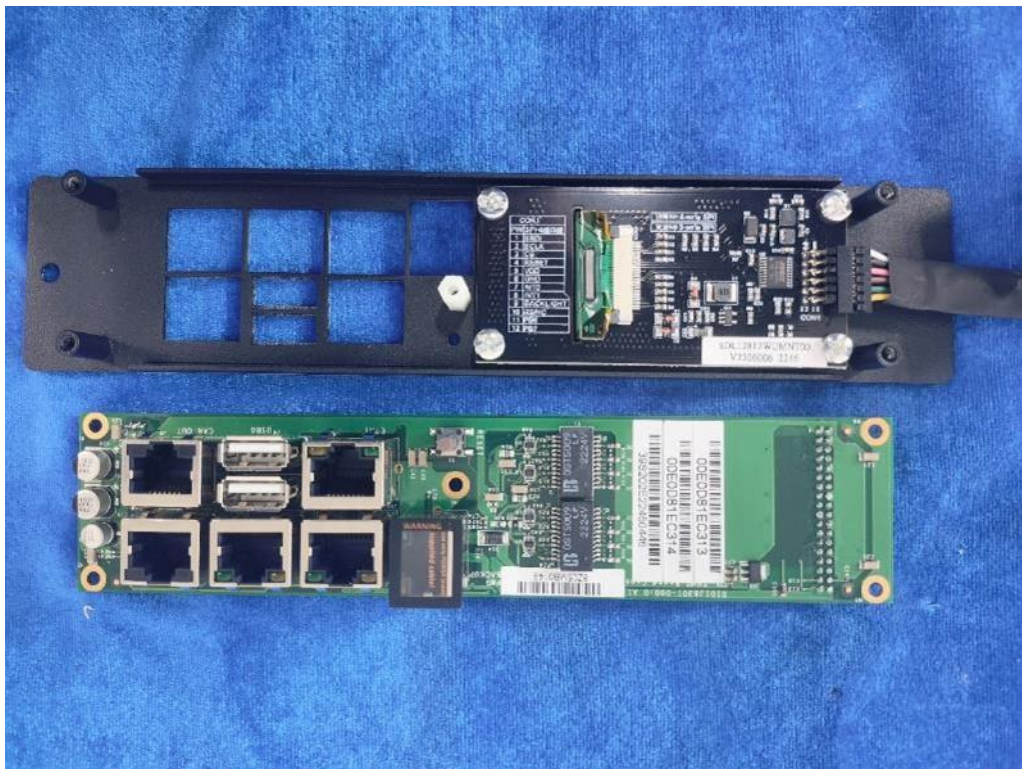


Photo 42: View of the terminal, control & display module of SPIM, SPOM, SPOS, SPOX series



Photo 43: Overall view for model XBSPIM60-4232A3P-Vxx



Photo 44: Overall view for model XBSPIM60-4232A3P-Vxx

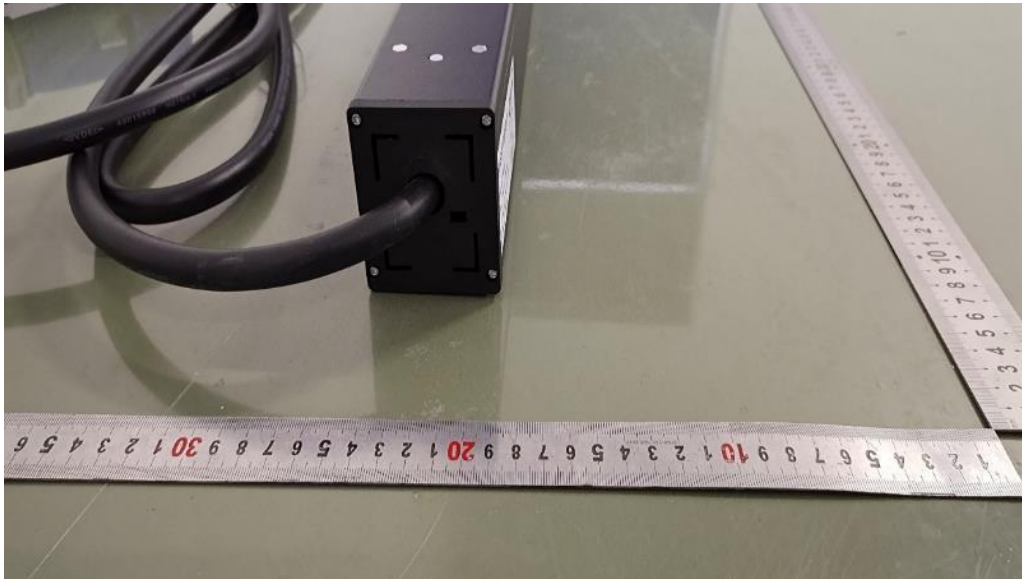


Photo 45: External view for model XBSPIM60-4232A3P-Vxx



Photo 46: External view for model XBSPIM60-4232A3P-Vxx



Photo 47: External view for model XBSPIM60-4232A3P-VXX



Photo 48: External view for model XBSPIM60-4232A3P-VXX



Photo 49: External view for model XBSPIM60-4232A3P-VXX



Photo 50: External view for model XBSPIM60-4232A3P-VXX



Photo 51: External view for model XBSPIM60-4232A3P-VXX

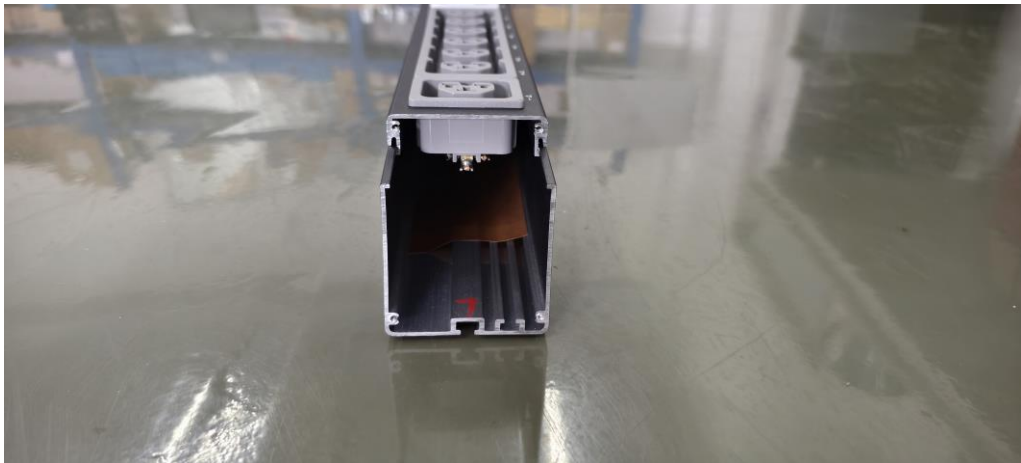


Photo 52: Right end internal view for model XBSPIM60-4232A3P-VXX



Photo 53: Left end internal view for model XBSPIM60-4232A3P-VXX

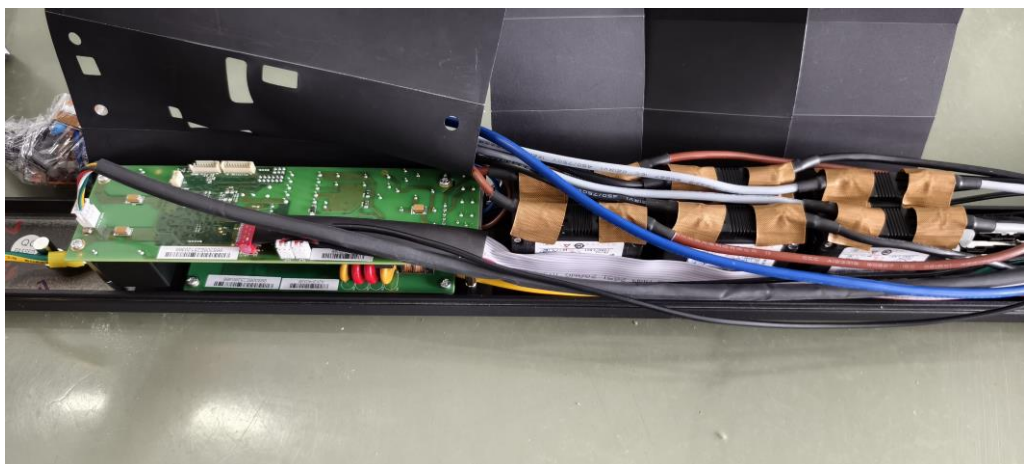


Photo 54: Left end internal view for model XBSPIM60-4232A3P-VXX

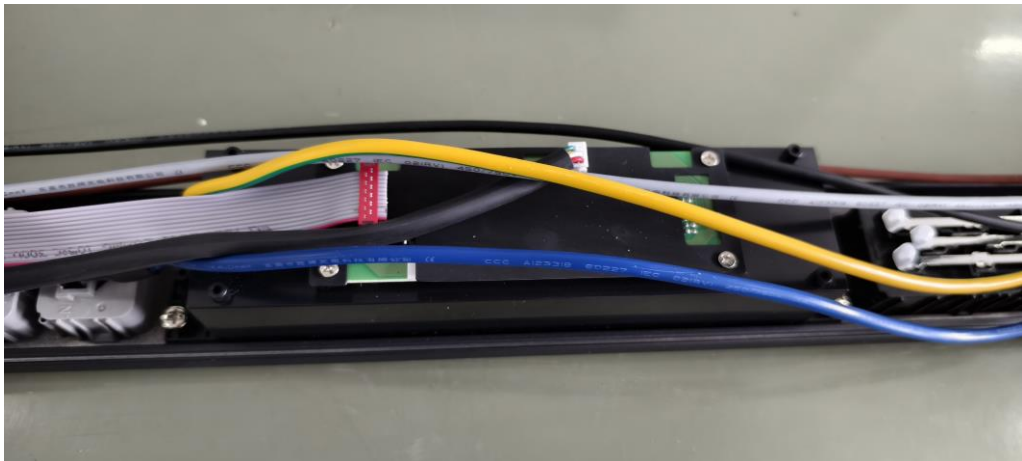


Photo 55: Internal view for model XBSPIM60-4232A3P-VXX

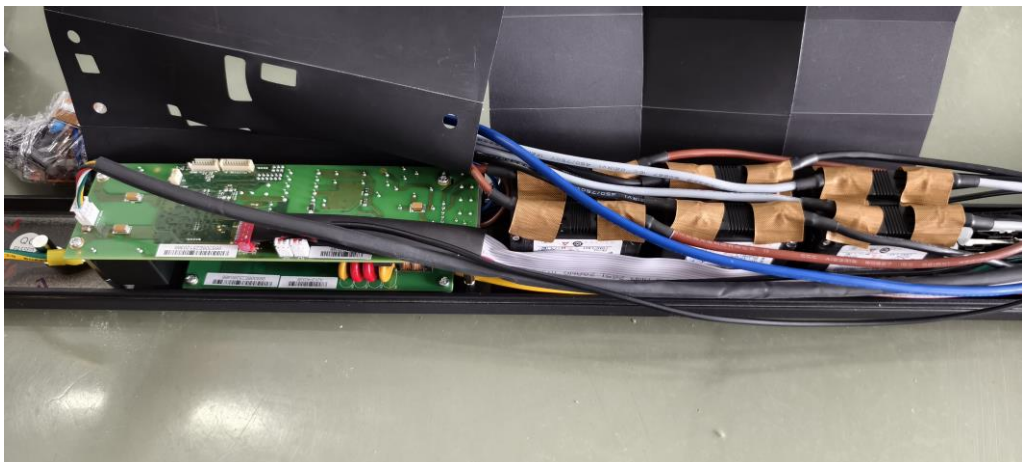


Photo 56: Internal view for model XBSPIM60-4232A3P-VXX

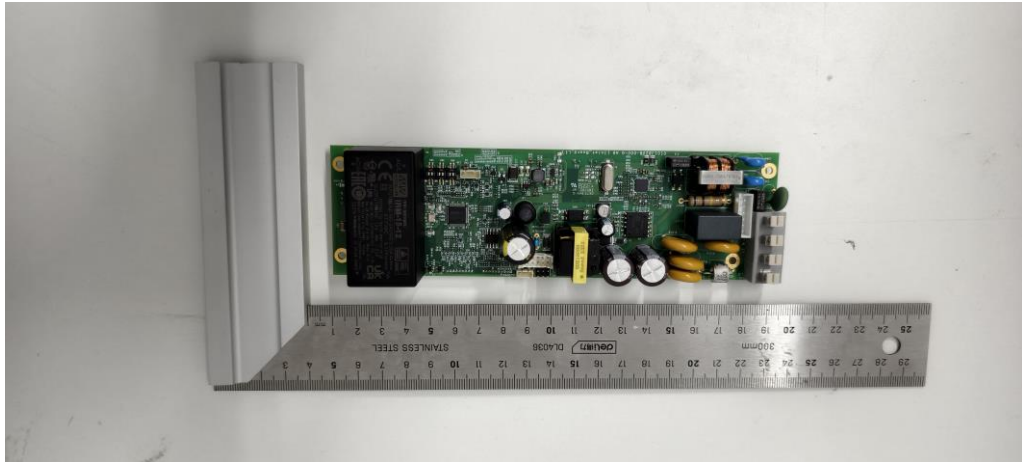


Photo 57: View of the Simple Inlet_Three Phase Board for SPIM series

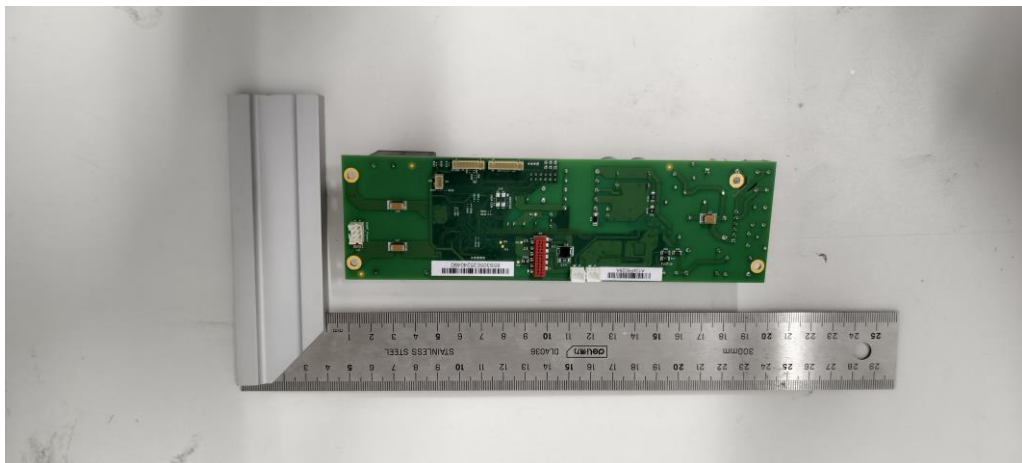


Photo 58: View of the Simple Inlet_Three Phase Board for SPIM series



Photo 59: View of the Inlet_board supplied by three phases



Photo 60: View of the Inlet_board supplied by three phases



Photo 61: Overall view for model XBNPIM55-3632A1P-VXX



Photo 62: Overall view for model XBNPIM55-3632A1P-VXX

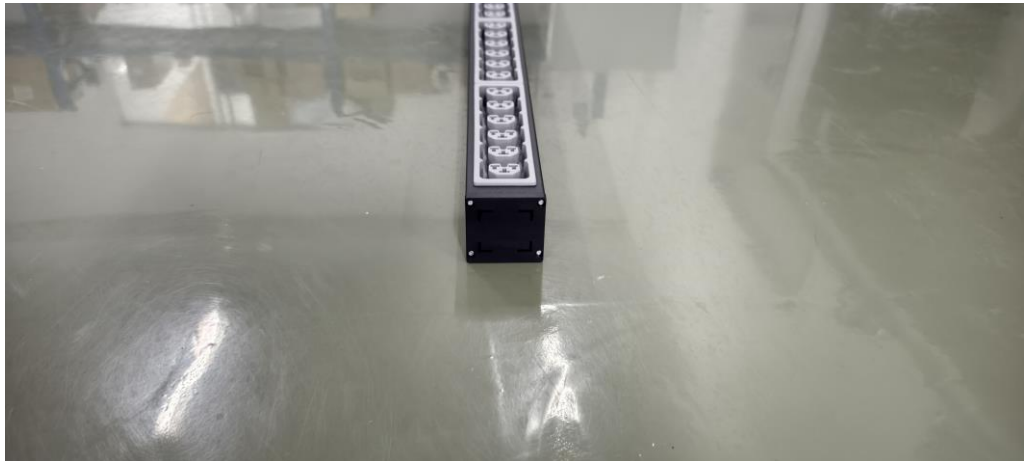


Photo 63: External view for model XBNPIM55-3632A1P-VXX



Photo 64: External view for model XBNPIM55-3632A1P-VXX



Photo 65: External view for model XBNPIM55-3632A1P-VXX



Photo 66: External view for model XBNPIM55-3632A1P-VXX



Photo 67: External view for model XBNPIM55-3632A1P-VXX

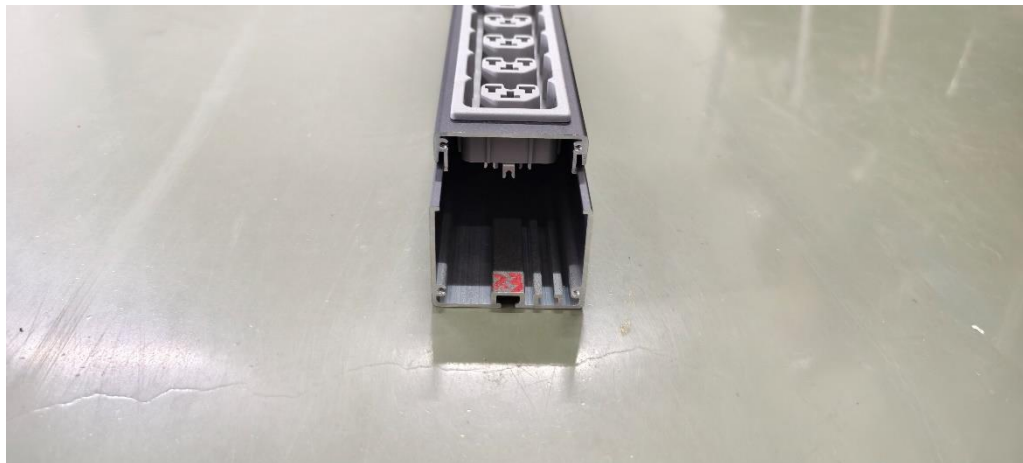


Photo 68: Right end internal view for model XBNPIM55-3632A1P-VXX



Photo 69: Left end internal view for model XBNPIM55-3632A1P-VXX

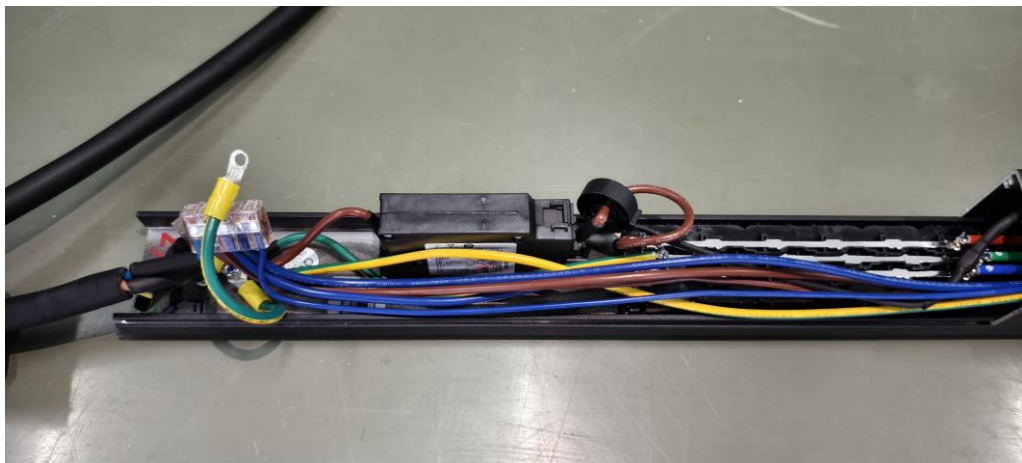


Photo 70: Left end internal view for model XBNPIM55-3632A1P-VXX



Photo 71: Internal view for model XBNPIM55-3632A1P-VXX

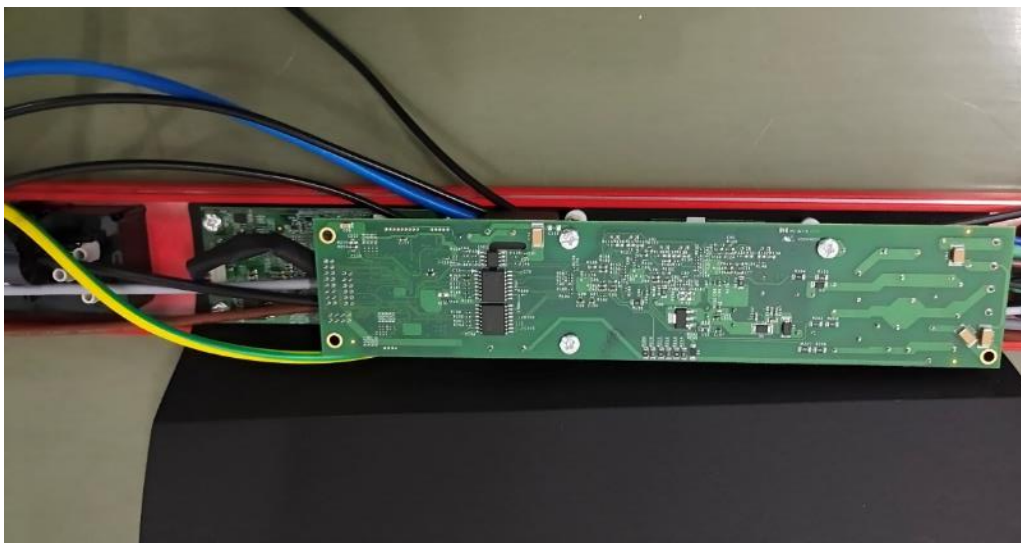


Photo 72: Internal view for model XBNPIM55-3632A1P-VXX